



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 20-0756
DATE PAID: 9/16/20
FEE PAID: 310.00
RECEIPT #: 1578730

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Charles Button

AGENT: North Florida Septic Tank Inc.

TELEPHONE: 386-755-6372

MAILING ADDRESS: 741 SE State Road 100 Lake City, Fla 32025

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(a) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: BLOCK: SUBDIVISION: -NA- PLATTED:

PROPERTY ID #: 32-25-16-01810-002 ZONING: I/M OR EQUIVALENT: ☒ Y ☐ N

PROPERTY SIZE: 5 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ≤ 2000 GPD ☐ > 2000 GPD

IS SEWER AVAILABLE AS PER 381.0065, PS? ☒ Y ☐ N DISTANCE TO SEWER: FT

PROPERTY ADDRESS: 1687 NW Queen Rd Lake City

DIRECTIONS TO PROPERTY: TRIP ON A1N, TRIP ON NW Bascom Norris Dr
TRIP ON NW Lake Jeffery Rd, TRIP ON NW Leonia Way,
TRIP ON NW Queen Rd TO 1687

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	<u>NEW home</u>	<u>2</u>	<u>1800</u>	
2	<u>With Porch Area</u>		<u>3432</u>	
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE: Robert W. Zelen


DATE: 9-10-2020

STATE OF FLORIDA
DEPARTMENT OF HEALTH
APPLICATION FOR CONSTRUCTION PERMIT

Permit Application Number 20-0756

Button

Scale: Each block represents 10 feet and 1 inch = 40 feet.

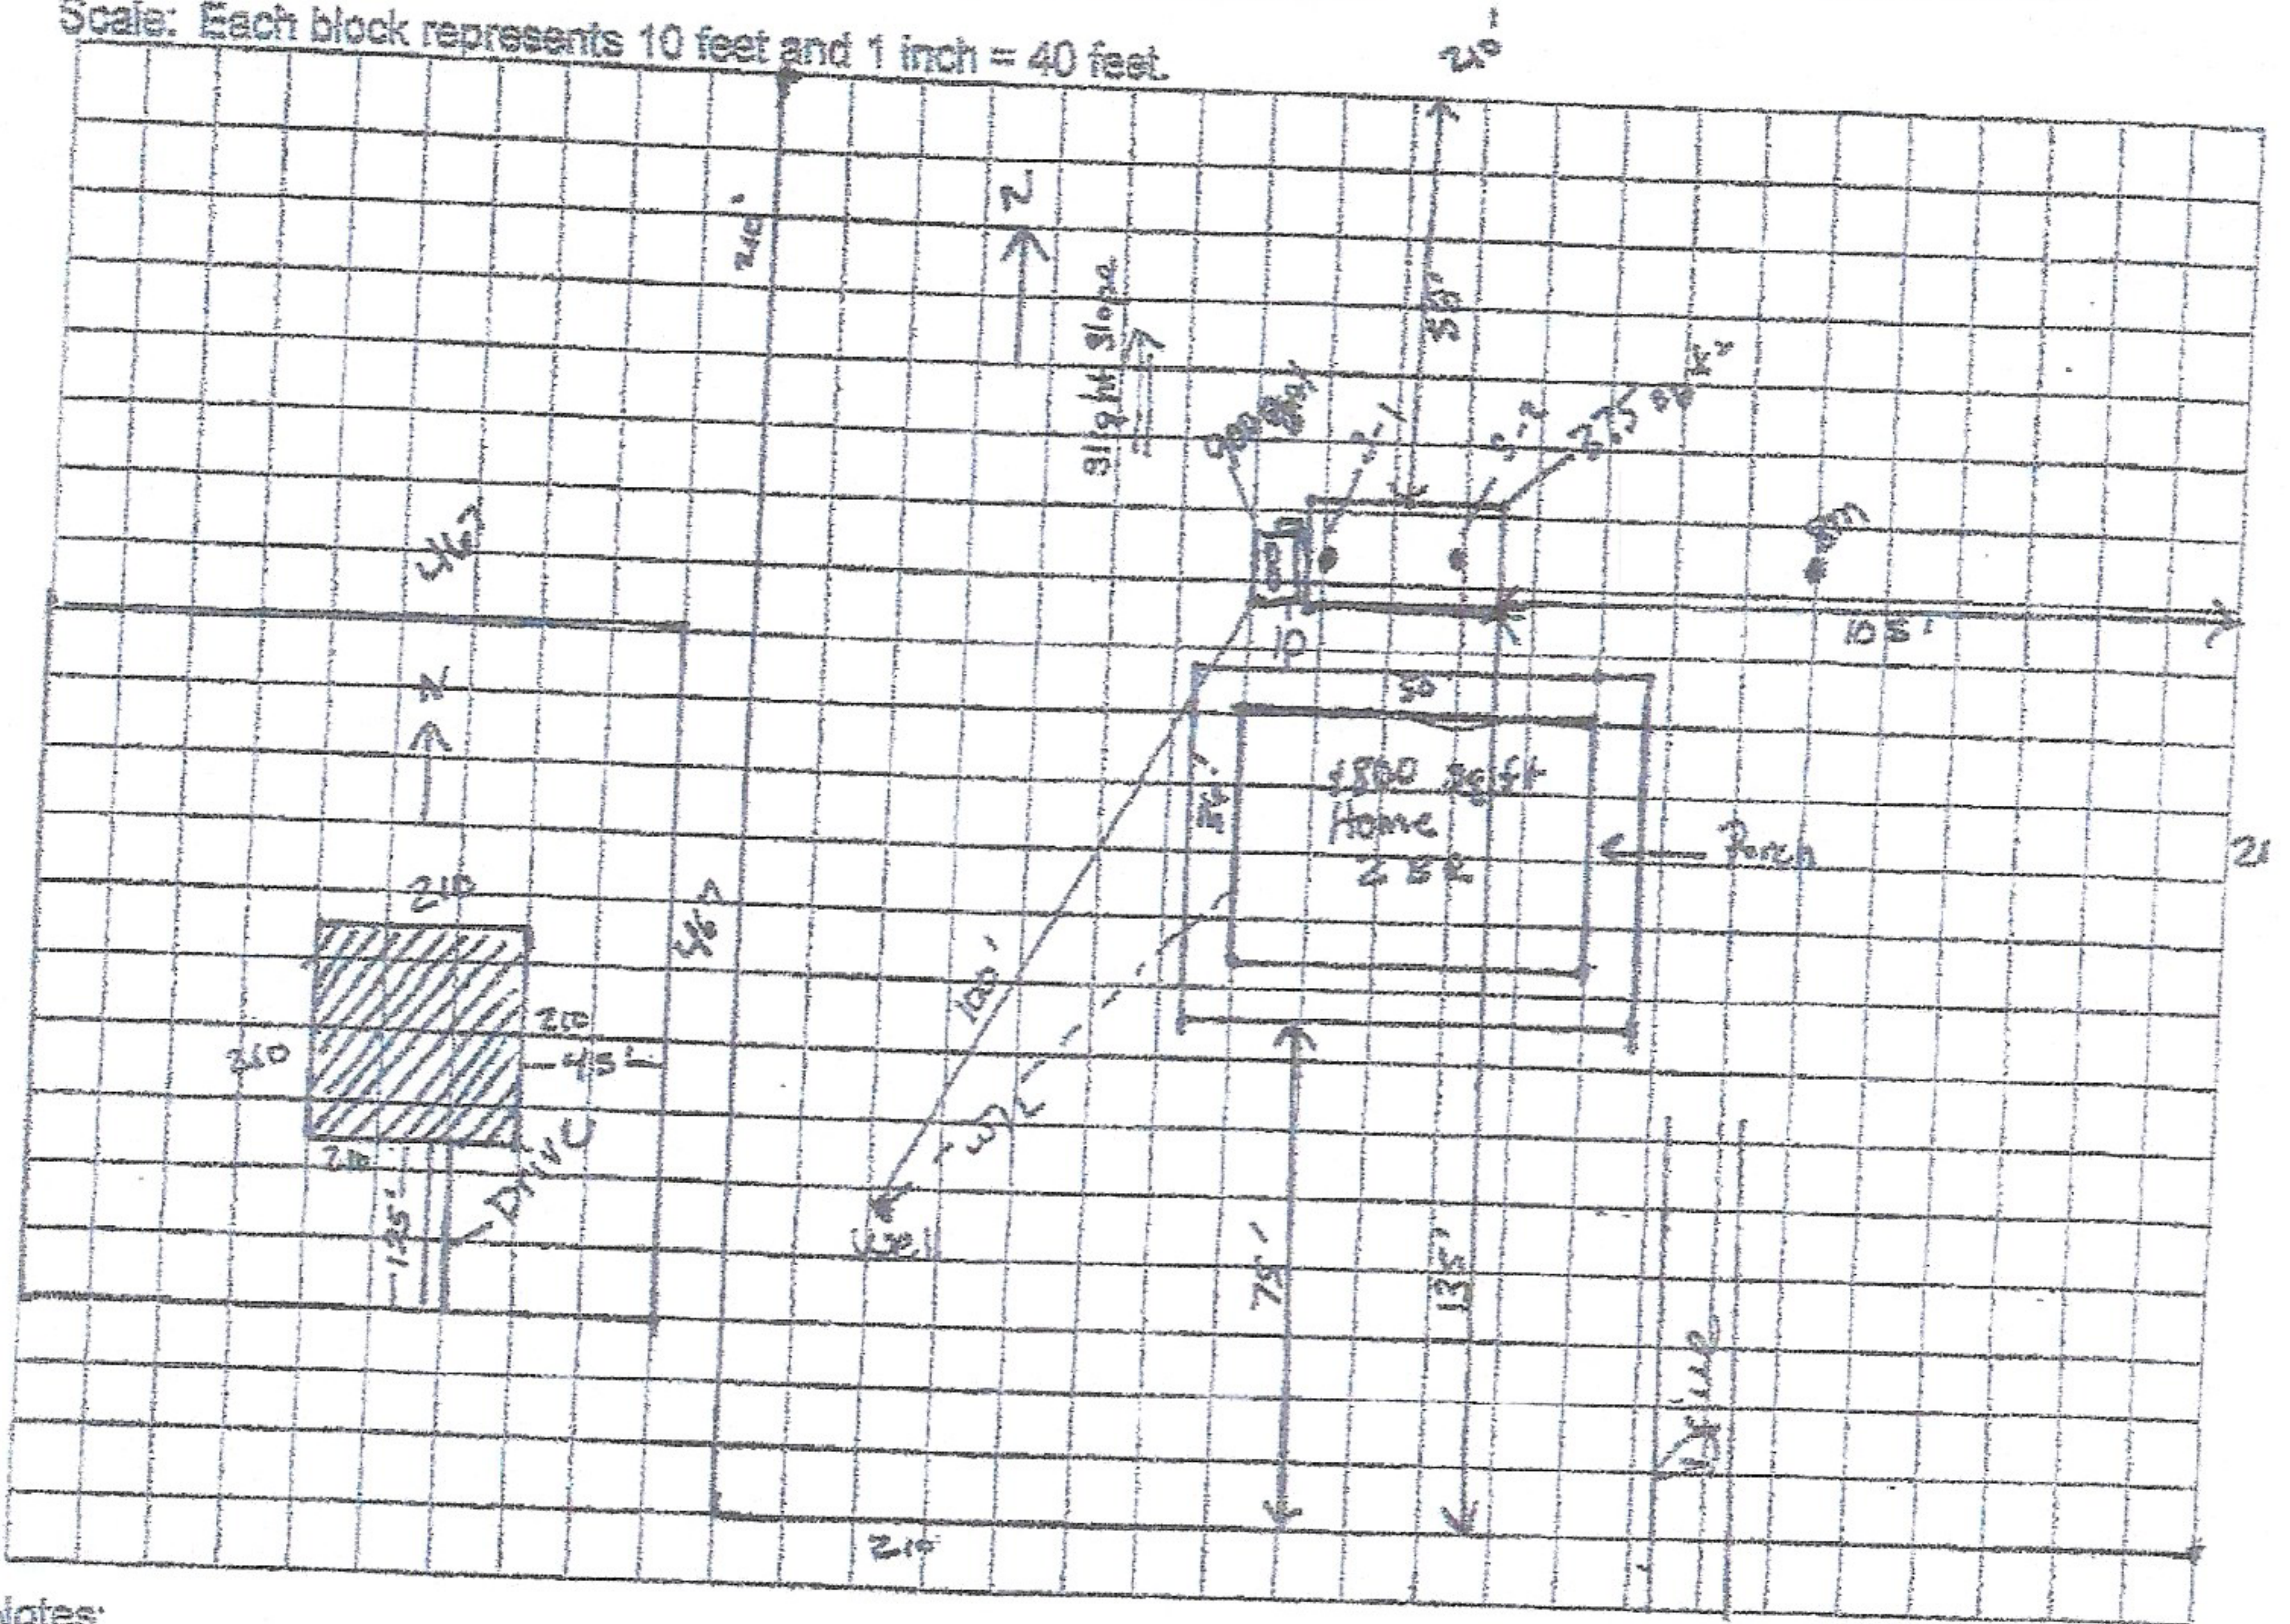

Notes:

Site Plan submitted by: Robert W. Ford III Date 9-10-2020

Plan Approved ☒ Not Approved ☐

By Kell Ry Columbia County Health Department Date 9/17/2020

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-2167415
APPLICATION #: AP1578730
DATE PAID: 9/16/2020
FEE PAID: 310.00
RECEIPT #: 12-PID-4672745
DOCUMENT #: PR1408398

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: CHARLES**20-0756 BUTTON

PROPERTY ADDRESS: 1687 NW QUEEN Lake City, FL 32055

LOT: _____ BLOCK: _____ SUBDIVISION: _____

PROPERTY ID #: 01810-002 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD New Septic CAPACITY
A [] GALLONS / GPD N/A CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS [] DOSES PER 24 HRS #Pumps []

D [375] SQUARE FEET Drainfield SYSTEM
R [] SQUARE FEET N/A SYSTEM

A TYPE SYSTEM: [X] STANDARD [] FILLED [] MOUND []
I CONFIGURATION: [X] TRENCH [] BED []

F LOCATION OF BENCHMARK: Oak tree E of site

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES] FT [] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [40.00] [INCHES] FT [] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT

D FILL REQUIRED: [2.00] INCHES EXCAVATION REQUIRED: [] INCHES

The system is sized for 2 bedrooms with a maximum occupancy of 4 persons (2 per bedroom), for a total estimated flow of 300 gpd.

SPECIFICATIONS BY: Ronald Ford

TITLE: Master Contractor

APPROVED BY: Kelli C Rogers

TITLE: Environmental Specialist II Columbia CHD

DATE ISSUED: 09/17/2020

EXPIRATION DATE: 03/17/2022

DE 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC