

BREINES RESIDENCE
12.78kW PV SYSTEM
315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

Castillo

Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250,

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

BREINES RESIDENCE
315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME




COVER SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

G-01

PROJECT DESCRIPTION:	CODES AND STANDARDS	OWNER	HOUSE PHOTO																																
<p>35x365 REC : REC365AA (365W) MODULES ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES</p> <p>SYSTEM SIZE: 12.78 kW DC STC ARRAY AREA #1: 339.00 SQ FT. ARRAY AREA #2: 320.11 SQ FT.</p> <p>EQUIPMENT SUMMARY</p> <p>35 REC : REC365AA (365W) MODULES 35 ENPHASE: IQ7PLUS-72-2-US MICROINVERTERS 01 TESLA GATEWAY 2 02 TESLA POWERWALL 2 (BATTERIES TO BE INSTALLED UPON AVAILABILITY)</p> <p>RACKING: SNAPNRACK ULTRA RAIL UR-60 ATTACHMENT: S-5! PROTEA BRACKET</p> <p>DESIGN CRITERIA :</p> <p>WIND SPEED (ULT): 130 MPH WIND SPEED (ASD): 101 MPH RISK CATEGORY: II EXPOSURE: B</p> <p>AUTHORITY HAVING JURISDICTION: COLUMBIA COUNTY</p>	<p>GOVERNING CODES : FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 (FRC) FLORIDA PLUMBING CODE, 7TH EDITION 2020 (FPC) FLORIDA BUILDING CODE, 7TH EDITION 2020 (FBC) FLORIDA MECHANICAL CODE, 7TH EDITION 2020 (FMC) NATIONAL ELECTRICAL CODE 2017 (NEC) ASCE 7-16</p> <div></div>	<p>BREINES, RICHARD</p> <p>INSTALLER</p> <p>POWER PRODUCTION MANAGEMENT 625 NW 8th Ave, Gainesville, FL 32601 (352) 263-0766</p> <p>ENGINEER</p> <p>Castillo Engineering Services LLC 620 N. Wymore Road, Suite 250, Maitland, FL 32751 TEL: (407) 289-2575 Ermocrates E. Castillo License#: FL PE 52590</p> <table><tr><th colspan="2">SHEET INDEX</th></tr><tr><th>SHEET #</th><th>SHEET DESCRIPTION</th></tr><tr><td>G-01</td><td>COVER SHEET</td></tr><tr><td>A-00</td><td>NOTES AND DESCRIPTION</td></tr><tr><td>A-01</td><td>ROOF PLAN</td></tr><tr><td>S-01</td><td>MODULE LAYOUT</td></tr><tr><td>S-01.1</td><td>PARTIAL PRESSURE AND MODULES EXPOSURE</td></tr><tr><td>S-02</td><td>ATTACHMENT DETAIL</td></tr><tr><td>S-02.1</td><td>STRUCTURE CALCULATION</td></tr><tr><td>E-01</td><td>ELECTRICAL LINE DIAGRAM</td></tr><tr><td>E-02</td><td>WIRING CALCULATIONS</td></tr><tr><td>E-03</td><td>SYSTEM LABELING</td></tr><tr><td>DS-01-07</td><td>DATA SHEETS</td></tr><tr><td></td><td></td></tr><tr><td></td><td></td></tr><tr><td></td><td></td></tr></table>	SHEET INDEX		SHEET #	SHEET DESCRIPTION	G-01	COVER SHEET	A-00	NOTES AND DESCRIPTION	A-01	ROOF PLAN	S-01	MODULE LAYOUT	S-01.1	PARTIAL PRESSURE AND MODULES EXPOSURE	S-02	ATTACHMENT DETAIL	S-02.1	STRUCTURE CALCULATION	E-01	ELECTRICAL LINE DIAGRAM	E-02	WIRING CALCULATIONS	E-03	SYSTEM LABELING	DS-01-07	DATA SHEETS							<div></div> <div></div>
SHEET INDEX																																			
SHEET #	SHEET DESCRIPTION																																		
G-01	COVER SHEET																																		
A-00	NOTES AND DESCRIPTION																																		
A-01	ROOF PLAN																																		
S-01	MODULE LAYOUT																																		
S-01.1	PARTIAL PRESSURE AND MODULES EXPOSURE																																		
S-02	ATTACHMENT DETAIL																																		
S-02.1	STRUCTURE CALCULATION																																		
E-01	ELECTRICAL LINE DIAGRAM																																		
E-02	WIRING CALCULATIONS																																		
E-03	SYSTEM LABELING																																		
DS-01-07	DATA SHEETS																																		
STRUCTURAL CERTIFICATION:	ELECTRICAL CERTIFICATION:																																		
<p>I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7th ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES, AND EQUIPMENT DEAD LOADS.</p>	<p>I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.</p>																																		

Symbols:

Section.....

Sheet where section is located

Elevation

Detail ID Letter

Sheet where section is located

Detail

Detail ID Letter

Sheet where section is located

Detail

Detail ID Letter

Area to be enlarged

Sheet where section is located

Keyed Notes

1

Keyed note designation on applicable sheet

Ground Terminal

Grounding Point/rod....

Solar Panel

or

00

Module with Source Circuit number

Combiner Box

CB

AC Disconnect

ACD

Main Distribution Panel

MDP

Fuse

Overcurrent Breaker ..

Inverter

Transformer

Automatic

ATS

Transfer Switch

Vent, Attic fan (Roof obstruction)

PV Roof Attachment

Trusses

Conduit

Fire Access

Abbreviations:

AC	Alternating Current
ACD	AC Disconnect
APPROX	Approximate
AWG	American Wire Gauge
BAT	Battery
CB	Combiner Box
DC	Direct Current
DISC	Disconnect
(E)	Existing
EL	Elevation
EQ	Equal
GP	Generation Panel
JB	Junction Box
MCB	Main Combiner Box
MFR	Manufacturer
MID	Microgrid Interconnect Device
MIN	Minimum
MISC	Miscellaneous
MDP	Main Distribution Panel
(N)	New
NAVD	North American Vertical datum
OCPD	OverCurrent Protection Device
POCC	Point Of Common Coupling
PV	Photovoltaic
SF	Squarefoot/feet
STC	Standard Test Conditions
SD	Soladeck
TBD	To Be Determined
TYP	Typical
UNO	Unless Noted Otherwise
UM	Utility meter
VIF	Verify In Field
WP	Weather Proof

System Description

This system is a grid-tied, PV system, with PV generation consisting of 35x365 REC : REC365AA (365W) Modules with a combined STC rated dc output power of 12,775W. The modules are connected into 35 Enphase: IQ7PLUS-72-2-US microinverters. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electrical Code*

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

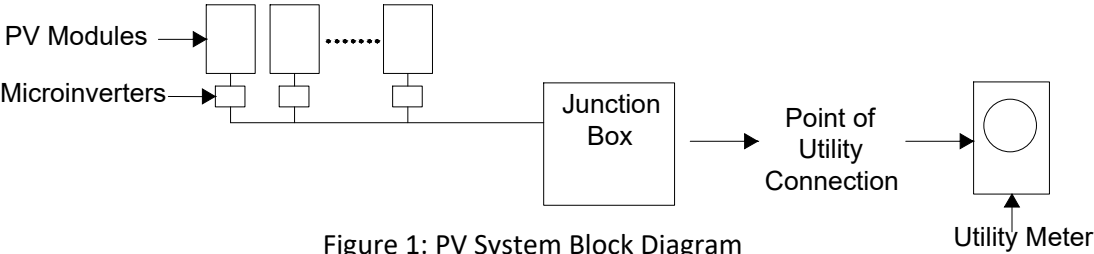


Figure 1: PV System Block Diagram


The inverter meets the requirements of IEEE 1547 and UL 1741.

FALL PROTECTION:
ANCHORAGES USED FOR ATTACHMENT OF PERSONAL FALL ARREST EQUIPMENT MUST BE INDEPENDENT OF ANY ANCHORAGE BEING USED TO SUPPORT OR SUSPEND PLATFORMS, AND CAPABLE OF SUPPORTING AT LEAST 5,000 POUNDS PER EMPLOYEE ATTACHED, OR MUST BE DESIGNED AND USED AS FOLLOWS:

- AS PART OF A COMPLETE PERSONAL FALL ARREST SYSTEM WHICH MAINTAINS A SAFETY FACTOR OF AT LEAST TWO.
- UNDER THE SUPERVISION OF A QUALIFIED PERSON

ADDITIONAL INFORMATION

- 29 CFR 1926 SUBPART M, FALL PROTECTION. OSHA STANDARD.
- 1926.502, FALL PROTECTION SYSTEMS CRITERIA AND PRACTICES
- ... 1926.502(D)(15)

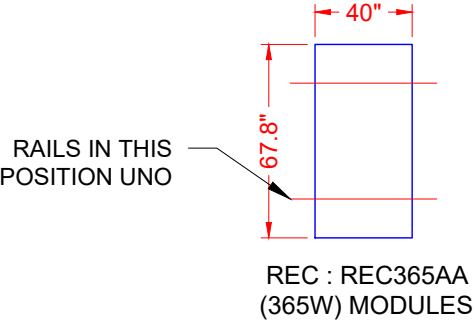

ALLOWABLE/DESIGN PRESSURE	PSF
DOWN PRESSURE	75
UPLIFT PRESSURE, 2 RAILS	75

Castillo Engineering
SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD, SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER
PRODUCTION MANAGEMENT, INC.

Signature with Seal


PROJECT NAME

BREINES RESIDENCE
315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME
NOTES AND DESCRIPTION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
A-00



Castillo
Engineering 
SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER
PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME


ROOF PLAN

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

A-01

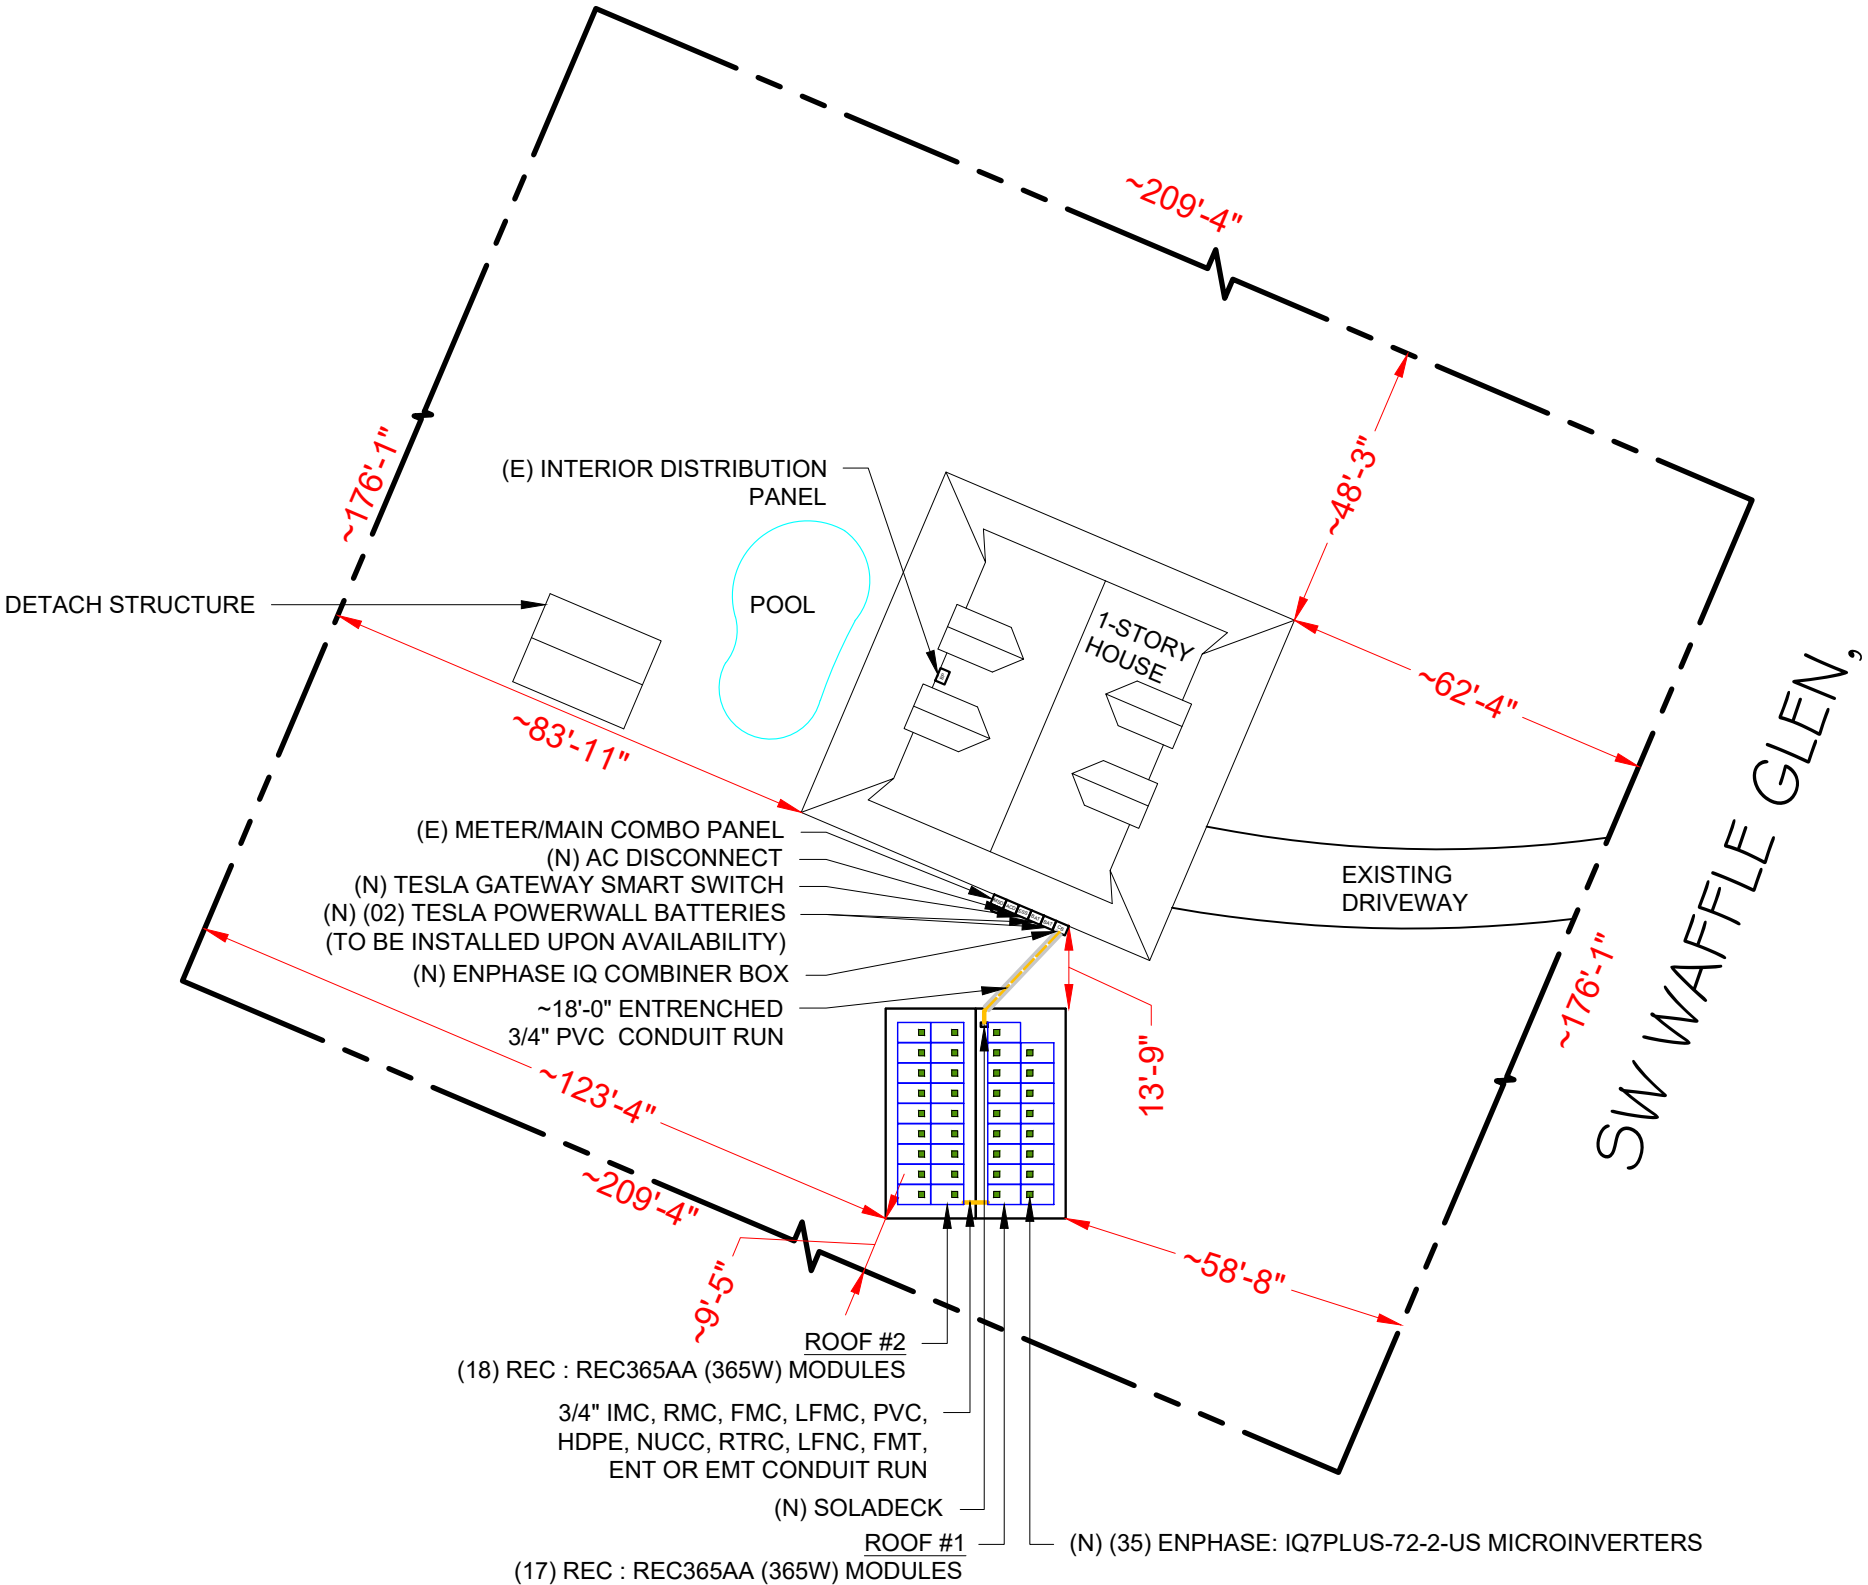


1 | ROOF PLAN AND PROPERTY LINES

A-01

SCALE: 1/32" = 1'-0"

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 35 MODULES
MODULE TYPE = REC : REC365AA (365W) MODULES
MODULE WEIGHT = 42.99 LBS / 19.5 KG.
MODULE DIMENSIONS = 67.8"x 40" = 18.83 SF
UNIT WEIGHT OF ARRAY = 2.28 PSF



ARRAY AREA & ROOF AREA CALC'S								
ROOF	ROOF TYPE	ARRAY AREA (sq.Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)	TILT	AZIMUTH	TRUSS SIZE	TRUSSES SPACING
#1	METAL	339.00	524.93	64.58	14°	90°	2"X4"	24" O.C.
#2	METAL	320.11	524.93	60.98	14°	270°	2"X4"	24" O.C.

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO SEAM SHALL BE INSTALLED AS SHOWN IN SHEET S-02.2 AND AS FOLLOWS FOR EACH WIND ZONE:

FOR GABLE ROOF TOP MOUNTED MODULES:

WIND ZONES	NON - EXPOSED MODULES		EDGE / EXPOSED MODULES	
	SPAN	CANTILEVER	SPAN	CANTILEVER
ZONE 1	6' - 0"	1' - 4"	5' - 0"	1' - 4"
ZONE 1'	X	X	X	X
ZONE 2e	6' - 0"	1' - 4"	5' - 0"	1' - 4"
ZONE 2n	6' - 0"	1' - 4"	4' - 0"	1' - 4"
ZONE 2r	6' - 0"	1' - 4"	4' - 0"	1' - 4"
ZONE 3e	6' - 0"	1' - 4"	4' - 0"	1' - 4"
ZONE 3r	5' - 0"	1' - 4"	3' - 0"	1' - 0"

SEE SHEET S-02.3 FOR SUPPORTING CALCULATIONS.

2) EXISTING RESIDENTIAL BUILDING HAVE 2"X4" SYP TRUSSES SPACED AT 24" O.C. AND METAL ROOF DECKS WITH MEAN ROOF HEIGHTS OF 15 FT WITH SEAMS SPACED 12" O.C. EXISTING ROOF SLOPE FOR THE SOLAR RETROFIT IS 14 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS

* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7TH ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE LATERAL AND UPLIFT WIND LOADS AND EQUIPMENT DEAD LOADS. *



CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD, SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal


PROJECT NAME

BREINES RESIDENCE
315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME
MODULE LAYOUT


SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
S-01

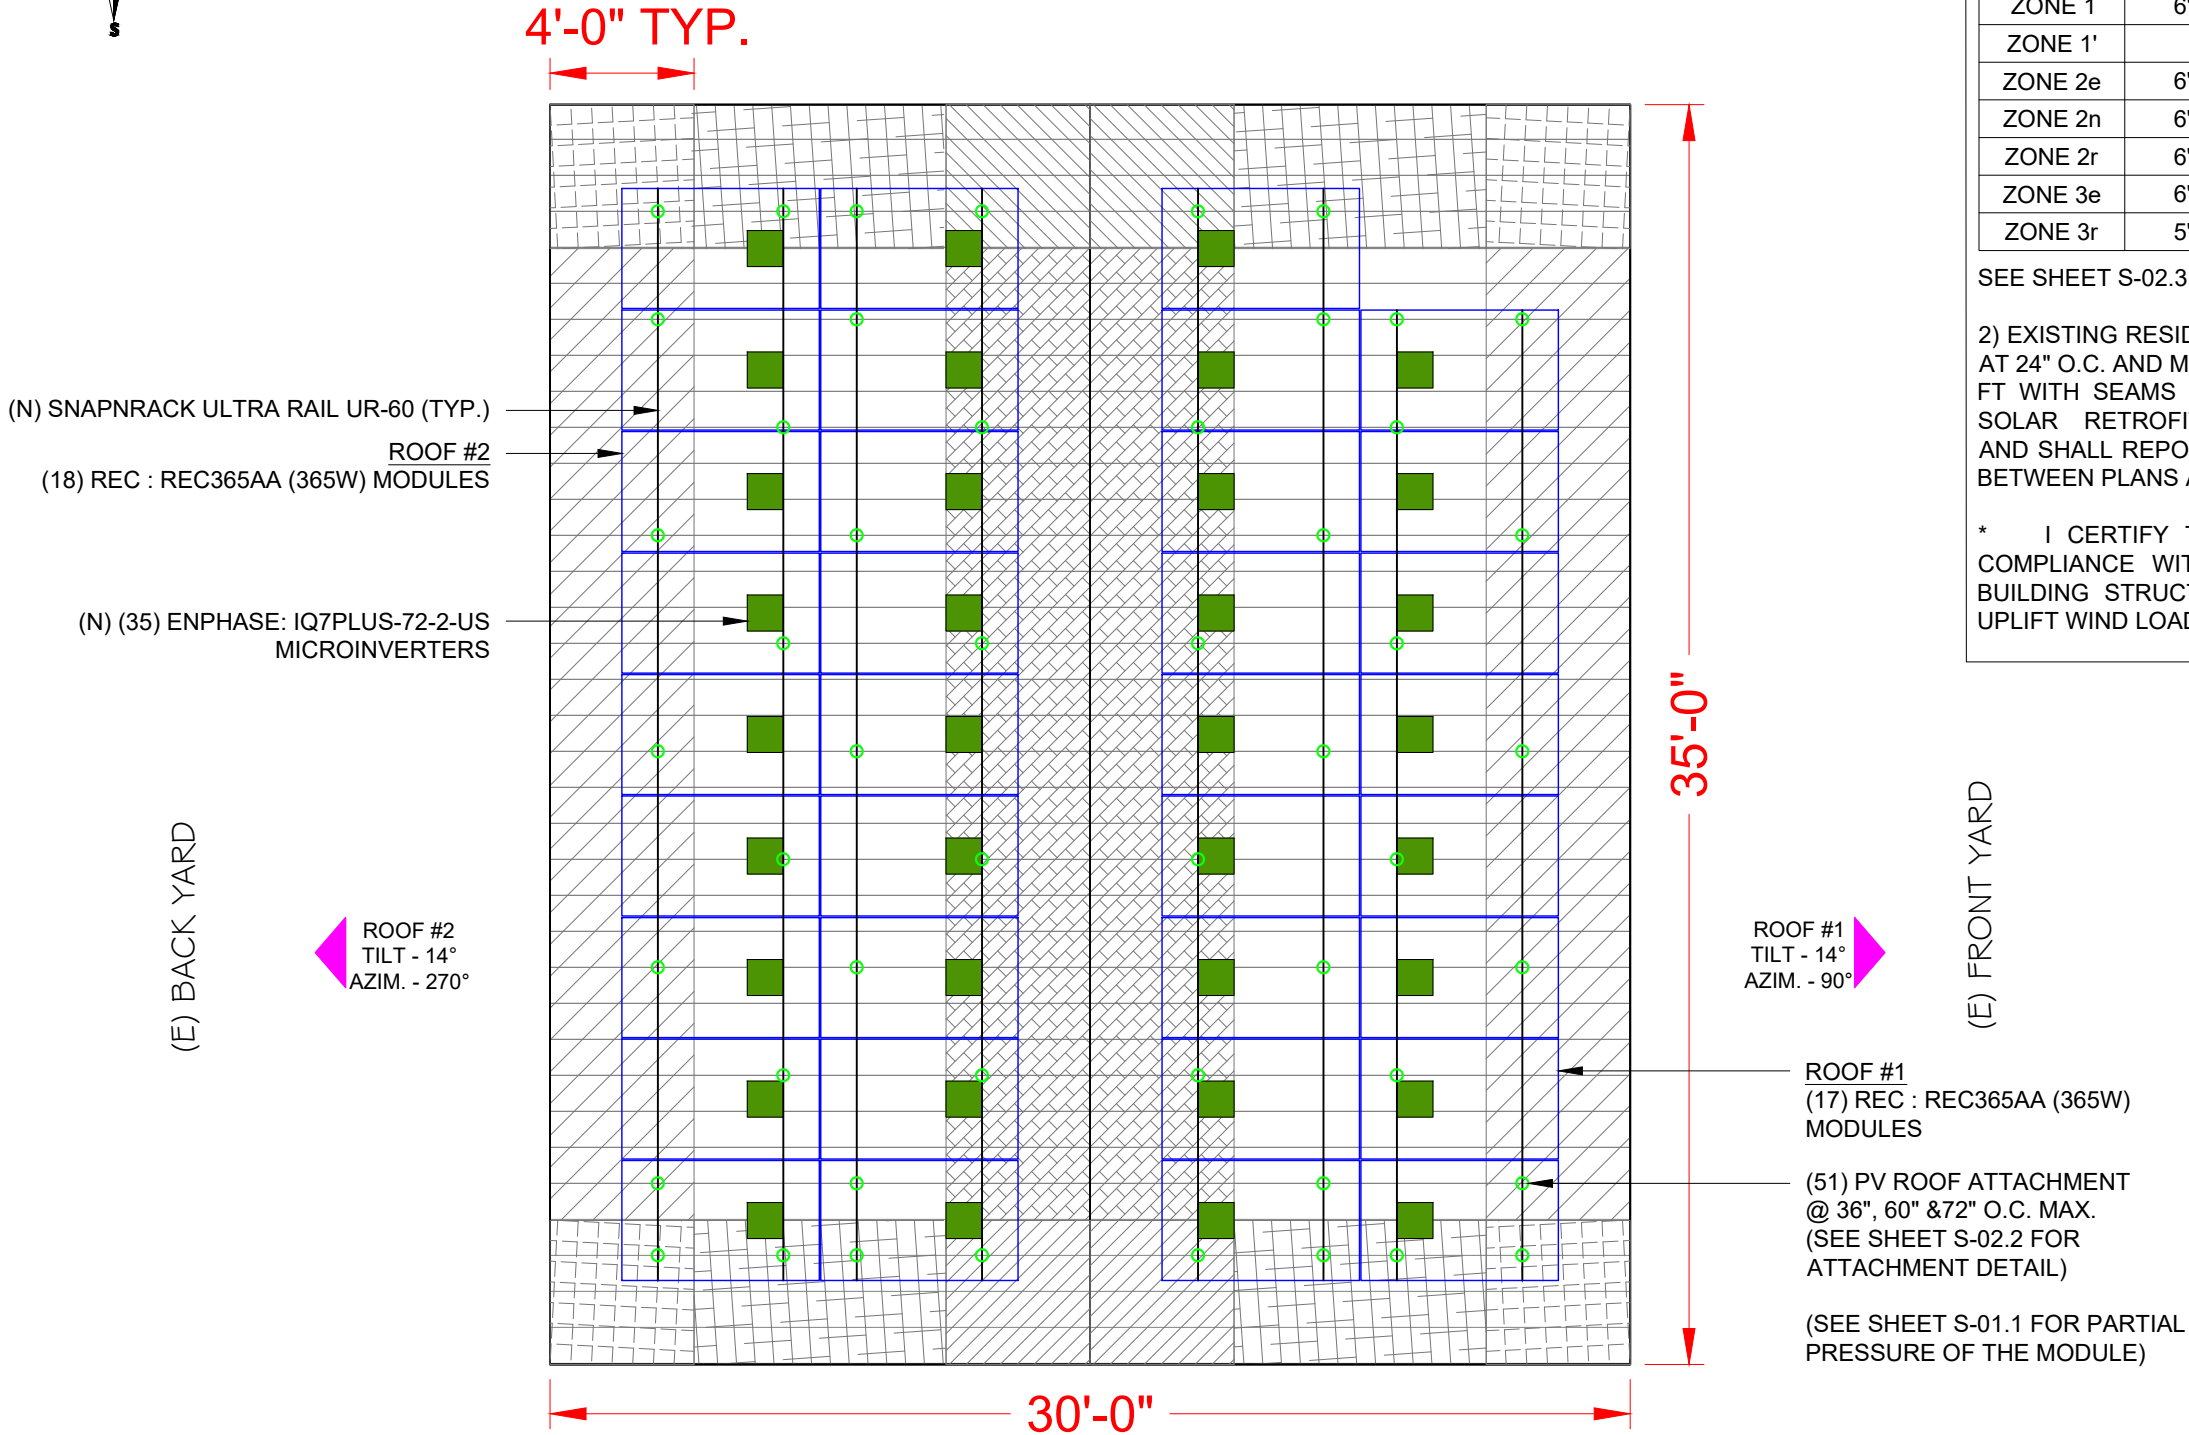


LEGEND

- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)



4'-0" TYP.

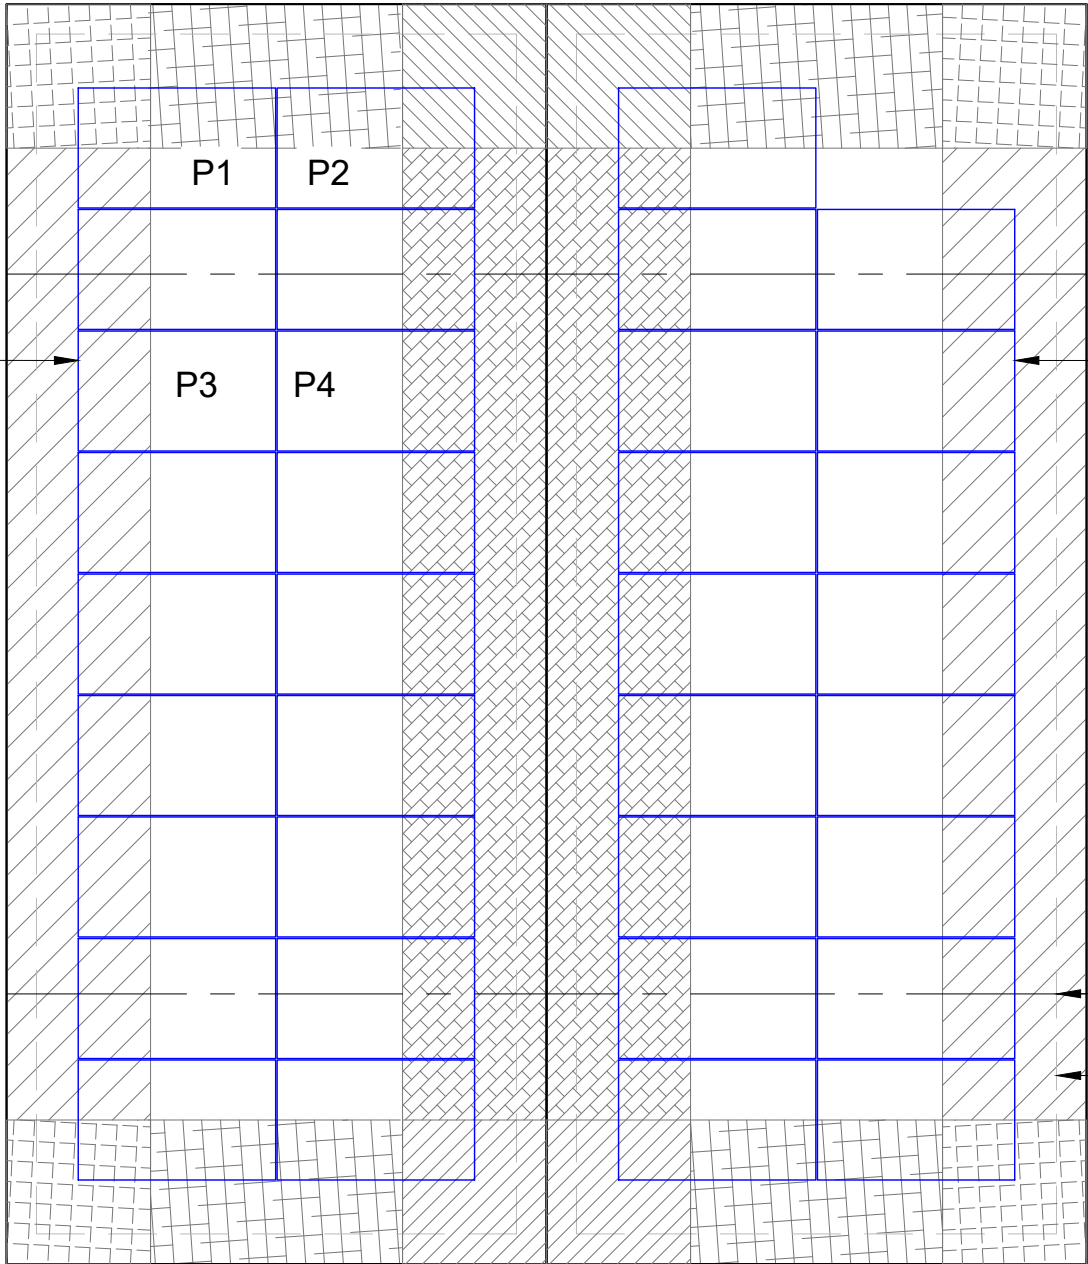

ROOF #2
(18) REC : REC365AA (365W)
MODULES

ROOF #1
(17) REC : REC365AA (365W)
MODULES

(E) BACK YARD

(E) FRONT YARD

0.5h

2h₂

2h₂ DISTANCE : 0' - 10"
0.5h DISTANCE : 7' - 6"

NOTE : PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

FOR NON-EXPOSED MODULES

1	1'	2e	2n	2r	3e	3r
19.5	0	19.5	24.3	24.3	24.3	28.7

Module Size 18.83 Sq. ft.

Non-Exposed modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P1	5.96	0	3.44	5.98	0	3.45	0	21.90
P2	5.98	0	0	5.99	3.42	0	3.43	23.56
P3	11.93	0	6.88	0	0	0	0	19.49
P4	11.96	0	0	0	6.86	0	0	21.24

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS: 75 PSF

LEGEND

- EXPOSED MODULE
- EDGE MODULE
- NON- EXPOSED MODULE
- MISSING MODULE
- MIN. MODULE EDGE DISTANCE LINE
- MODULE EXPOSURE LINE
- WIND ZONE 1 (TYP)
- WIND ZONE 2 & 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3 & 3e (TYP)



CASTILLO ENGINEERING
SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

PARTIAL PRESSURE AND
MODULES EXPOSURE

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

S-01.1

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER™
PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME


BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038


SHEET NAME
ATTACHMENT DETAIL
FOR METAL ROOF

SHEET SIZE
ANSI B
11" X 17"


SHEET NUMBER
S-02

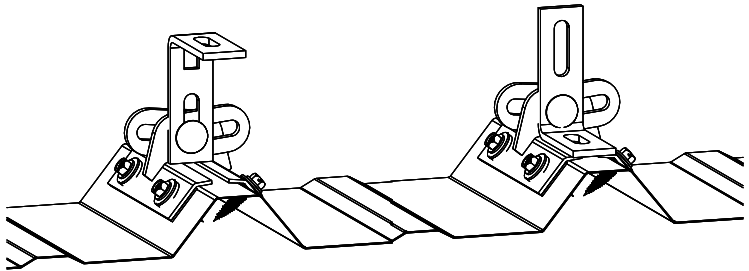


ProteaBracket

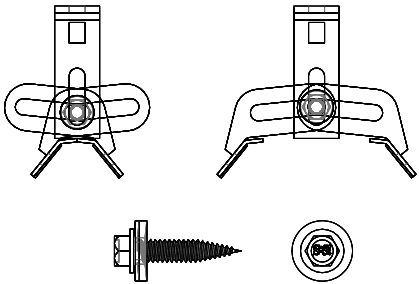


FOR STANDING SEAM SPECIFIC MECHANICAL LOAD TEST
INFORMATION AND CLAMP INSTALLATION INFORMATION
PLEASE VISIT: WWW.S-5.COM

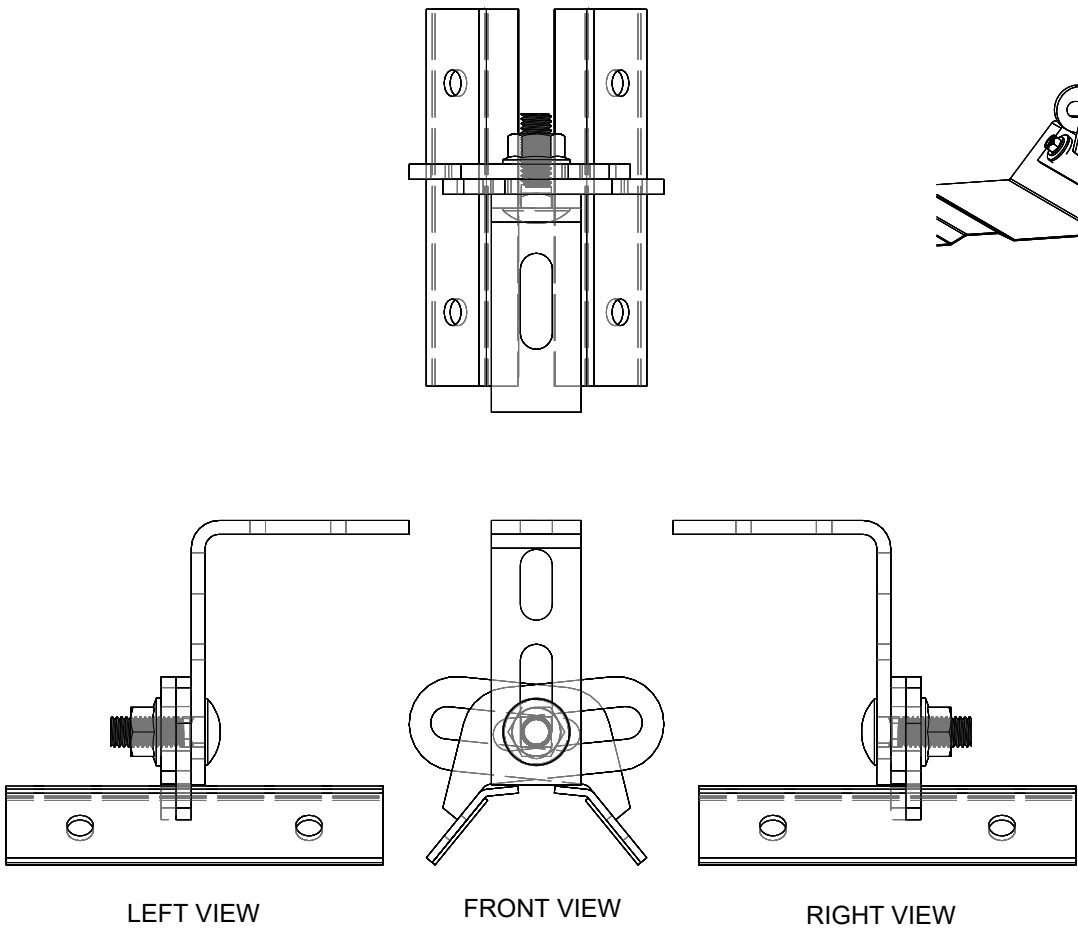


1 ATTACHMENT DETAIL
S-02 SCALE - NTS

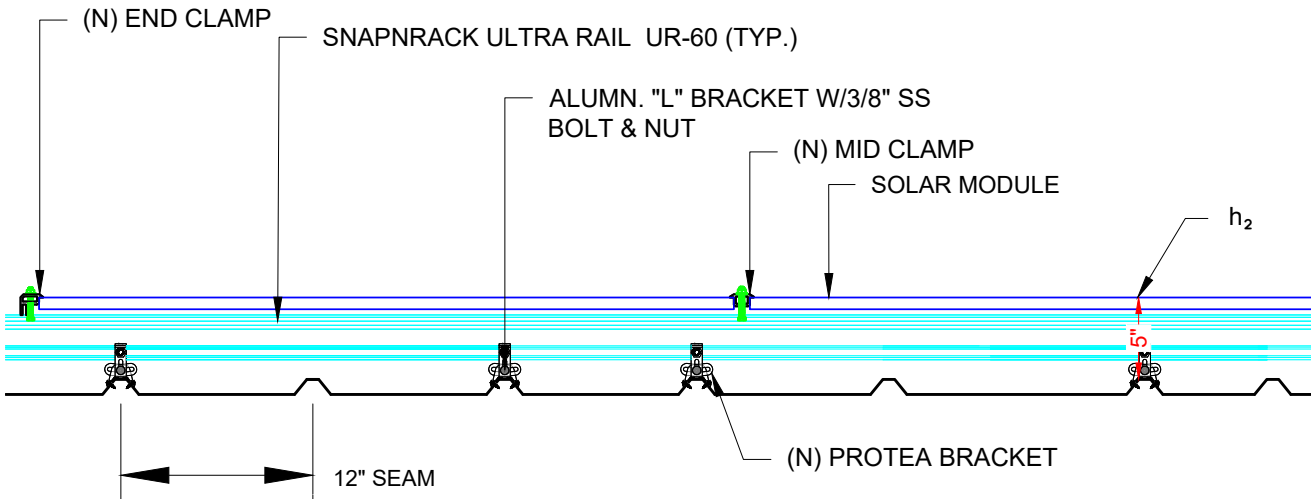

2 ATTACHMENT DETAIL
S-02 SCALE: 1" = 1'-0"

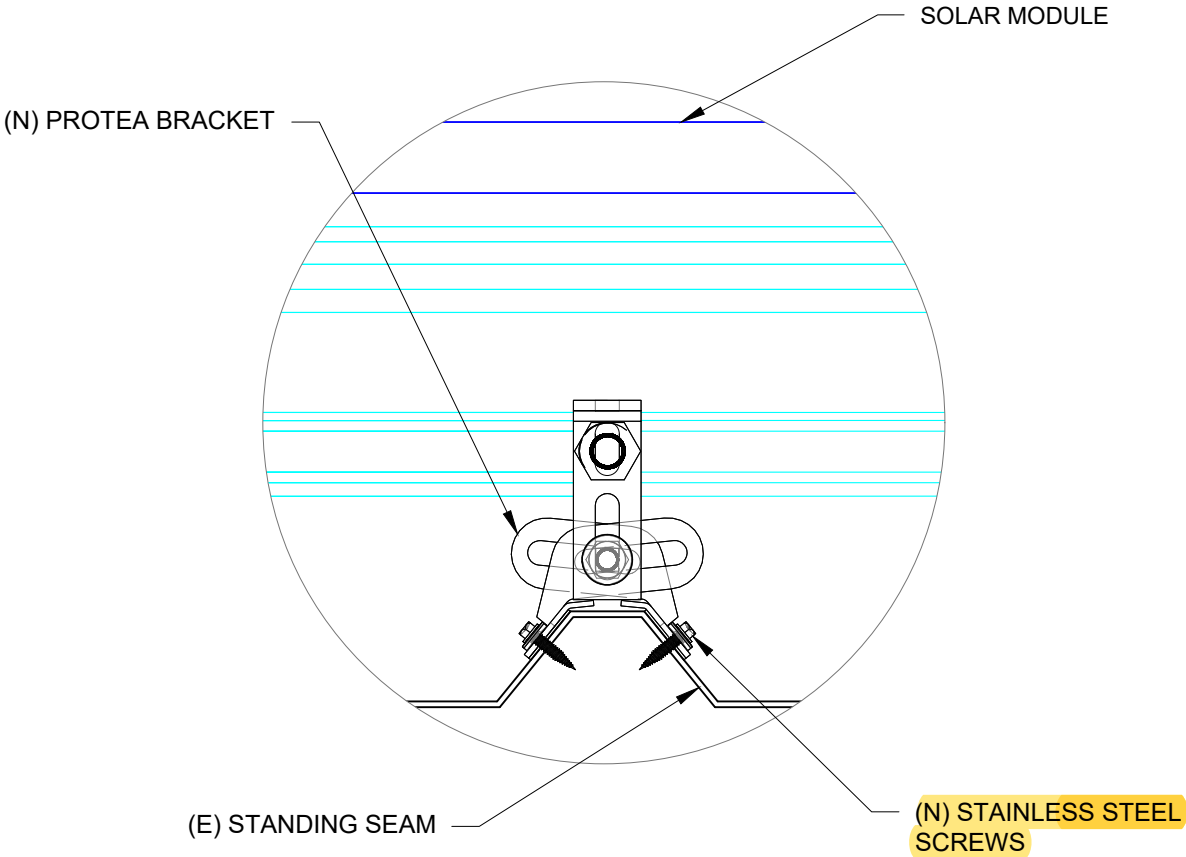

3 ATTACHMENT DETAIL (ENLARGED VIEW)
S-02 SCALE: 6" = 1'-0"

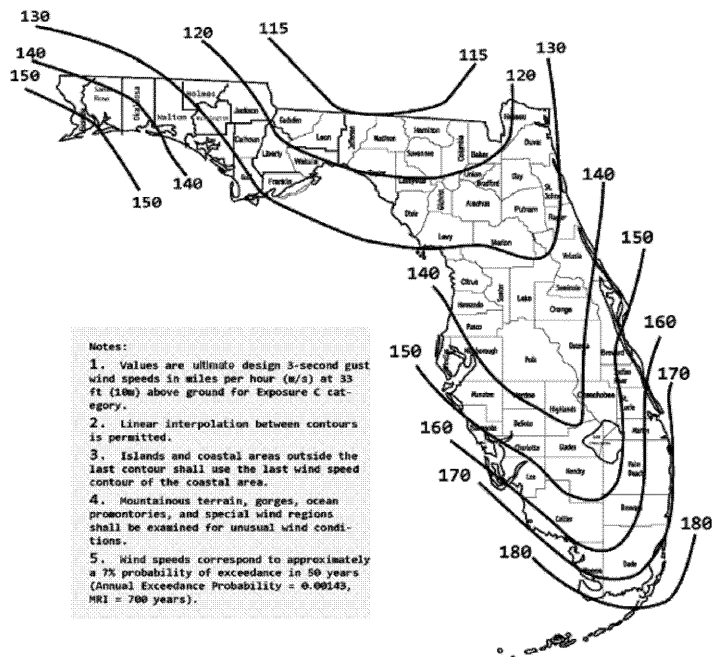

Notes:
1. Values are ultimate design 3-second gust wind speeds in miles per hour (m/s) at 33 ft (10m) above ground for Exposure C category.
2. Linear interpolation between contours is permitted.
3. Islands and coastal areas outside the last contour shall use the last wind speed contour of the coastal area.
4. Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.
5. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (Annual Exceedance Probability = 0.00143, WPI = 700 years).

FIGURE 1609.3(1)
ULTIMATE DESIGN WIND SPEEDS, V_{ULT} , FOR RISK CATEGORY II BUILDINGS AND OTHER STRUCTURES

WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	15.0	EXPOSURE CATEGORY	B
ROOF LENGTH (ft)	35.0	ROOF SLOPE	3 / 12
ROOF WIDTH (ft)	30.0	ROOF SLOPE (°)	14.0
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	GABLE
MODULE LENGTH (in)	67.8	ULTIMATE WIND SPEED	130 mph
MODULE WIDTH (in)	40.0	NOMINAL WIND SPEED	101 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR (C_e)	1.000
MODULE AREA (sq. ft.)	18.83	TEMPERATURE FACTOR (C_t)	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR (I_s)	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR (C_s)	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	K_D	0.850
EFFECTIVE WIND AREA (ft^2)	18.8	K_{ZT}	1.000
GROUND ELEVATION (ft)	62.0	K_e	0.998
HVHZ	NO	K_z	0.575

DESIGN CALCULATIONS			
VELOCITY PRESSURE (q) = $.00256 \cdot K_e \cdot K_z \cdot K_{ZT} \cdot K_D \cdot V^2$			
VELOCITY PRESSURE(ASD) 12.7 psf			
WIDTH OF PRESSURE COEFFICIENT	30' * 10%	=	3'
	15' * 40%	=	6'
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	0.471	-2.056
	ZONE 1'	X	X
	ZONE 2e	0.471	-2.056
	ZONE 2n	0.471	-2.607
	ZONE 2r	0.471	-2.607
	ZONE 3e	0.471	-2.607
	ZONE 3r	0.471	-3.105
INTERNAL PRESSURE COEFFICIENT (+/-) 0.18			

DESIGN PRESSURES			
ROOF ZONE	DOWN	UP	
1	16.0	-28.3	psf
1'	X	X	psf
2e	16.0	-28.3	psf
2n	16.0	-35.3	psf
2r	16.0	-35.3	psf
3e	16.0	-35.3	psf
3r	16.0	-41.6	psf
Module allowable uplift pressure 75 psf			
Module allowable down pressure 75 psf			

ARRAY FACTORS			
ARRAY EDGE FACTOR (EXPOSED)	1.5	SOLAR PANEL PRESSURE	
ARRAY EDGE FACTOR (NON-EXPOSED)	1	EQUALIZATION FACTOR	0.69003

ADJUSTED DESIGN PRESSURES			
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)
1	16.0	-29.3	-19.5
1'	X	X	X
2e	16.0	-29.3	-19.5
2n	16.0	-36.5	-24.3
2r	16.0	-36.5	-24.3
3e	16.0	-36.5	-24.3
3r	16.0	-43.0	-28.7

ATTACHMENTS USED	
ATTACHMENT MODEL	S-5 protea
ATTACHMENT STRENGTH	422 lbs

MAX DESIGN LOADS ALLOWABLE						
LIMIT MAX SPAN TO		N/A	in			
SEAM SPACING		12	in	NO. OF RAILS	Exposed: 2	Non. Exp: 2
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)		SPANS (E)	SPANS (N.E)
1	271.2	413.6	330.9	lbs	60 in	72 in
1'	X	X	X	lbs	X in	X in
2e	271.2	413.6	330.9	lbs	60 in	72 in
2n	271.2	412.4	412.4	lbs	48 in	72 in
2r	271.2	412.4	412.4	lbs	48 in	72 in
3e	271.2	412.4	412.4	lbs	48 in	72 in
3r	226.0	364.6	405.1	lbs	36 in	60 in

Castillo
Engineering
SOLAR DONE RIGHT®

CASTILLO ENGINEERING
SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER
PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME
STRUCTURAL
CALCULATION
FOR METAL ROOF

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
S-02.1

ELECTRICAL CALCULATION

Module Manufacturer	REC SOLAR
Module Model	REC365AA
Inverter Manufacturer	ENPHASE
Inverter Model	ENPHASE IQ 7 PLUS
Modules/Branch Circuit 1	12
Modules/Branch Circuit 2	12
Modules/Branch Circuit 3	11
TOTAL ARRAY POWER (KW)	12.78
SYSTEM AC VOLTAGE	240V 1-PHASE

DESIGN TEMPERATURE	
MIN. AMBIENT TEMP. °F	32
MAX. AMBIENT TEMP. °F	117
CALCULATED MAX. VOC	48
CALCULATED MIN VMP	29
CONDUIT FILL	
NUMBER OF CONDUITS	1

AMPACITY CALCULTIONS											
Circuit	MAX AMPS	1.25 X MAX AMPS	AWG	90 °C AMPACITY	AMBIENT TEMP °F	TEMP DERATE	CONDUIT FILL	FILL DERATE	DERATED AMPACITY	MAXIMUM CIRCUIT BREAKER	
Circuit 1	14.5	18.1	#10	40	130	0.76	6	0.8	24.32	20 A	
Circuit 2	14.5	18.1	#10	40	130	0.76	6	0.8	24.32	20 A	
Circuit 3	13.3	16.6	#10	40	130	0.76	6	0.8	24.32	20 A	
AC COMBINER PANEL OUTPUT	42.3	52.9	#6	75	95	0.96	3	1	72	60 A	

MAXIMUM CIRCUIT VOLTAGE DROP	2%
------------------------------	----

VOLTAGE DROP CALCULATIONS					
Circuit	AWG	CIRCULAR MILLS	I	V	MAX LENGTH
Circuit 1	#10	10380	14.5	240	133 FEET
Circuit 2	#10	10380	14.5	240	133 FEET
Circuit 3	#10	10380	13.3	240	145 FEET
COMBINER PANEL OUTPUT	#6	26240	42.3	240	115 FEET

NOTES	
	TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)
	CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)
	MAXIMUM VOC CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A)
	UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER
	ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE
	IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS
	IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION
	INFORMATION INPUT BY SYSTEM DESIGNER
	INFORMATON OBTAINED FROM MANUFACTURER DATASHEETS


MODULE PROPERTIES			
VOC	44	ISC	10.52
VMPP	37.1	IMP	9.85
TC VOC	-0.24%/ °C	TC VMP	-0.26%/ °C
PMP	365.0	NOCT	45 °C

INVERTER PROPERTIES	
OUTPUT VOLTAGE	240 L-L 1-PH
MAX INPUT DC VOLTAGE	60 VDC
OPERATING RANGE	16 - 60 VDC
MPPT VOLTAGE RANGE	27 - 45 VDC
START VOLTAGE	22 VDC
MAX INPUT POWER	440 WDC
CONTINUOUS AC POWER	290 VA

ELECTRICAL NOTES

1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
3. THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
4. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
5. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
6. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
7. WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
8. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
9. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
10. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
11. THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
12. UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
13. MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
14. RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
15. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
16. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).
17. THIS SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN OF PV CONDUCTORS IN COMPLIANCE WITH NEC 690.12.
18. LABELING IN COMPLIANCE WITH NEC 690.12 AND 690.56(C) IS SHOWN ON SHEET E-03.

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.




CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD, SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

E-02

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC 690.13(B))

WARNING

DUAL POWER SOURCE

SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(b))

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL LOCATION:
AC DISCONNECT
(PER CODE: NEC690.56(C)(3))

WARNING:

DO NOT ADD ANY LOADS IN THIS PANEL

LABEL LOCATION:
METER/MAIN COMBO PANEL



- ADHESIVE FASTENED SIGNS:
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
 - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].
 - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OPERATING CURRENT 42.3 AMPS

AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC690.54)

WARNING

INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:
POINT OF INTERCONNECTION
(PER CODE: NEC 705.12(B)(2)(3)(b))

DATA PER PANEL			
NOMINAL OPERATING AC VOLTAGE -	240	V	
NOMINAL OPERATING AC FREQUENCY-	60	Hz	
MAXIMUM AC POWER-	290	VA	
MAXIMUM AC CURRENT-	1.21	A	
MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION PER CIRCUIT-	20	A	

LABEL LOCATION:
COMBINER BOX
(PER CODE: NEC690.52)

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

LABEL LOCATION:
AC DISCONNECT, POINT OF INTERCONNECTION
(PER CODE: NEC 690.56(C)(1)(a), IFC 605.11.3.1(1))

Castillo Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD, SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER

PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

SYSTEM LABELING

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

E-03

SOLAR'S MOST TRUSTED



REC ALPHA
BLACK SERIES



375
WP
POWER

PRODUCT
REC
25 YEAR
PROTRUST
WARRANTY

ELIGIBLE FOR

EXPERIENCE
α
PERFORMANCE



REC ALPHA BLACK SERIES
PRODUCT DATASHEET



Measurements in mm [in]

GENERAL DATA

Cell type:	120 half-cut cells with REC heterojunction cell technology 6 strings of 20 cells in series	Connectors:	Stäubli MC4 PV-KBT4/KST4 (4 mm ²) in accordance with IEC 62852 IP68 only when connected
Glass:	3.2 mm solar glass with anti-reflection surface treatment	Cable:	4 mm ² solar cable, 1.0 m + 1.2 m in accordance with EN 50618
Backsheet:	Highly resistant polymeric construction (black)	Dimensions:	1721 x 1016 x 30 mm (1.75 m ²)
Frame:	Anodized aluminum (black)	Weight:	19.5 kg
Junction box:	3-part, 3 bypass diodes, IP67 rated in accordance with IEC 62790	Origin:	Made in Singapore

ELECTRICAL DATA

	Product Code*: RECxxxAA Black					
STC	Power Output - P _{MAX} (Wp)	355	360	365	370	375
	Watt Class Sorting - (W)	-0/+5	-0/+5	-0/+5	-0/+5	-0/+5
	Nominal Power Voltage - V _{MPP} (V)	36.4	36.7	37.1	37.4	37.8
	Nominal Power Current - I _{MPP} (A)	9.77	9.82	9.85	9.9	9.94
	Open Circuit Voltage - V _{OC} (V)	43.6	43.9	44.0	44.1	44.2
	Short Circuit Current - I _{SC} (A)	10.47	10.49	10.52	10.55	10.58
NMOT	Power Density (W/m ²)	202.85	205.71	208.57	211.42	214.28
	Panel Efficiency (%)	20.3	20.6	20.9	21.2	21.4
	Power Output - P _{MAX} (Wp)	271	274	278	282	286
	Nominal Power Voltage - V _{MPP} (V)	34.3	34.6	35.0	35.2	35.6
	Nominal Power Current - I _{MPP} (A)	7.89	7.93	7.96	8.00	8.03
	Open Circuit Voltage - V _{OC} (V)	41.1	41.4	41.5	41.6	41.6
	Short Circuit Current - I _{SC} (A)	8.46	8.47	8.50	8.52	8.55

Values at standard test conditions (STC: air mass AM 1.5, irradiance 1000 W/m², temperature 25°C), based on a production spread with a tolerance of P_{MAX}, V_{OC} & I_{SC} ±3% within one watt class. Nominal module operating temperature (NMOT: air mass AM 1.5, irradiance 800 W/m², temperature 20°C, windspeed 1 m/s). *Where xxx indicates the nominal power class (P_{MAX}) at STC above.

CERTIFICATIONS

IEC 61215:2016, IEC 61730:2016, UL 1703, UL 61730
IEC 62804 PID
IEC 61701 Salt Mist
IEC 62716 Ammonia Resistance
ISO 11925-2 Ignitability (Class E)
IEC 62782 Dynamic Mechanical Load
IEC 61215-2:2016 Hailstone (35mm)
AS4040.2 NCC 2016 Cyclic Wind Load
ISO 14001:2004, ISO 9001:2015, OHSAS 18001:2007, IEC 62941



takeaway
for an easy way
take-e-way WEEE-compliant
recycling scheme

WARRANTY*

	Standard	REC ProTrust
Installed by an REC Certified Solar Professional	No	Yes
System Size	All	<25 kW 25-500 kW
Product Warranty (yrs)	20	25
Power Warranty (yrs)	25	25
Labor Warranty (yrs)	0	25
Power in Year 1	98%	98%
Annual Degradation	0.25%	0.25%
Power in Year 25	92%	92%

See warranty documents for details. Conditions apply.

MAXIMUM RATINGS

Operational temperature:	-40 ... +85°C
Maximum system voltage:	1000 V
Design load (+): snow	4666 Pa (475 kg/m ²)*
Maximum test load (+):	7000 Pa (713 kg/m ²)*
Design load (-): wind	2666 Pa (272 kg/m ²)*
Maximum test load (-):	4000 Pa (407 kg/m ²)*
Max series fuse rating:	25 A
Max reverse current:	25 A

* Calculated using a safety factor of 1.5
* See installation manual for mounting instructions

TEMPERATURE RATINGS*

Nominal Module Operating Temperature:	44°C (±2°C)
Temperature coefficient of P _{MAX} :	-0.26 %/°C
Temperature coefficient of V _{OC} :	-0.24 %/°C
Temperature coefficient of I _{SC} :	0.04 %/°C

*The temperature coefficients stated are linear values

LOW LIGHT BEHAVIOUR

Typical low irradiance performance of module at STC:



REC Group is an international pioneering solar energy company dedicated to empowering consumers with clean, affordable solar power in order to facilitate global energy transitions. Committed to quality and innovation, REC offers photovoltaic modules with leading high quality, backed by an exceptional low warranty claims rate of less than 100ppm. Founded in Norway in 1996, REC employs 2,000 people and has an annual solar panel capacity of 1.8 GW. With over 10 GW installed worldwide, REC is empowering more than 16 million people with clean solar energy. REC Group is a Bluestar Elkem company with headquarters in Norway, operational headquarters in Singapore, and regional bases in North America, Europe, and Asia-Pacific.



www.recgroup.com



Castillo Engineering
SOLAR DONE RIGHT®

CASTILLO ENGINEERING
SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-01



Castillo Engineering Services, LLC
2925 W. State Road 434, Suite 111,
Longwood, FL 32779

RE: REC Modules Max Wind Load

San Luis Obispo, 18 February 2021

To Whom it May Concern;

REC Americas LLC confirms that the REC Twin Peak 3M series (RECXXXT3M) and REC Alpha Series (RECXXXAA) modules have passed UL2703 Mechanical Load testing at a test load of +/-113 PSF utilizing four-point attachments on the long side of the module.

Please be in touch with the REC Technical Department if you have any questions.

Sincerely,

George McClellan
REC Americas LLC
Senior Technical Sales Manager

REC Americas LLC
1420 Gateway Dr, Suite 170
San Mateo, CA 94404
Dir 805 704 3226
Fax 805 457 6104
www.recgroup.com



CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME
DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
DS-01.1

Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate seamlessly with the Enphase IQ Envoy™, Enphase Q Aggregator™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



To learn more about Enphase offerings, visit enphase.com



Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2-US	
Commonly used module pairings ¹	235 W - 350 W +		235 W - 440 W +	
Module compatibility	60-cell PV modules only		60-cell and 72-cell PV modules	
Maximum input DC voltage	48 V		60 V	
Peak power tracking voltage	27 V - 37 V		27 V - 45 V	
Operating range	16 V - 48 V		16 V - 60 V	
Min/Max start voltage	22 V / 48 V		22 V / 60 V	
Max DC short circuit current (module Isc)	15 A		15 A	
Overvoltage class DC port	II		II	
DC port backfeed current	0 A		0 A	
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit			
OUTPUT DATA (AC)	IQ 7 Microinverter		IQ 7+ Microinverter	
Peak output power	250 VA		295 VA	
Maximum continuous output power	240 VA		290 VA	
Nominal (L-L) voltage/range ²	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V
Maximum continuous output current	1.0 A	1.15 A	1.21 A	1.39 A
Nominal frequency	60 Hz		60 Hz	
Extended frequency range	47 - 68 Hz		47 - 68 Hz	
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms	
Maximum units per 20 A (L-L) branch circuit ³	16 (240 VAC) 13 (208 VAC)		13 (240 VAC) 11 (208 VAC)	
Overvoltage class AC port	III		III	
AC port backfeed current	0 A		0 A	
Power factor setting	1.0		1.0	
Power factor (adjustable)	0.7 leading ... 0.7 lagging		0.7 leading ... 0.7 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V
Peak CEC efficiency	97.6 %	97.6 %	97.5 %	97.3 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %
MECHANICAL DATA	IQ 7 Microinverter			
Ambient temperature range	-40°C to +65°C			
Relative humidity range	4% to 100% (condensing)			
Connector type	MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter)			
Dimensions (WxHxD)	212 mm x 175 mm x 30.2 mm (without bracket)			
Weight	1.08 kg (2.38 lbs)			
Cooling	Natural convection - No fans			
Approved for wet locations	Yes			
Pollution degree	PD3			
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure			
Environmental category / UV exposure rating	NEMA Type 6 / outdoor			
FEATURES				
Communication	Power Line Communication (PLC)			
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.			
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.			

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.
2. Nominal voltage range can be extended beyond nominal if required by the utility.
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit enphase.com



© 2018 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.
2018-02-08



CASTILLO ENGINEERING SERVICES, LLC
COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751
TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"


SHEET NUMBER

DS-02

Enphase IQ Combiner 3

(X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

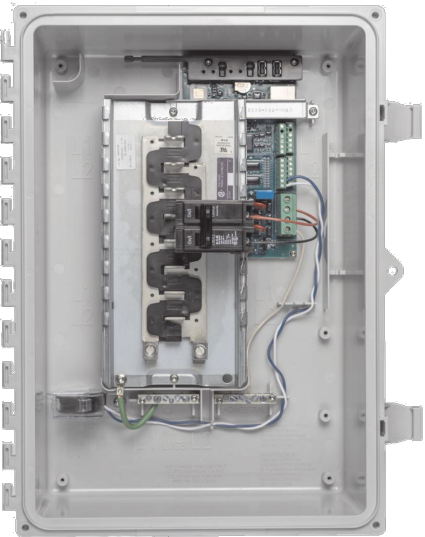

Smart


- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year warranty
- UL listed

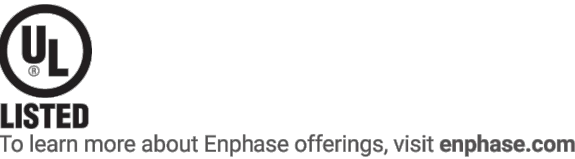

Enphase IQ Combiner 3

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (not included, order separately)	
Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)
COMPLIANCE	
Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1
* Consumption monitoring is required for Enphase Storage Systems.	

To learn more about Enphase offerings, visit enphase.com

© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner.
2018-09-13



Castillo

Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER

PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME
DATA SHEET

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
DS-03

(BATTERIES TO BE INSTALLED UPON AVAILABILITY)

POWERWALL

Tesla Powerwall is a fully-integrated AC battery system for residential or light commercial use. Its rechargeable lithium-ion battery pack provides energy storage for solar self-consumption, time-based control, and backup.

Powerwall's electrical interface provides a simple connection to any home or building. Its revolutionary compact design achieves market-leading energy density and is easy to install, enabling owners to quickly realize the benefits of reliable, clean power.



PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240 V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Total Energy ¹	14 kWh
Usable Energy ¹	13.5 kWh
Real Power, max continuous ²	5 kW (charge and discharge)
Real Power, peak (10s, off-grid/backup) ²	7 kW (charge and discharge)
Apparent Power, max continuous	5.8 kVA (charge and discharge)
Apparent Power, peak (10s, off-grid/backup)	7.2 kVA (charge and discharge)
Maximum Supply Fault Current	10 kA
Maximum Output Fault Current	32 A
Overcurrent Protection Device	30 A
Imbalance for Split-Phase Loads	100%
Power Factor Output Range	+/- 1.0 adjustable
Power Factor Range (full-rated power)	+/- 0.85
Internal Battery DC Voltage	50 V
Round Trip Efficiency ^{1,3}	90%
Warranty	10 years

¹Values provided for 25°C (77°F), 3.3 kW charge/discharge power.
²In Backup mode, grid charge power is limited to 3.3 kW.
³AC to battery to AC, at beginning of life.


COMPLIANCE INFORMATION

Certifications	UL 1642, UL 1741, UL 1973, UL 9540, IEEE 1547, UN 38.3
Grid Connection	Worldwide Compatibility
Emissions	FCC Part 15 Class B, ICES 003
Environmental	RoHS Directive 2011/65/EU
Seismic	AC156, IEEE 693-2005 (high)

MECHANICAL SPECIFICATIONS

Dimensions ¹	1150 mm x 755 mm x 147 mm (45.3 in x 29.6 in x 5.75 in)
Weight ¹	114 kg (251.3 lbs)
Mounting options	Floor or wall mount

¹Dimensions and weight differ slightly if manufactured before March 2019. Contact Tesla for additional information.

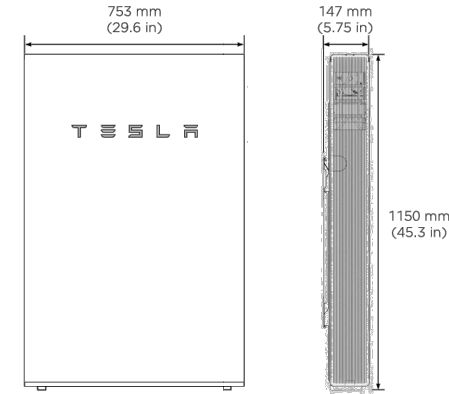


ENVIRONMENTAL SPECIFICATIONS


Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Recommended Temperature	0°C to 30°C (32°F to 86°F)
Operating Humidity (RH)	Up to 100%, condensing
Storage Conditions	-20°C to 30°C (-4°F to 86°F) Up to 95% RH, non-condensing State of Energy (SoE): 25% initial
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R
Ingress Rating	IP67 (Battery & Power Electronics) IP56 (Wiring Compartment)
Wet Location Rating	Yes
Noise Level @ 1m	< 40 dBA at 30°C (86°F)

TYPICAL SYSTEM LAYOUTS

WHOLE HOME BACKUP

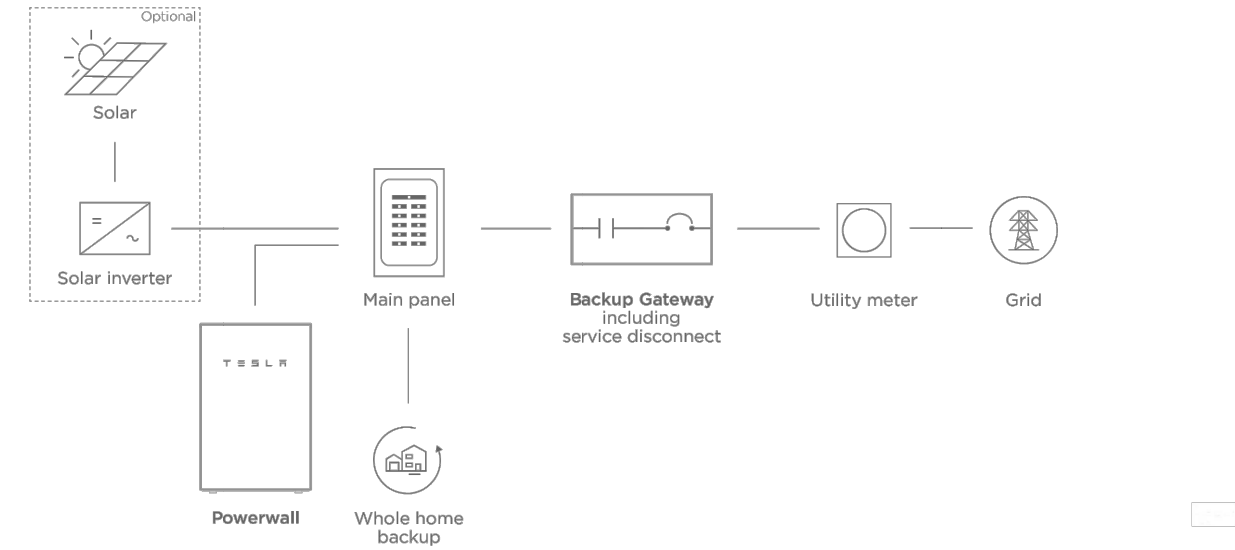

PARTIAL HOME BACKUP

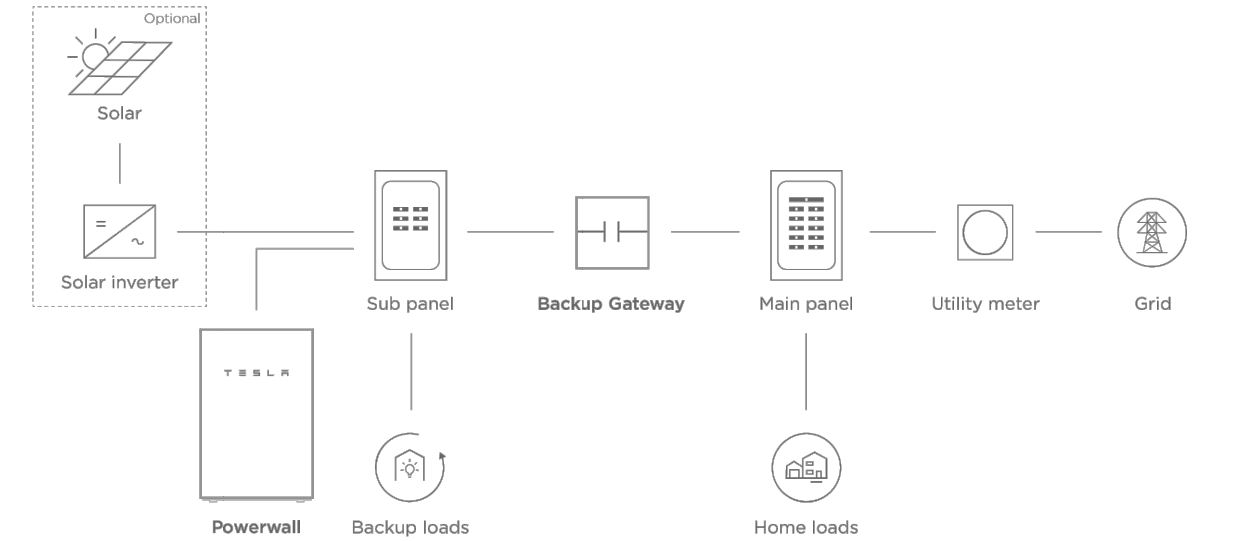

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

Signature with Seal

PROJECT NAME

BREINES RESIDENCE
315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-04

POWERWALL
Backup Gateway 2

The Backup Gateway 2 for Tesla Powerwall provides energy management and monitoring for solar self-consumption, time-based control, and backup.

The Backup Gateway 2 controls connection to the grid, automatically detecting outages and providing a seamless transition to backup power. When equipped with a main circuit breaker, the Backup Gateway 2 can be installed at the service entrance. When the optional internal panelboard is installed, the Backup Gateway 2 can also function as a load center.

The Backup Gateway 2 communicates directly with Powerwall, allowing you to monitor energy use and manage backup energy reserves from any mobile device with the Tesla app.




PERFORMANCE SPECIFICATIONS

AC Voltage (Nominal)	120/240V
Feed-In Type	Split Phase
Grid Frequency	60 Hz
Current Rating	200 A
Maximum Input Short Circuit Current	10 kA ¹
Overcurrent Protection Device	100-200A; Service Entrance Rated ¹
Overvoltage Category	Category IV
AC Meter	Revenue accurate (+/- 0.2 %)
Primary Connectivity	Ethernet, Wi-Fi
Secondary Connectivity	Cellular (3G, LTE/4G) ²
User Interface	Tesla App
Operating Modes	Support for solar self-consumption, time-based control, backup, and off-grid
Backup Transition	Automatic disconnect for seamless backup
Modularity	Supports up to 10 AC-coupled Powerwalls
Optional Internal Panelboard	200A 6-space / 12 circuit Eaton BR Circuit Breakers
Warranty	10 years

¹When protected by Class J fuses, Backup Gateway 2 is suitable for use in circuits capable of delivering not more than 22kA symmetrical amperes.
²The customer is expected to provide internet connectivity for Backup Gateway 2; cellular should not be used as the primary mode of connectivity. Cellular connectivity subject to network operator service coverage and signal strength.

MECHANICAL SPECIFICATIONS

Dimensions	660 mm x 411 mm x 149 mm (26 in x 16 in x 6 in)
Weight	20.4 kg (45 lb)
Mounting options	Wall mount, Semi-flush mount

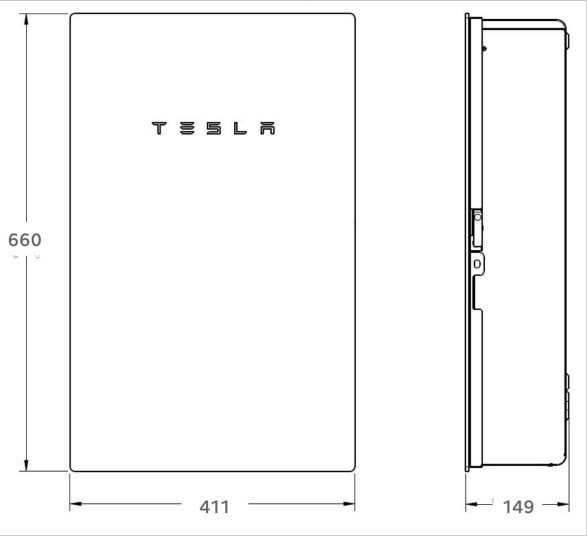

COMPLIANCE INFORMATION

Certifications	UL 67, UL 869A, UL 916, UL 1741 PCS CSA 22.2 0.19, CSA 22.2 205
Emissions	FCC Part 15, ICES 003

ENVIRONMENTAL SPECIFICATIONS

Operating Temperature	-20°C to 50°C (-4°F to 122°F)
Operating Humidity (RH)	Up to 100%, condensing
Maximum Elevation	3000 m (9843 ft)
Environment	Indoor and outdoor rated
Enclosure Type	NEMA 3R

Castillo

Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING

SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD,

SUITE 250,

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-05

Ultra Rail


UR-40
UR-60

SnapNrack Ultra Rail System

A sleek, straightforward rail solution for mounting solar modules on all roof types. Ultra Rail features two rail profiles; UR-40 is a lightweight rail profile that is suitable for most geographic regions and maintains all the great features of SnapNrack rail, while UR-60 is a heavier duty rail profile that provides a larger rail channel and increased span capabilities. Both are compatible with all existing mounts, module clamps, and accessories for ease of install.


The Entire System is a Snap to Install

- New Ultra Rail Mounts include snap-in brackets for attaching rail
- Compatible with all the SnapNrack Mid Clamps and End Clamps customers love
- Universal End Clamps and snap-in End Caps provide a clean look to the array edge

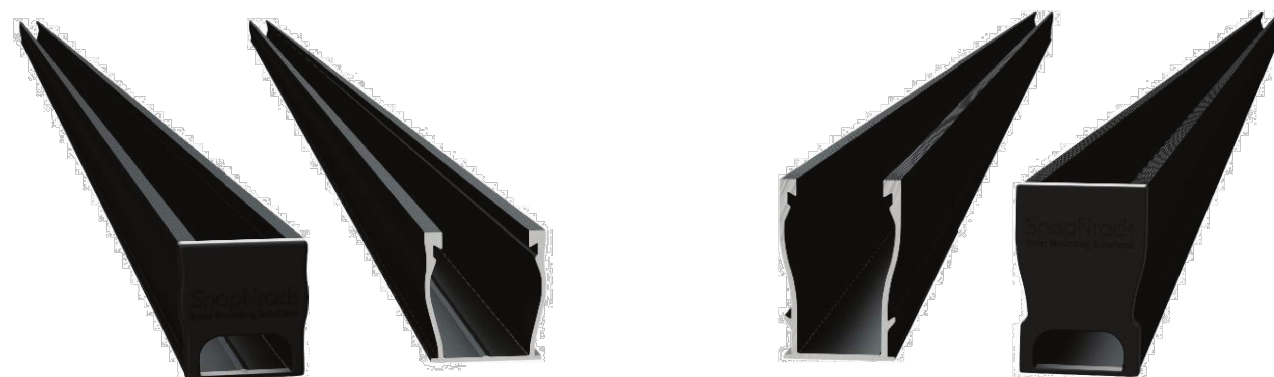

Unparalleled Wire Management

- Open rail channel provides room for running wires resulting in a long-lasting quality install
- Industry best wire management offering includes Junction Boxes, Universal Wire Clamps, MLPE Attachment Kits, and Conduit Clamps
- System is fully bonded and listed to UL 2703 Standard

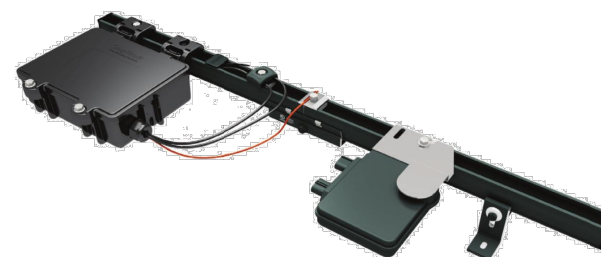

The Ultimate Value in Rooftop Solar



Industry leading Wire Management Solutions



Mounts available for all roof types



Single Tool Installation



All SnapNrack Module Clamps & Accessories are compatible with both rail profiles

Start Installing Ultra Rail Today

RESOURCES
DESIGN
WHERE TO BUY

snapnrack.com/resources
snapnrack.com/configurator
snapnrack.com/where-to-buy

Heavy Duty UR-60 Rail

- UR-60 rail profile provides increased span capabilities for high wind speeds and snow loads
- Taller, stronger rail profile includes profile-specific rail splice and end cap
- All existing mounts, module clamps, and accessories are retained for the same great install experience



Quality. Innovative. Superior.

SnapNrack Solar Mounting Solutions are engineered to optimize material use and labor resources and improve overall installation quality and safety.

877-732-2860

www.snapnrack.com

contact@snapnrack.com

© 2019 by SnapNrack Solar Mounting Solutions. All rights reserved

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER™
PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-06

S-5![®]

The Right Way![™]

NEW

NOW AVAILABLE
IN ALUMINUM

ProteaBracket[™]

ProteaBracket[™]

A versatile bracket for
mounting solar PV to
trapezoidal roof profiles

ProteaBracket[™] is now made in aluminum. Still the most versatile trapezoidal metal roof attachment solution on the market, the S-5! ProteaBracket just got better!

The bracket features an adjustable attachment base and module attachment options to accommodate different roof profile dimensions and mounting options.

Our pre-applied EPDM gasket with peel and stick adhesive makes installation a snap, ensuring accurate and secure placement the first time.

With no messy sealants, faster installation, and a weather-proof fit, ProteaBracket offers you the most versatile solar attachment solution available.

ProteaBracket* can be used for
rail mounting or "direct-attach"
with S-5! PVKIT[™]

Features and Benefits

- 34% lighter - saves on shipping
- Stronger L-Foot[™]
- Load-tested for engineered application
- Corrosion-resistant materials
- Adjustable - Fits rib profiles up to 3"
- Peel-and-Stick prevents accidental shifting during installation
- Fully pre-assembled
- 25-year warranty*

*When ProteaBracket is used in conjunction with the S-5! PVKIT, an additional nut is required during installation.

*See www.S-5.com for details.



888-825-3432 | www.S-5.com

S-5![®]

The Right Way![™]

ProteaBracket[™] is the perfect solar attachment solution for most trapezoidal rib, exposed-fastened metal roof profiles!


ProteaBracket[™] is compatible with common metal roofing materials and comes with a pre-applied EPDM gasket on the base.

Note: All four pre-punched holes must be used to achieve tested strength. Fasteners are provided.


For design assistance, ask your distributor, or visit www.S-5.com for the independent lab test data that can be used for load-critical designs and applications. Also, please visit our website for more information including metallurgical compatibilities and specifications.

S-5![®] holding strength is unmatched in the industry.

Multiple Attachment Options:

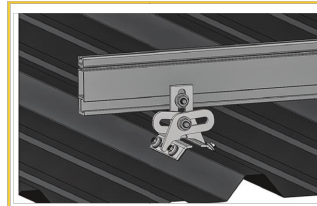

Side
Mount Rail

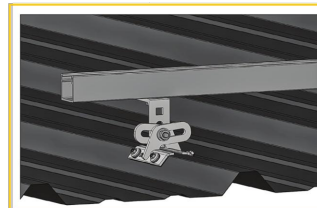



Bottom
Mount Rail



w/ S-5!
PVKIT[™]
(rail-less)

ProteaBracket[™]

ProteaBracket[™] is still available in stainless steel.

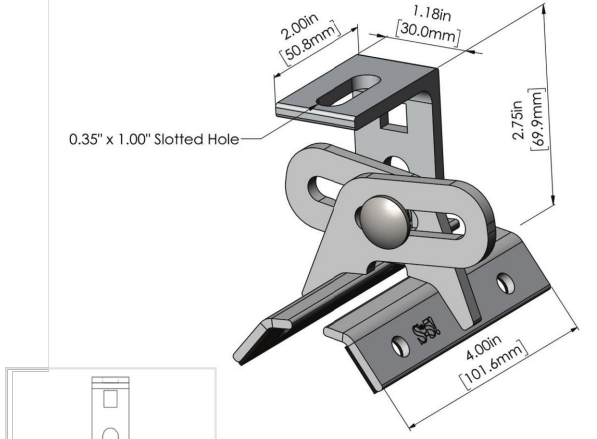

ProteaBracket fits profiles
up to 3 inches

INSTALLATION:

- No surface preparation needed. (1) Wipe away excess oil and debris. (2) Peel off adhesive release paper. (3) Align and mount bracket directly onto crown of panel. (4) Secure ProteaBracket through pre-punched holes, using piercing-point S-5! screws.



ProteaBracket[™] and the S-5! PVKIT[™] 2.0
mounted on a trapezoidal roof profile

S-5![®] Warning! Please use this product responsibly!

Products are protected by multiple U.S. and foreign patents. For published data regarding holding strength, bolt torque, patents, and trademarks, visit the S-5! website at www.S-5.com.

Copyright 2019, Metal Roof Innovations, Ltd. S-5! products are patent protected. S-5! aggressively protects its patents, trademarks, and copyrights. Version 07089.

Distributed by

Castillo
Engineering

SOLAR DONE RIGHT[®]

CASTILLO ENGINEERING
SERVICES, LLC

COA # 28345
620 N. WYMORE ROAD,
SUITE 250,
MAITLAND, FL 32751

TEL: (407) 289-2575
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY
CASTILLO ENGINEERING
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER[™]
PRODUCTION MANAGEMENT, INC.

Signature with Seal

PROJECT NAME

BREINES RESIDENCE

315 SW WAFFLE GLEN,
FORT WHITE, FL 32038

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

DS-07