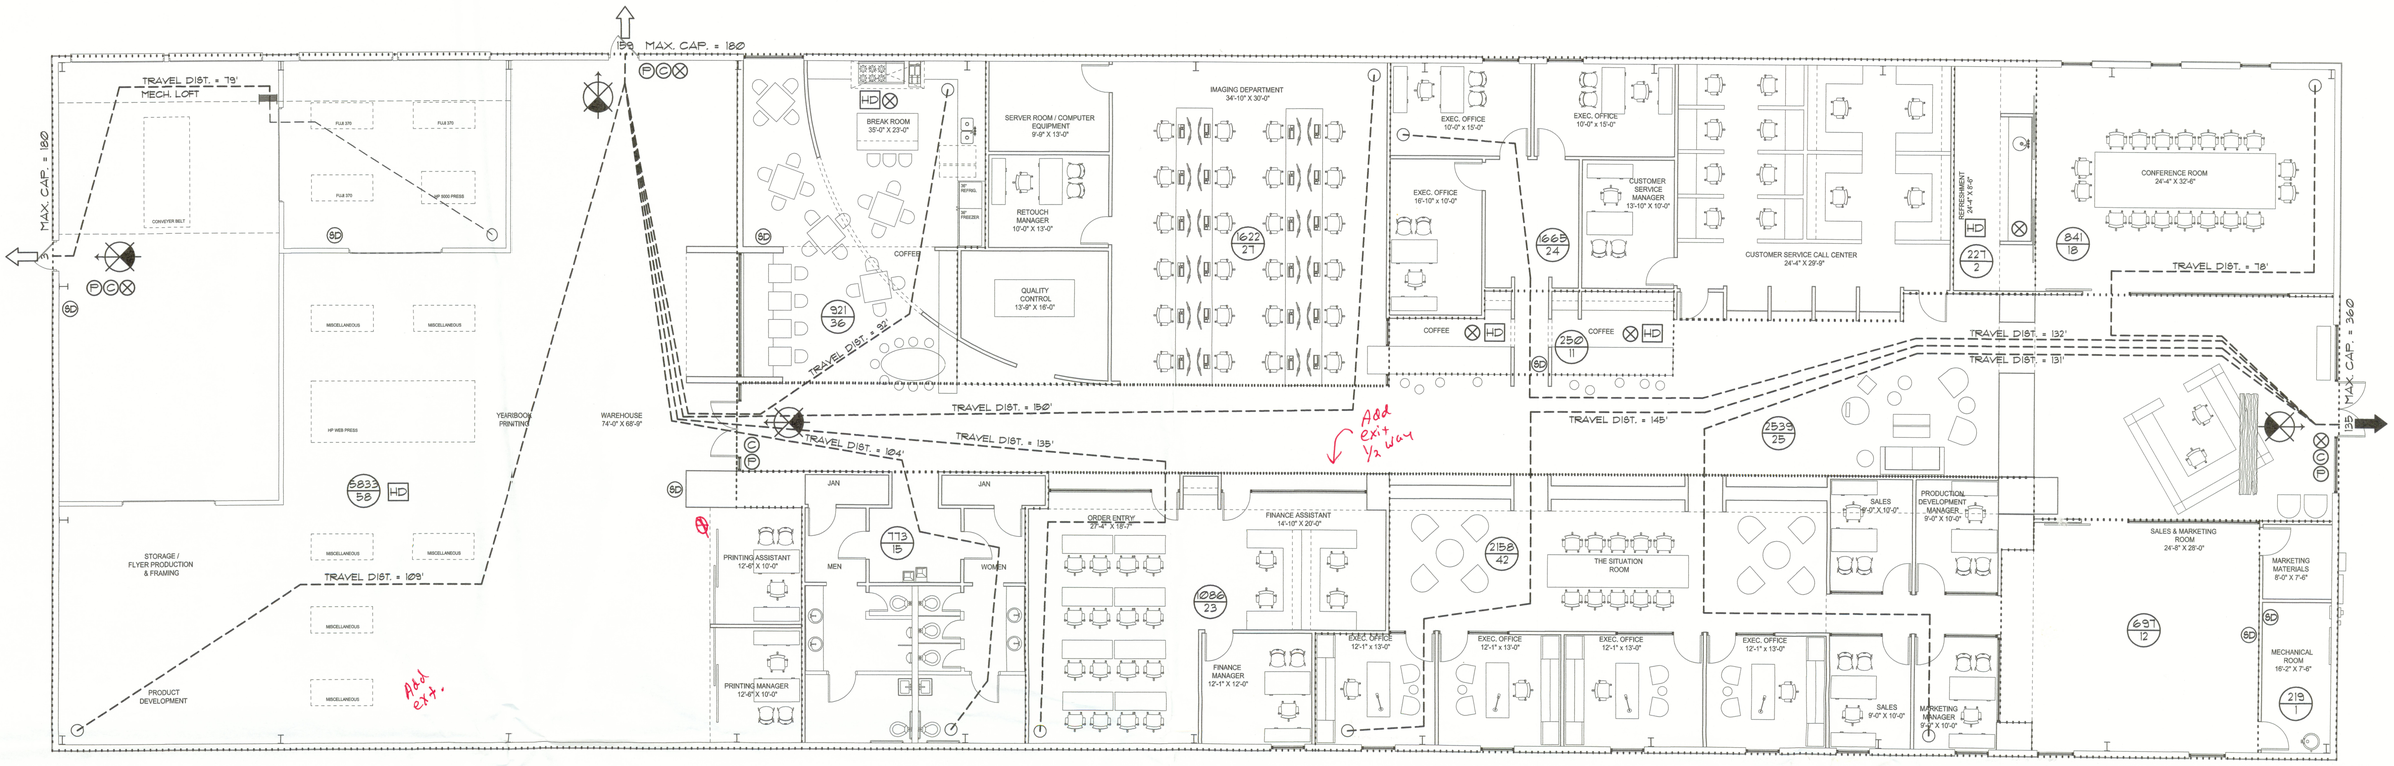

LIFE SAFETY PLAN

SCALE: 1/8" = 1'-0"

OCCUPANCY: 227 OCCUPANTS MAXIMUM TRAVEL DISTANCE = 150'

#29724

FIRE EXTINGUISHER CABINETS

PROVIDE 10 LB ABC FIRE EXTINGUISHERS IN ALUM. SEMI-RECESSED WALL CABINETS W/ BREAKAWAY GLASS FRONT PANEL. LOCATE 1 CABINET AT EACH EXIT DOOR OF EACH SPACE, WITHIN 10 FEET OF THE DOOR. ANY OTHER LOCATIONS SHALL BE AS DIRECTED BY THE FIRE MARSHAL AND/OR OWNER.

EXIT ACCESS TRAVEL DISTANCE PER FBC 1015, TABLE 1015.1

OCCUPANCY - BUSINESS:
150 FT. (W/O SPRINKLER SYSTEM)
250 FT/ (W/SPRINKLER SYSTEM)

OCCUPANCY LOAD - BUSINESS

AREA	TOTAL S.F.	ALLOWABLE	TOTAL OCCUP.	
RECEPTIONIST/PASSAGEWAY:	2539.49	1/100	25	
CONFERENCE:	840.88	PLAN. PLAN	18	- NON-CONCURENT
SALES DISPLAY AREA:	697.29	1/60	12	
BUSINESS AREAS:	6532.47	PLAN. PLAN	116	
REFRESHMENT AREAS:	1398.11	PLAN. PLAN	49	- NON-CONCURENT
RESTROOMS:	713.18	1/50	15	
PRODUCTION AREA:	5833.45	1/100	58	
MECH. EQ. / STORAGE:	219.46	1/300	1	
MECH. EQ. LOFT	164.92	1/300	3	
BUILDING TOTAL:	19558.25		230	- NON-CONCURENT
			291	- CONCURENT

NOTE:

EMERGENCY LIGHTING AND EXIT SIGNS, SHALL BE PROVIDED AS DIRECTED BY THE FIRE MARSHAL, AND SHALL BE WIRED PER NEC 700-12F.

LEGEND

- EXIT LIGHT - ARROW REPRESENTS DIRECTION OF EXIT
- HD — HEAT DETECTOR - COORDINATE WITH ELECTRICAL PLANS.
- SD — SMOKE DETECTOR - 120V HARD WIRED INTERLOCKED TOGETHER
- WALL HUNG "ABC" FIRE EXTINGUISHER
- C — DOOR /CLOSER FOR EXITING OR RATING REASONS
- F — PANC DEVICE
- 999 — ROOM SQUARE FOOTAGE
- 30 — ROOM OCCUPANCY LOAD
- 1.5 — PRIMARY EGRESS W/EXIT CAPACITY
- SECONDARY EGRESS

NOTE:

SMOKE DETECTORS SHALL BE MOUNTED NOT LESS THAN 90" ABOVE FINISHED FLOOR AND SHALL BE THE IONIZATION TYPE, INTERLOCKED TOGETHER, POWERED FROM EACH STORE PANEL W/BATTERY BACKUP

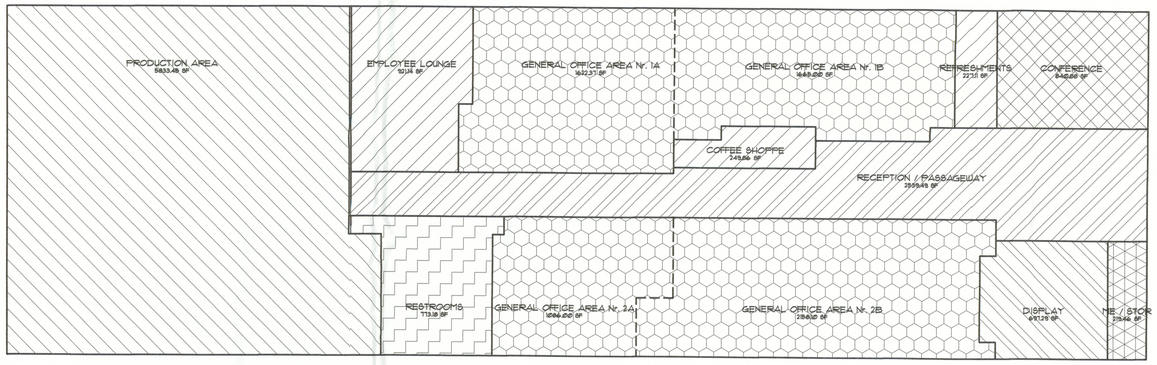

GROSS BUILDING AREA
18833.33 SF

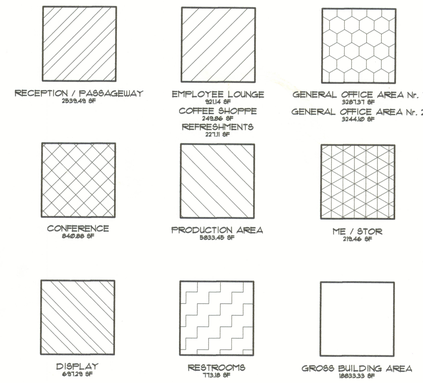

BUILDING OCCUPANCY PLAN

SCALE: 1/16" = 1'-0"

OCCUPANCY: XXX OCCUPANTS

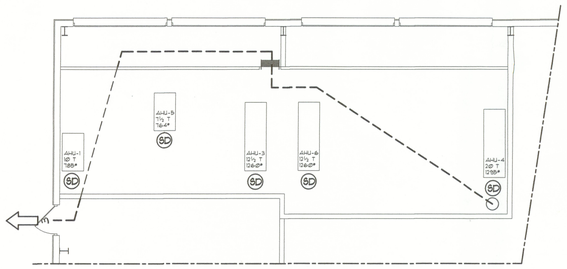

MECH. EQUIP. LOFT PLAN

SCALE: 1/8" = 1'-0"

NOTE:

SMOKE DETECTORS SHALL BE MOUNTED WITHIN RETURN AIR DUCTWORK AND POSITIONED IN THE AIR STREAM - ACTIVATION OF ANY ONE SMOKE DETECTOR SHUTS-DOWN ALL AHU'S

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

©WILLIAM MYERS DESIGN
P.O. BOX 1513
LAKE CITY, FL 32056
(386) 758-8406
will@willmyers.net

JOINT VENTURED WITH

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Lake City, FL 32055
386-365-4355

Celebrating 39 Years of Service
1972 - 2011
N.P. Geisler, Architect
AR0007005

AR0007005

TENANT IMPROVEMENTS for:

cady&cady.studios — art from the heart

LAKE CITY, COLUMBIA COUNTY, FLORIDA

REVISIONS
20 JUL 2011
29 JUL 2011
22 SEP 2011

JOB NUMBER	SHEET NUMBER
2K1124	LSP.1
DATE: 06 JUL 2011	OF 1 SHEETS