


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

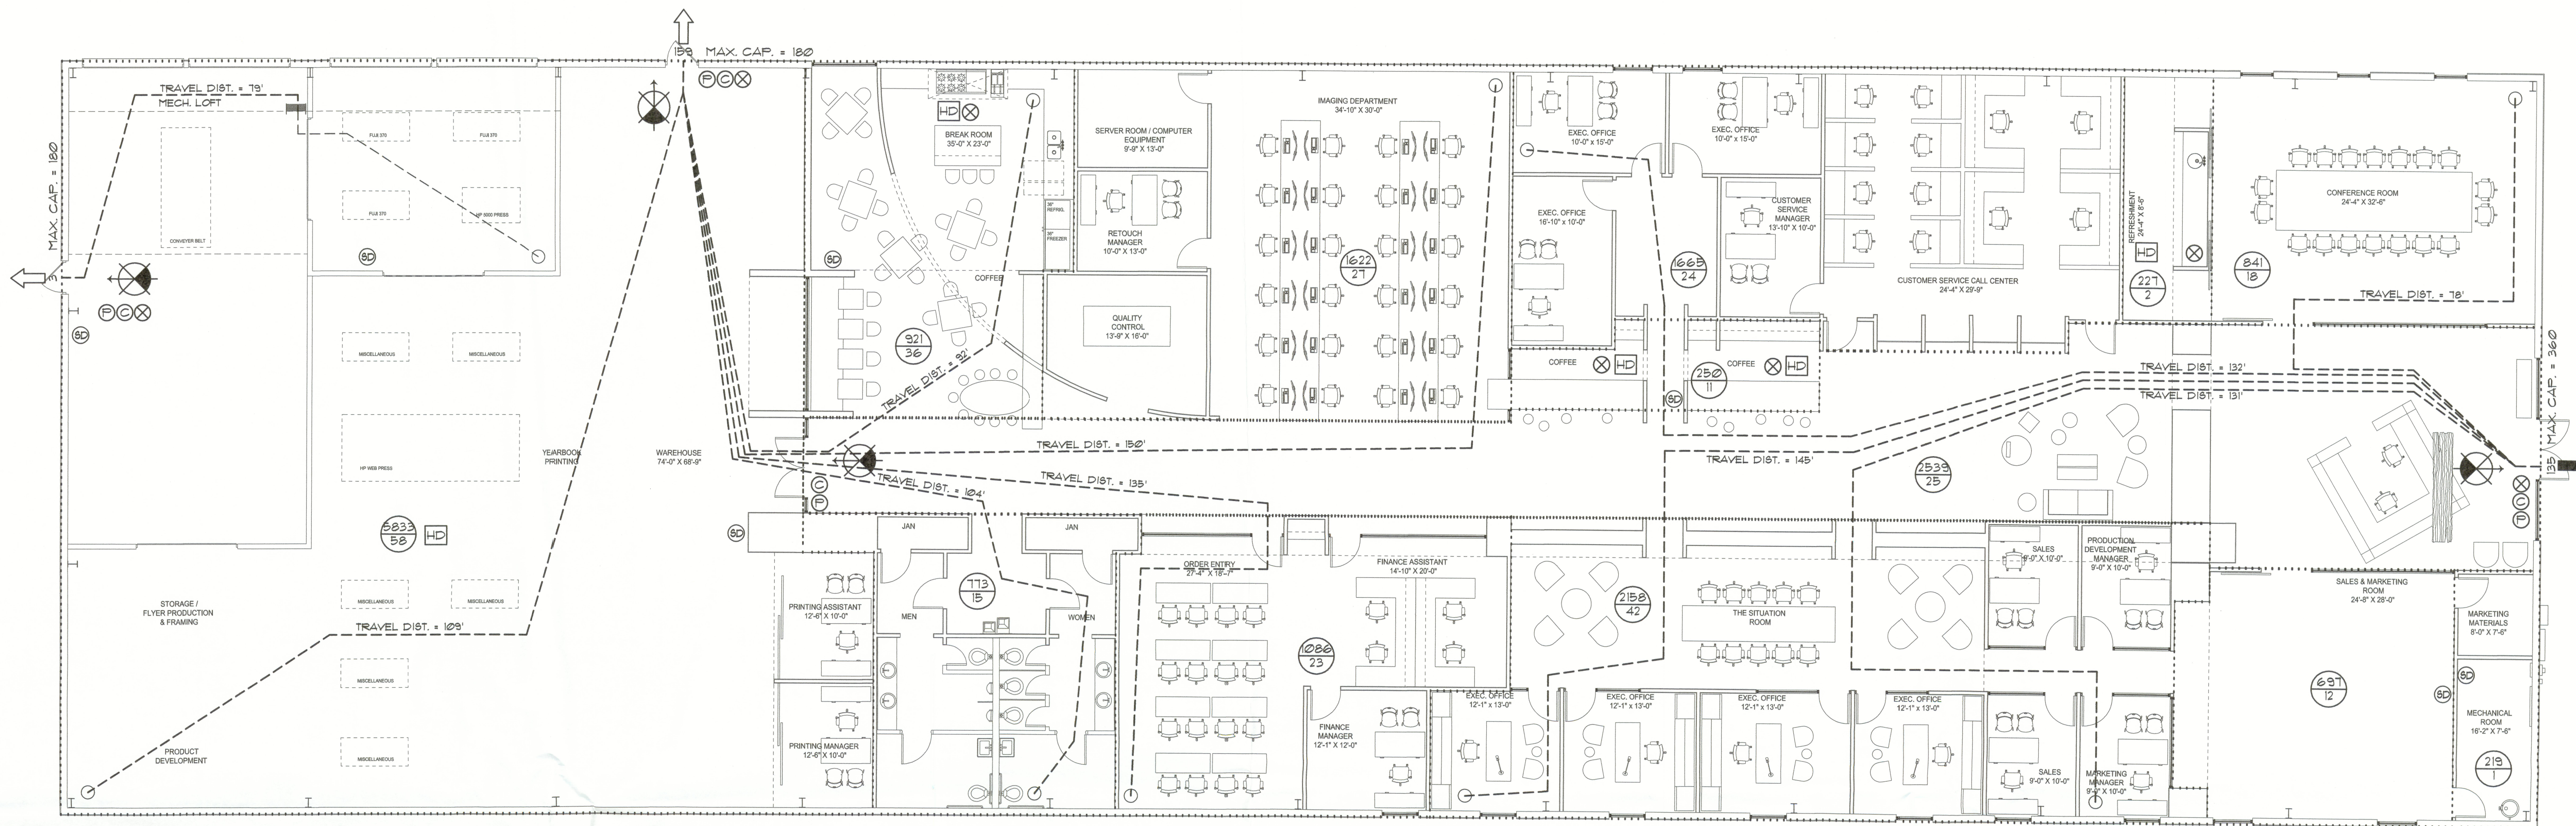

FIRE EXTINGUISHER CABINETS

PROVIDE 10 LB ABC FIRE EXTINGUISHERS IN ALUM. SEMI-RECESSED WALL CABINETS W/ BREAKAWAY GLASS FRONT PANEL. LOCATE 1 CABINET AT EACH EXIT DOOR OF EACH SPACE, WITHIN 10 FEET OF THE DOOR. ANY OTHER LOCATIONS SHALL BE AS DIRECTED BY THE FIRE MARSHAL AND/OR OWNER.

EXIT ACCESS TRAVEL DISTANCE PER FBC 105, TABLE 105.1

OCCUPANCY - BUSINESS
150 FT. (W/O SPRINKLER SYSTEM)
250 FT. (W/SPRINKLER SYSTEM)

OCCUPANCY LOAD - BUSINESS

AREA	TOTAL SF.	ALLOWABLE	TOTAL OCCUP.
RECEPTION/PASSAGEWAY	2539.49	1/100	25
CONFERENCE	840.88	FURN. PLAN	15 - NON-CONCURRENT
SALES DISPLAY AREA	697.29	1/60	12
BUSINESS AREAS	6532.41	FURN. PLAN	116
REFRESHMENT AREAS	1938.11	FURN. PLAN	49 - NON-CONCURRENT
RESTROOMS	713.18	1/50	15
PRODUCTION AREA	5833.45	1/100	58
MECH. EQ. / STORAGE	218.46	1/300	1
MECH. EQ. LOFT	164.92	1/300	3
BUILDING TOTAL:	19599.25		230 - NON-CONCURRENT 291 - CONCURRENT

NOTE!
EMERGENCY LIGHTING AND EXIT SIGNS, SHALL BE PROVIDED AS DIRECTED BY THE FIRE MARSHAL, AND SHALL BE WIRED PER NEC 100-12F.

LEGEND


- EXIT LIGHT - ARROW REPRESENTS DIRECTION OF EXIT
- HEAT DETECTOR - COORDINATE WITH ELECTRICAL DUGS.
- SMOKE DETECTOR - 120V HARD WIRED INTERLOCKED TOGETHER
- WALL HUNG "ABC" FIRE EXTINGUISHER
- DOOR / CLOSER FOR EXITING OR RATING REASONS
- PANIC DEVICE
- ROOM SQUARE FOOTAGE
- ROOM OCCUPANCY LOAD
- PRIMARY EGRESS / EXIT (CAPACITY)
- SECONDARY EGRESS

NOTE!
SMOKE DETECTORS SHALL BE MOUNTED NOT LESS THAN 80" ABOVE FINISHED FLOOR AND SHALL BE THE IONIZATION TYPE, INTERLOCKED TOGETHER, POWERED FROM EACH SMOKE PANEL W/BATTERY BACKUP

LIFE SAFETY PLAN

SCALE: 1/8" = 1'-0"

OCCUPANCY: 227 OCCUPANTS MAXIMUM TRAVEL DISTANCE = 150'

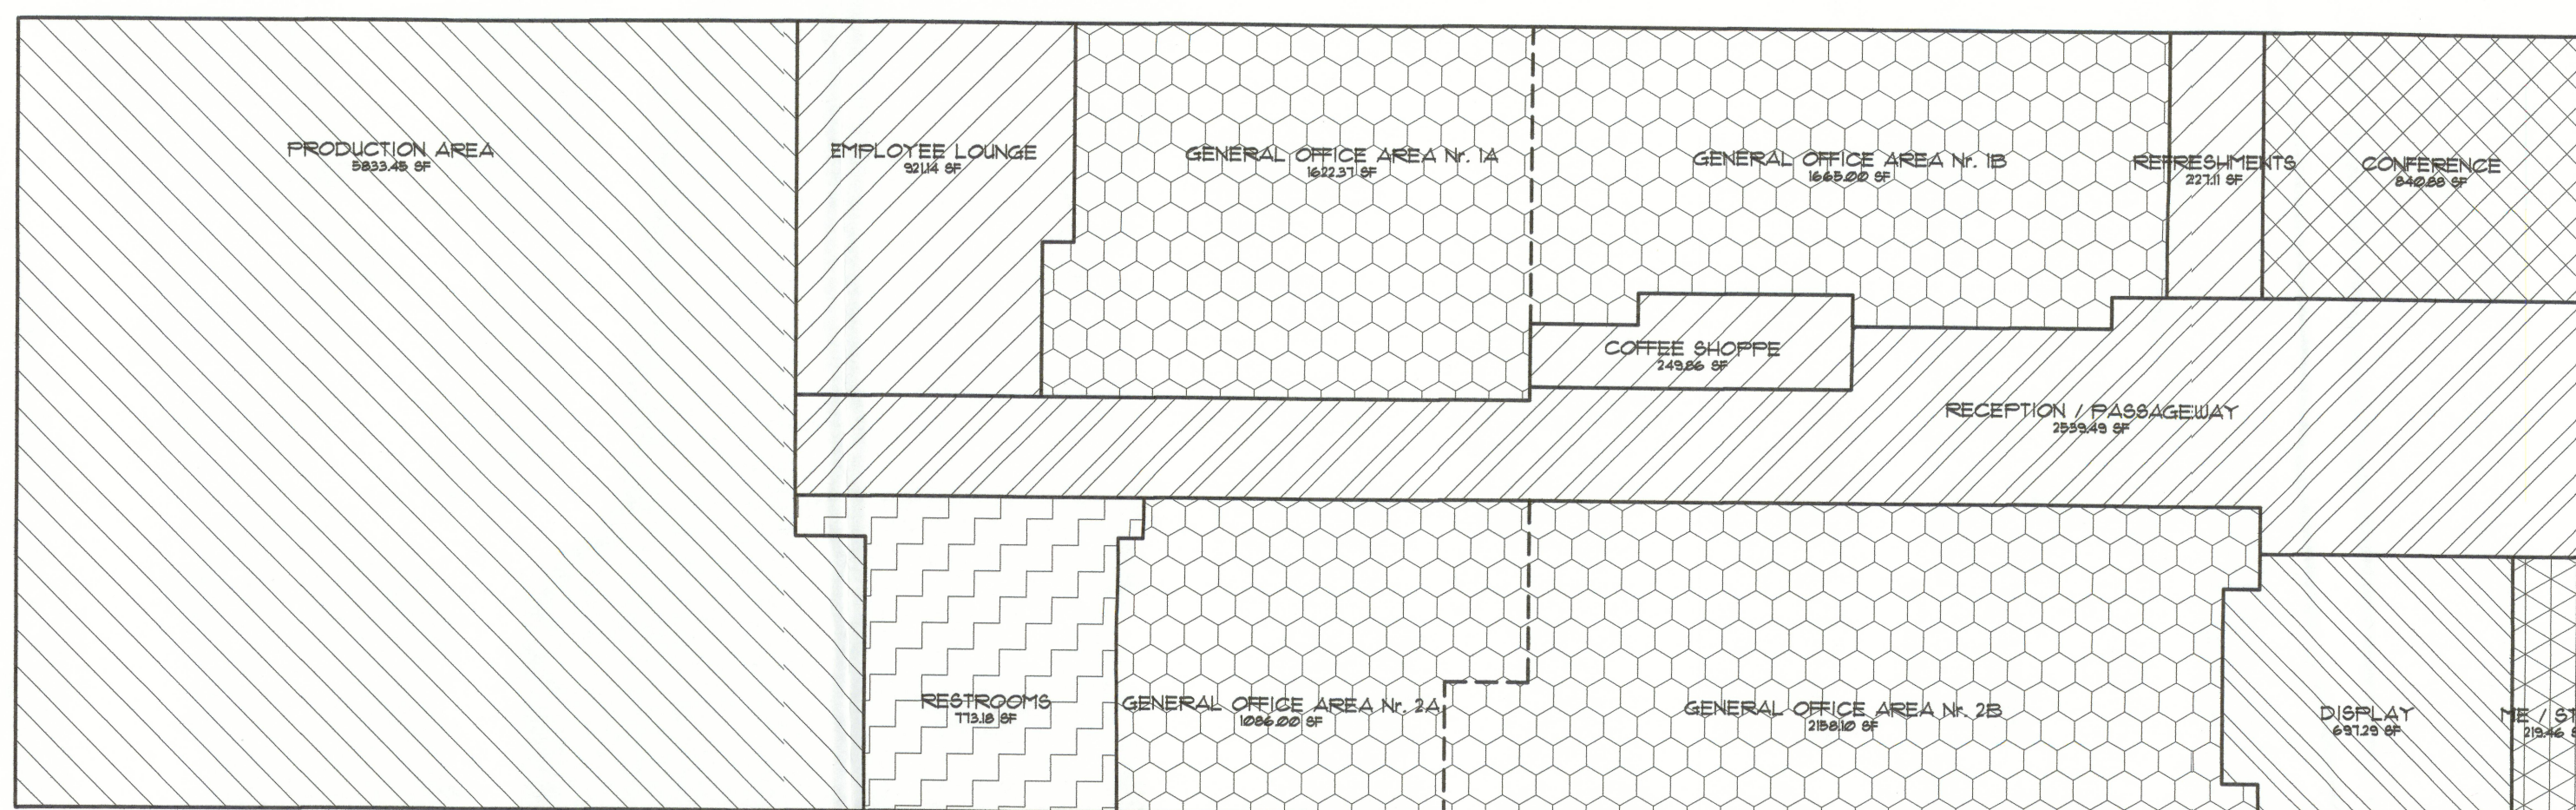


GROSS BUILDING AREA
18633.33 SF

BUILDING OCCUPANCY PLAN

SCALE: 1/16" = 1'-0"

OCCUPANCY: XXX OCCUPANTS

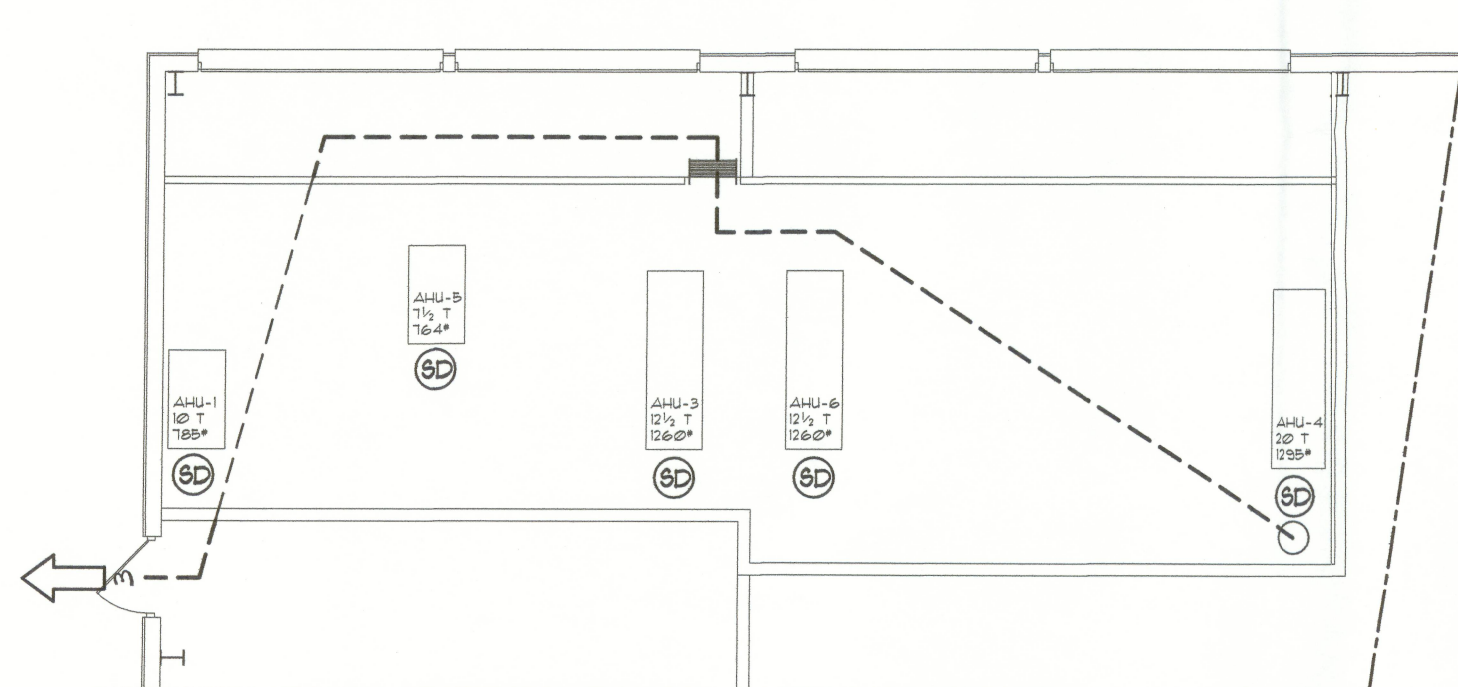


MECH. EQUIP. LOFT PLAN

SCALE: 1/8" = 1'-0"

NOTE!
SMOKE DETECTORS SHALL BE MOUNTED WITHIN RETURN AIR DUCTWORK AND POSITIONED IN THE AIR STREAM - ACTIVATION OF ANY ONE SMOKE DETECTOR SHUTS-DOWN ALL AHU'S

William C. Myers
WILLIAM MYERS DESIGN
P.O. BOX 1913
LAKE CITY, FL 32066
(386) 758-8406
will@williammyers.net

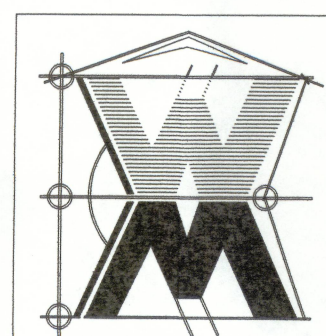

JOINT VENTURE WITH

NICHOLAS PAUL GEISLER ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Rd.
Lake City, FL 32055
386-3165-4355

Celebrating
39 Years of Service
1972 - 2011
N.P. Geisler, Architect
AR0007005

pende
12 Sep 2011
AR0007005

TENANT IMPROVEMENTS for:

cady&cady.studios
LAKE CITY, COLUMBIA COUNTY, FLORIDA

at the heart

REVISIONS

20 JUL 2011
29 JUL 2011
22 SEP 2011

JOB NUMBER
2K1124
DATE:
06 JUL 2011

SHEET NUMBER
LSP.1
OF 1 SHEETS