


DATE 11/01/2010

Columbia County Building Permit
This Permit Must Be Prominently Posted on Premises During Construction**PERMIT**
000028974

APPLICANT ADAM PAPKA PHONE 623-2383
ADDRESS 691 SW SISTERS WELCOME RD LAKE CITY FL 32025
OWNER LINDA CONNER PHONE 404-771-1191
ADDRESS 175 SW BRODERICK DR LAKE CITY FL 32025
CONTRACTOR ADAM PAPKA PHONE 623-2383
LOCATION OF PROPERTY 47 S, R BRODERICK DR, 2ND LOT ON RIGHT

TYPE DEVELOPMENT SFD, UTILITY ESTIMATED COST OF CONSTRUCTION 220850.00
HEATED FLOOR AREA 2866.00 TOTAL AREA 4417.00 HEIGHT 20.00 STORIES 1
FOUNDATION CONCRETE WALLS FRAMED ROOF PITCH 6/12 FLOOR SLAB
LAND USE & ZONING RSF-1 MAX. HEIGHT 35
Minimum Set Back Requirments: STREET-FRONT 25.00 REAR 15.00 SIDE 10.00
NO. EX.D.U. 0 FLOOD ZONE X DEVELOPMENT PERMIT NO. _____

PARCEL ID 18-4S-17-08467-003 SUBDIVISION CENTURY ESTATES
LOT 2 BLOCK _____ PHASE _____ UNIT _____ TOTAL ACRES 1.09

000001853 _____ CBC1253409 
Culvert Permit No. Culvert Waiver Contractor's License Number Applicant/Owner/Contractor
CULVERT 10-0472 BK HD N
Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: FLOOR ONE FOOT ABOVE THE ROAD, NOC ON FILECheck # or Cash 2005**FOR BUILDING & ZONING DEPARTMENT ONLY**

(footer/Slab)

Temporary Power _____ Foundation _____ Monolithic _____
date/app. by _____ date/app. by _____ date/app. by _____
Under slab rough-in plumbing _____ Slab _____ Sheathing/Nailing _____
date/app. by _____ date/app. by _____ date/app. by _____
Framing _____ Insulation _____
date/app. by _____ date/app. by _____
Rough-in plumbing above slab and below wood floor _____ Electrical rough-in _____
date/app. by _____ date/app. by _____
Heat & Air Duct _____ Peri. beam (Lintel) _____ Pool _____
date/app. by _____ date/app. by _____ date/app. by _____
Permanent power _____ C.O. Final _____ Culvert _____
date/app. by _____ date/app. by _____ date/app. by _____
Pump pole _____ Utility Pole _____ M/H tie downs, blocking, electricity and plumbing _____
date/app. by _____ date/app. by _____ date/app. by _____
Reconnection _____ RV _____ Re-roof _____
date/app. by _____ date/app. by _____ date/app. by _____

BUILDING PERMIT FEE \$ 1105.00 CERTIFICATION FEE \$ 22.09 SURCHARGE FEE \$ 22.09
MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$ _____
FLOOD DEVELOPMENT FEE \$ _____ FLOOD ZONE FEE \$ 25.00 CULVERT FEE \$ 25.00 **TOTAL FEE** 1249.18

INSPECTORS OFFICE  CLERKS OFFICE 

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

EVERY PERMIT ISSUED SHALL BECOME INVALID UNLESS THE WORK AUTHORIZED BY SUCH PERMIT IS COMMENCED WITHIN 180 DAYS AFTER ITS ISSUANCE, OR IF THE WORK AUTHORIZED BY SUCH PERMIT IS SUSPENDED OR ABANDONED FOR A PERIOD OF 180 DAYS AFTER THE TIME THE WORK IS COMMENCED. A VALID PERMIT RECIEVES AN APPROVED INSPECTION EVERY 180 DAYS. WORK SHALL BE CONSIDERED NOT SUSPENDED, ABANDONED OR INVALID WHEN THE PERMIT HAS RECIEVED AN APPROVED INSPECTION WITHIN 180 DAYS OT THE PREVIOUS INSPECTION.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

**CERTIFICATE OF
OCCUPANCY**

OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 18-4S-17-08467-003

Building permit No. 000028974

Use Classification SFD, UTILITY

Fire: 25.68

Permit Holder ADAM PAKKA

Waste: 67.00

Owner of Building LINDA CONNER

Total: 92.68

Location: 175 SW BRODERICK DR, LAKE CITY, FL 32025

Date: 06/23/2011

Fanny Dicks

Building Inspector

**POST IN A CONSPICUOUS PLACE
(Business Places Only)**



Attn: Harry @ Bldg. Dept.

#28974

Permanent Notice of Termite Protection
(as required by Florida Building Code (FBC) 104.2.7)

Aspen Pest Control, Inc.
(386) 755-3611 (352) 494-5751

This structure has been treated for the prevention of subterranean termites by the above named company. An annual inspection and a renewal of the annual termite protection contract is necessary for continued protection. Call the phone number above for inspection and contract renewal.

Conner Residence - 175 SW Broderick Dr. - Lake City, FL 32025
Address of Treatment or Lot/Block of Treatment

Intertek

LISTING INFORMATION OF Therma Tru 20 Min (with hose) Fiberglass Fire Door PP Model
20PPFFD

SPEC ID: 19840

Therma Tru Corporation
1750 Indian Wood Circle
Maumee, OH 43537

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Fiberglass Reinforced Faced (Proprietary Core) (Simulated Panel Type or Flush) Swinging Door for installation in up to 20 minute locations (with or without hose stream-see table below). For use in any "Category C - Standard" frames. These doors may also be installed in frames listed in "Category C - Proprietary" in accordance with the frame manufacturer's individual listing. **A fire rated compression weather strip is required.**

Limitations

Cylindrical/Deadbolt/ Latches with maximum 2-3/4" backset/Surface Mounted Vertical Rod Fire Exit Devices/Rim-Type Fire Exit Devices/Viewers/Protection Plates/Surface Mounted Closers/Surface or Kerf Mounted Door Bottom/ Arch Top and Round Top Door Configurations.

Maximum Size of Openings

Single Swing (**with hose stream**) 3'0" wide x 6'8" high

Standard and Double Egress Pairs - Not Allowed

Testing Standard

UL-10C (Positive Pressure) (2009), NFPA 252 (2008), CAN4 S104 (1985).

All assemblies are identified by a label or marking bearing the wording, "Listed (Product)", a time interval, temperature rise (if applicable), a serial number and the WHI Certification Mark.

(Unless otherwise specified, all Fire Doors have a nominal thickness of 1-3/4".)

<u>Attribute</u>	<u>Value</u>
CSI Code	08 10 00 Doors and Frames
CSI Code	08 15 00 Plastic Doors
Fire Resistance	20 Min w/Hose Stream PP Cat A Door
Swing	Single Swing
Listed or Inspected	LISTED
Report Number	J20051379-231, 3032869-2, 3084465, 3176111MID-002, 3187023MID-001
Criteria	CAN4 S104 (1985)
Criteria	NFPA 252 (2008)
Criteria	UL 10(c) (2009)
Intertek Services	Certification
Listing Section	CATEGORY A - DOORS - NO ADDITIONAL EDGE-SEALING SYSTEM REQUIRED

Columbia County Building Permit Application

For Office Use Only Application # 1010-42 Date Received 10/12/10 By CH Permit # 1853/28974
 Zoning Official BLK Date 29.10.10 Flood Zone X Land Use Res. U.L. Dev. Zoning RSF-1
 FEMA Map # N/A Elevation N/A MFE 1' above RL River N/A Plans Examiner NO Date 10-27-10
 Comments _____
☒ NOC ☒ EH ☒ Deed or PA ☒ Site Plan ☒ State Road Info ☐ Parent Parcel # _____
☐ Dev Permit # _____ ☐ In Floodway ☐ Letter of Auth. from Contractor ☐ F W Comp. letter _____
 IMPACT FEES: EMS _____ Fire _____ Corr _____ Road/Code _____
 School _____ = TOTAL N/A Suspended ☒ UF form

Septic Permit No. 10-0472 Fax _____
 Name Authorized Person Signing Permit Adam Papka Phone 623-2383
 Address 691 SW Sisters Welcome Rd, Lake City, FL 32025
 Owners Name Linda Conner Phone 404-771-1191
 911 Address 175 SW Broderick Drive Lake City FL
 Contractors Name Adam Papka Phone 623-2383
 Address 691 SW Sisters Welcome Rd Lake City FL 32025
 Fee Simple Owner Name & Address NA
 Bonding Co. Name & Address NA
 Architect/Engineer Name & Address Mark Disosway
 Mortgage Lenders Name & Address First Federal Bank of Florida
 Circle the correct power company - FL Power & Light Clay Elec. - Suwannee Valley Elec. - Progress Energy
 Property ID Number 18-4S-17-08467-003 Estimated Cost of Construction 282K
 Subdivision Name Century Estates Lot 2 Block _____ Unit _____ Phase _____
 Driving Directions 47 S. R. on Broderick Dr 2nd Lot on R

Number of Existing Dwellings on Property 0
 Construction of Single family dwelling Total Acreage 1.09 Acres Lot Size 1.09
 Do you need a Culvert Permit or Culvert Waiver or Have an Existing Drive Total Building Height 19'8"
 Actual Distance of Structure from Property Lines - Front 55' Side 34' Side 75' Rear 93'
 Number of Stories 1 Heated Floor Area 2866 Total Floor Area 4417 Roof Pitch 6-12

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standard of all laws regulating construction in this jurisdiction.

Spoke to Adam on 10/29/10 CH

Page 2 of 2 (Both Pages must be submitted together.)

Revised 6-10

Columbia County Building Permit Application

TIME LIMITATIONS OF APPLICATION: An application for a permit for any proposed work shall be deemed to have been abandoned 180 days after the date of filing, unless such application has been pursued in good faith or a permit has been issued; except that the building official is authorized to grant one or more extensions of time for additional periods not exceeding 90 days each. The extension shall be requested in writing and justifiable cause demonstrated.

TIME LIMITATIONS OF PERMITS: Every permit issued shall become invalid unless the work authorized by such permit is commenced within 180 days after its issuance, or if the work authorized by such permit is suspended or abandoned for a period of 180 days after the time work is commenced. A valid permit receives an approved inspection every 180 days. Work shall be considered not suspended, abandoned or invalid when the permit has received an approved inspection within 180 days of the previous approved inspection.

FLORIDA'S CONSTRUCTION LIEN LAW: Protect Yourself and Your Investment: According to Florida Law, those who work on your property or provide materials, and are not paid-in-full, have a right to enforce their claim for payment against your property. This claim is known as a construction lien. If your contractor fails to pay subcontractors or material suppliers or neglects to make other legally required payments, the people who are owed money may look to your property for payment, even if you have paid your contractor in full. This means if a lien is filed against your property, it could be sold against your will to pay for labor, materials or other services which your contractor may have failed to pay.

NOTICE OF RESPONSIBILITY TO BUILDING PERMITEE: **YOU ARE HEREBY NOTIFIED** as the recipient of a building permit from Columbia County, Florida, you will be held responsible to the County for any damage to sidewalks and/or road curbs and gutters, concrete features and structures, together with damage to drainage facilities, removal of sod, major changes to lot grades that result in ponding of water, or other damage to roadway and other public infrastructure facilities caused by you or your contractor, subcontractors, agents or representatives in the construction and/or improvement of the building and lot for which this permit is issued. No certificate of occupancy will be issued until all corrective work to these public infrastructures and facilities has been corrected.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

OWNERS CERTIFICATION: I CERTIFY THAT ALL THE FOREGOING INFORMATION IS ACCURATE AND THAT ALL WORK WILL BE DONE IN COMPLIANCE WITH ALL APPLICABLE LAWS REGULATING CONSTRUCTION AND ZONING

NOTICE TO OWNER: There are some properties that may have deed restrictions recorded upon them. These restrictions may limit or prohibit the work applied for in your building permit. It may be to your advantage to check and see if your property is encumbered by any restrictions.

(Owners Must Sign All Applications Before Permit Issuance)

Linda Conner
Owners Signature

****OWNER BUILDERS MUST PERSONALLY APPEAR AND SIGN THE BUILDING PERMIT**

CONTRACTORS AFFIDAVIT: By my signature I understand and agree that I have informed and provided this written statement to the owner of all the above written responsibilities in Columbia County for obtaining this Building Permit including all application and permit time limitations.

[Signature]
Contractor's Signature (Permitee)

Contractor's License Number CBC1253409
Columbia County
Competency Card Number _____

Affirmed under penalty of perjury to by the Contractor and subscribed before me this 21 day of October 2010

Personally known [Signature] or Produced Identification _____


[Signature]
State of Florida Notary Signature (For the Contractor)

SEAL:

NOTARY PUBLIC-STATE OF FLORIDA
Linda R. Roder
Commission #DD755608
Expires: MAR. 24, 2012

Linda Conner

18-45-17-08467-003

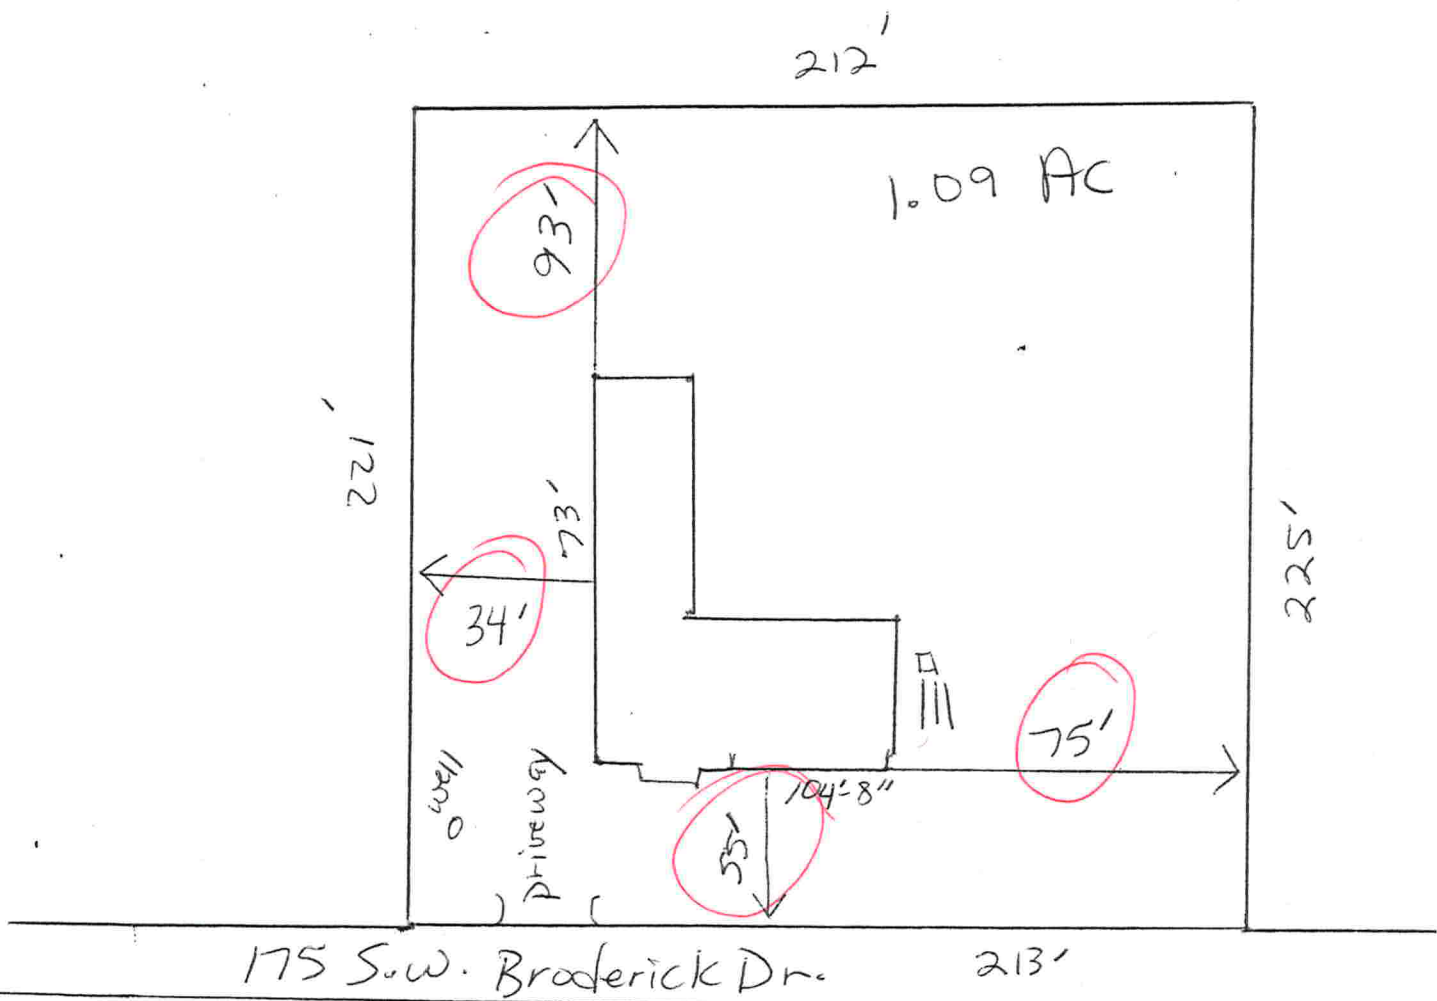

TMD 10-181

THIS INSTRUMENT WAS PREPARED BY:
FIRST FEDERAL BANK OF FLORIDA
4705 WEST U.S. HIGHWAY 90
P.O. BOX 2029
LAKE CITY, FLORIDA 32056

Rec. 10.00
Cost. Pay 3.00

Inst. 201012016264 Date: 10/8/2010 Time: 12:00 AM
DC P DeWitt Cason, Columbia County Page 1 of 1 B 1202 P 2045

PERMIT NO. _____

TAX FOLIO NO. R08467-003

NOTICE OF COMMENCEMENT

STATE OF FLORIDA
COUNTY OF COLUMBIA

The undersigned hereby gives notice that improvement will be made to certain real property, and in accordance with Chapter 713, Florida Statutes, the following information is provided in this Notice of Commencement.


1. Description of property: Lot 2 and the West 7 Feet of Lot 1, CENTURY ESTATES, a subdivision according to the plat thereof recorded in Plat Book 4, Page 90 of the public records of Columbia County, Florida.
2. General description of improvement: Construction of Dwelling
3. Owner information:
 - a. Name and address: LINDA CONNER, as Trustee of the Linda Conner Revocable Trust dated July 16, 2007, 207 SW Audrey Way, Lake City, Florida 32024; 386-755-0058
 - b. Interest in property: Fee Simple
 - c. Name and address of fee simple title holder (if other than Owner): NONE
4. Contractor (name and address): ADAM'S FRAMING AND CONSTRUCTION, LLC, 691 SW Sisters Welcome Road, Lake City, Florida 32025 - Telephone No. 386-623-2383
5. Surety:
 - a. Name and address: N/A
 - b. Amount of bond: _____
6. Lender: FIRST FEDERAL BANK OF FLORIDA
4705 WEST U.S. HIGHWAY 90
P. O. BOX 2029
LAKE CITY, FLORIDA 32056
7. Persons within the State of Florida designated by Owner upon whom notices or other document may be served as provided by Section 713.13 (1) (a) 7., Florida Statutes: NONE
8. In addition to himself, Owner designates PAULA HACKER of FIRST FEDERAL BANK OF FLORIDA, 4705 West U.S. Highway 90 / P. O. Box 2029, Lake City, Florida 32056 to receive a copy of the Lienor's Notice as provided in Section 713.13 (1) (b), Florida Statutes.
9. Expiration date of notice of commencement (the expiration date is 1 year from the date of recording unless a different date is specified).

Linda Conner, Trustee
Borrower Name Linda Conner, Trustee

Co-Borrower Name _____

The foregoing instrument was acknowledged before me this 7th day of October, 2010, by LINDA CONNER, as Trustee of the Linda Conner Revocable Trust dated July 16, 2007, who is personally known to me or who has produced driver's license for identification.

Terry McDavid
Notary Public
My Commission Expires _____



This Instrument Prepared By:
Michael H. Harrell
Abstract & Title Services, Inc.
PO Box 7175
Lake City, Florida 32055
ATS# 17601

Inst: 200912010769 Date: 6/29/2009 Time: 2:17 PM
Doc Stamp-Deed: 308.00
DC, P. DeWitt Cason, Columbia County Page 1 of 1 B: 1176 P: 393

GENERAL WARRANTY DEED

Individual to Trust

This Warranty Deed made this 26th day of June, 2009 by

Wayne Hudson

hereinafter called the Grantor, to

Linda Conner, as Trustee of the Linda Conner Revocable Trust dated July 16, 2007

with full power to manage, conserve, sell, and transfer the subject property, whose post office address is 5844 Pro Drive, Norcross, GA 30092, hereinafter called the Grantee.

(Wherever used herein the terms "Grantor" and "Grantee" include all the parties to this instrument and the heirs, legal representatives and assigns of Individuals, and the successors and assigns of Corporation.)

The Grantor, for and in consideration of the sum of \$10.00 and other valuable considerations, receipt whereof is hereby acknowledged, hereby grants, bargains, sells, unto the Grantee all that certain land, situate in Columbia County, Florida, viz: TAX ID: R08467-003 :

Lot 2 and the West 7 feet of Lot 1, Century Estates, a subdivision according to the plat thereof recorded in Plat Book 4, Page 90 of the Public Records of Columbia County, Florida.

The above described property is not, nor has it ever been the homestead property of the Grantor and is in fact Vacant Land.

Together with all the tenements, hereditaments, and appurtenances thereto belonging or in any ways appertaining.

To have and to hold, the same in fee simple forever.

And the Grantor hereby covenants with said Grantee that the Grantor is lawfully seized of said land in fee simple; that the Grantor has good right and lawful authority to sell and convey said land, and hereby warrants the title to said land and will defend the same against the lawful claims of all persons whomsoever; and that said land is free of all encumbrances except taxes accruing subsequent to December 31, 2008.

In witness whereof, the said Grantor has signed and sealed these presents the day and year first above written.

Donna Cox
WITNESS

Printed Name: Donna Cox

Traci Landry
WITNESS

Printed Name: Traci Landry

Wayne Hudson
Wayne Hudson

State of Florida
County of Columbia

I hereby certify that on this 26th day of June, 2009, before me, an officer duly authorized to administer oaths and take acknowledgements, personally appeared Wayne Hudson, who is personally known to me or produced a DL for identification, and known to me to be the person described in and who executed the foregoing instrument, who acknowledged before me that he/she/they executed the same, and an oath was not taken.

(SEAL)



DONNA COX
Notary Public, State of Florida
My Comm. Expires Jan. 15, 2010
Commission No. DD 507061
Bonded Thru Notary Public Underwriters

Donna Cox
NOTARY PUBLIC

My Commission Expires:



STATE OF FLORIDA
DEPARTMENT OF HEALTH


APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT

Permit Application Number

10-0472

PART II - SITE PLAN

Scale: Each block represents 5 feet and 1 inch = 50 feet.

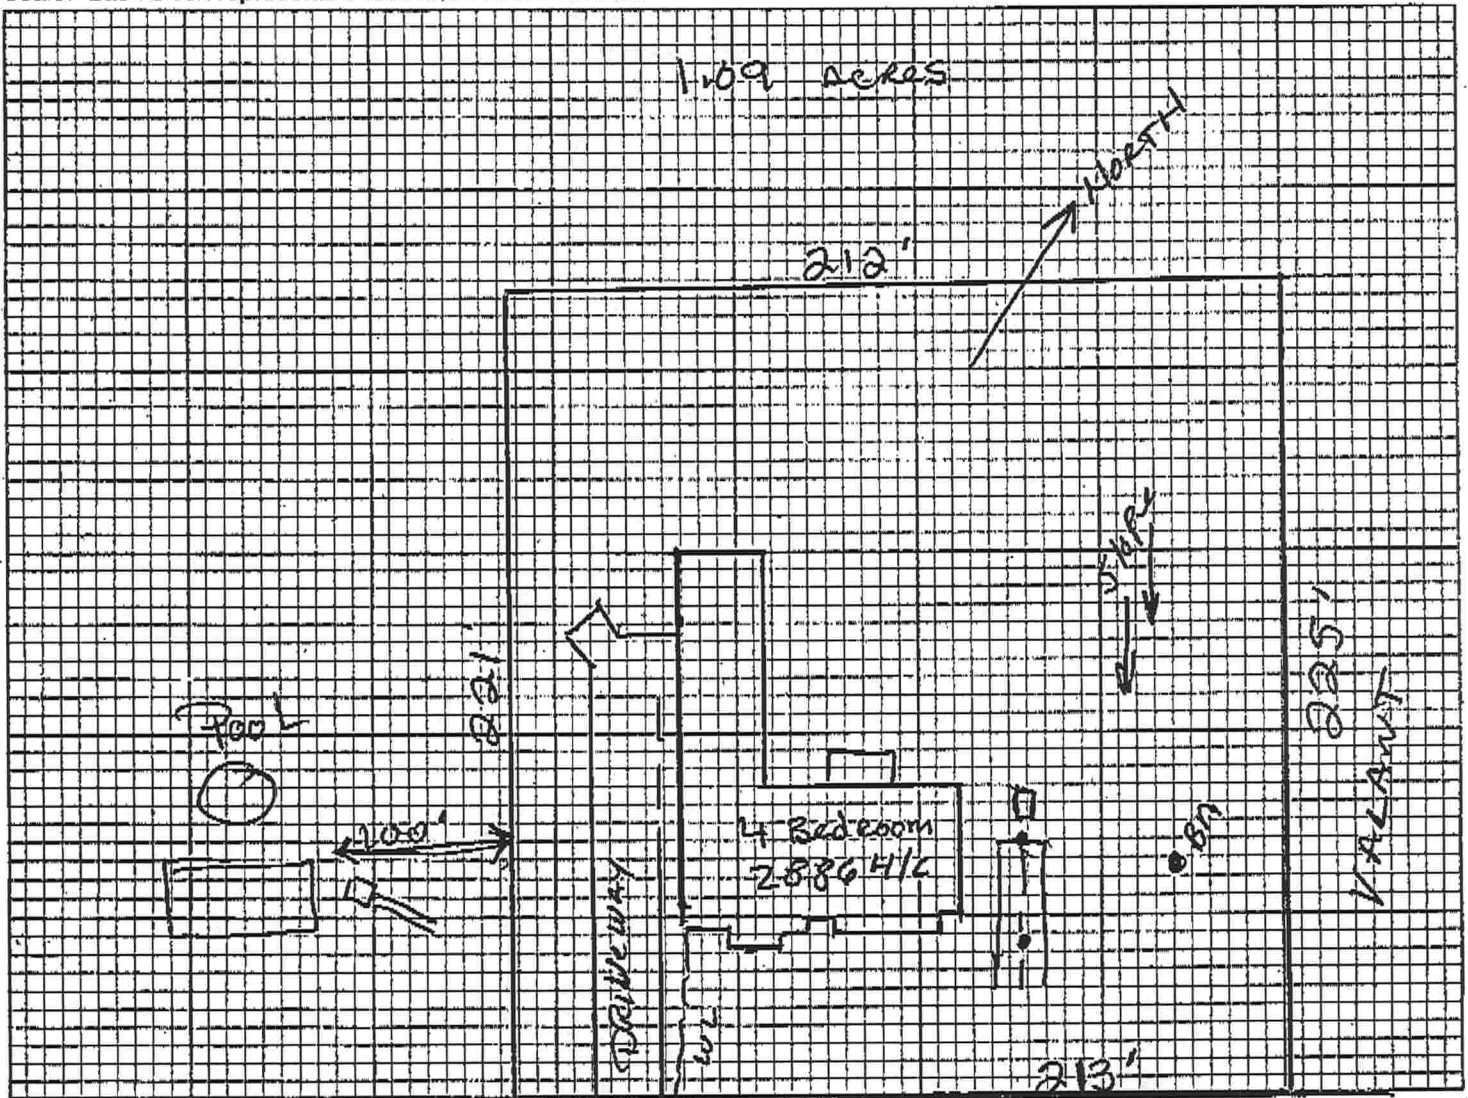

Notes:

175 SW Broderick

Linda Conner

Lot 2 Century Estates

1.09 Acres

Site Plan submitted by:

Robert W. Ford Jr.

Signature

Agent

Title

Plan Approved ☒

Not Approved ☐

Date

10-21-10

By

Salli Ford, EH Director

Columbia CHD

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

New Construction Subterranean Termite Service Record

OMB Approval No. 2502-0525
(exp. 02/29/2012)

This form is completed by the licensed Pest Control Company.

Public reporting burden for this collection of information is estimated to average 15 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. This information is required to obtain benefits. HUD may not collect this information, and you are not required to complete this form, unless it displays a currently valid OMB control number.

Section 24 CFR 200.926d(b)(3) requires that the sites for HUD insured structures must be free of termite hazards. This information collection requires the builder to certify that an authorized Pest Control company performed all required treatment for termites, and that the builder guarantees the treated area against infestation for one year. Builders, pest control companies, mortgage lenders, homebuyers, and HUD as a record of treatment for specific homes will use the information collected. The information is not considered confidential, therefore, no assurance of confidentiality is provided.

This report is submitted for informational purposes to the builder on proposed (new) construction cases when treatment for prevention of subterranean termite infestation is specified by the builder, architect, or required by the lender, architect, FHA, or VA.

All contracts for services are between the Pest Control Company and builder, unless stated otherwise.

28974

Section 1: General Information (Pest Control Company Information)

Company Name Aspen Pest Control, Inc.
Company Address P.O. Box 1785 City Lake City State FL Zip 32056
Company Business License No. JB109476 Company Phone No. 386-755-3611
FHA/VA Case No. (if any) _____

Section 2: Builder Information

Company Name Adam's Construction Phone No. 623-2385

Section 3: Property Information

Location of Structure(s) Treated (Street Address or Legal Description, City, State and Zip) Linda Conner 175 SW
Broderick Dr. Lake City, FL 32025

Section 4: Service Information

Date(s) of Service(s) 11-15-2010
Type of Construction (More than one box may be checked) ☒ Slab ☐ Basement ☐ Crawl ☐ Other _____

Check all that apply:

- ☒ A. Soil Applied Liquid Termiticide
Brand Name of Termiticide: Maxx-Thor EPA Registration No. 93923-6
Approx. Dilution (%): .06 Approx. Total Gallons Mix Applied: 650 Treatment completed on exterior: ☐ Yes ☒ No
- ☐ B. Wood Applied Liquid Termiticide
Brand Name of Termiticide: _____ EPA Registration No. _____
Approx. Dilution (%): _____ Approx. Total Gallons Mix Applied: _____
- ☐ C. Bait System Installed
Name of System: _____ EPA Registration No. _____ Number of Stations Installed: _____
- ☐ D. Physical Barrier System Installed
Name of System: _____ Attach installation information (required)

Service Agreement Available? ☒ Yes ☐ No

Note: Some state laws require service agreements to be issued. This form does not preempt state law.

Attachments (List) _____

Comments _____

Name of Applicator(s) C. Lacey Certification No. (if required by State law) JB104376

The applicator has used a product in accordance with the product label and state requirements. All materials and methods used comply with state and federal regulations.

Authorized Signature [Signature] Date 11-15-2010

Warning: HUD will prosecute false claims and statements. Conviction may result in criminal and/or civil penalties. (18 U.S.C. 1001, 1010, 1012; 31 U.S.C. 3729, 3802)

Form NPCA-99-B may still be used

form HUD-NPMA-99-B

SUBCONTRACTOR VERIFICATION FORM

NUMBER

28974

CONTRACTOR

Adam F. F. F.

PHONE

623-2383

THIS FORM MUST BE SUBMITTED PRIOR TO THE ISSUANCE OF A PERMIT

In Columbia County one permit will cover all trades doing work at the permitted site. It is **REQUIRED** that we have records of the subcontractors who actually did the trade specific work under the permit. Per Florida Statute 440 and Ordinance 89-6, a contractor shall require all subcontractors to provide evidence of workers' compensation or exemption, general liability insurance and a valid Certificate of Competency license in Columbia County.

Any changes, the permitted contractor is responsible for the corrected form being submitted to this office prior to the start of that subcontractor beginning any work. Violations will result in stop work orders and/or fines.

ELECTRICAL	Print Name _____ License #: _____	Signature _____ Phone #: _____
MECHANICAL/ A/C _____	Print Name _____ License #: _____	Signature _____ Phone #: _____
PLUMBING/ GAS	Print Name _____ License #: _____	Signature _____ Phone #: _____
ROOFING	Print Name _____ License #: _____	Signature _____ Phone #: _____
SHEET METAL	Print Name _____ License #: _____	Signature _____ Phone #: _____
FIRE SYSTEM/ SPRINKLER	Print Name _____ License #: _____	Signature _____ Phone #: _____
SOLAR	Print Name _____ License #: _____	Signature _____ Phone #: _____

Specialty License	License Number	Sub-Contractors Printed Name	Sub-Contractors Signature
MASON	97	Kenneth Loudon	Kenneth Loudon
CONCRETE FINISHER			
FRAMING			
INSULATION			
STUCCO			
DRYWALL			
PLASTER			
CABINET INSTALLER			
PAINTING			
ACOUSTICAL CEILING			
GLASS			
CERAMIC TILE			
FLOOR COVERING			
ALUM/VINYL SIDING			
GARAGE DOOR			
METAL BLDG ERECTOR			

F. S. 440.103 Building permits; identification of minimum premium policy.--Every employer shall, as a condition to applying for and receiving a building permit, show proof and certify to the permit issuer that it has secured compensation for its employees under this chapter as provided in ss. 440.10 and 440.38, and shall be presented each time the employer applies for a building permit.

SUBCONTRACTOR VERIFICATION FORM

APPLICATION NUMBER

1010-42

CONTRACTOR

ADAM PAPIKA

ADAM'S Framing & Const

PHONE 386-623-383

THIS FORM MUST BE SUBMITTED PRIOR TO THE ISSUANCE OF A PERMIT

In Columbia County one permit will cover all trades doing work at the permitted site. It is **REQUIRED** that we have records of the subcontractors who actually did the trade specific work under the permit. Per Florida Statute 440 and Ordinance 89-6, a contractor shall require all subcontractors to provide evidence of workers' compensation or exemption, general liability insurance and a valid Certificate of Competency license in Columbia County.

Any changes, the permitted contractor is responsible for the corrected form being submitted to this office prior to the start of that subcontractor beginning any work. Violations will result in stop work orders and/or fines.

ELECTRICAL 380	Print Name: <u>Donald Davis</u> License #: <u>EC0002306</u>	Signature: <u>[Signature]</u> Phone #: <u>386-623-0499</u>
MECHANICAL/A/C B-508	Print Name: <u>DAVID HALL</u> License #: <u>CAC057424</u>	Signature: <u>[Signature]</u> Phone #: <u>386-755-9792</u>
PLUMBING/GAS 714	Print Name: <u>Mark B Bais</u> License #: <u>CFC057219</u>	Signature: <u>[Signature]</u> Phone #: <u>752-8656</u>
ROOFING 514	Print Name: <u>Adguy Papika</u> License #: <u>NA</u>	Signature: <u>[Signature]</u> Phone #: <u></u>
SHEET METAL	Print Name: <u>NA</u> License #: <u>NA</u>	Signature: <u>[Signature]</u> Phone #: <u></u>
FIRE SYSTEM/SPRINKLER	Print Name: <u>NA</u> License #: <u>NA</u>	Signature: <u>[Signature]</u> Phone #: <u></u>
SOLAR	Print Name: <u>NA</u> License #: <u>NA</u>	Signature: <u>[Signature]</u> Phone #: <u></u>

Specialty License	License Number	Sub-Contractors Printed Name	Sub-Contractors Signature
MASON	00157	FRANK CROFT	<u>[Signature]</u>
CONCRETE FINISHER	CBC1253409	ADAM'S Framing & Const	<u>[Signature]</u>
FRAMING	CBC1253409	ADAM'S Framing & Const	<u>[Signature]</u>
INSULATION	000741	SUNCOAST Patsy Bowen	<u>[Signature]</u>
STUCCO	NA		
DRYWALL	000838	Jerry Ruzika	<u>[Signature]</u>
PLASTER	000838	Jerry Ruzika	<u>[Signature]</u>
CABINET INSTALLER	CBC1253409	ADAM'S FRAMING & CONST	<u>[Signature]</u>
PAINTING	CBC1253409	ADAM'S FRAMING & CONST	<u>[Signature]</u>
ACOUSTICAL CEILING	NA		
GLASS	NA		
CERAMIC TILE	See Separate Sheet Attached		
FLOOR COVERING	000118	JAMIN MARTIN	<u>[Signature]</u>
ALUM/VINYL SIDING	CBC1253409	ADAM'S FRAMING & CONST	<u>[Signature]</u>
GARAGE DOOR	CBC1253409	ADAM'S FRAMING & CONST	<u>[Signature]</u>
METAL BLDG ERECTOR	NA		

F. S. 440.103 Building permits; identification of minimum premium policy.--Every employer shall, as a condition to applying for and receiving a building permit, show proof and certify to the permit issuer that it has secured compensation for its employees under this chapter as provided in ss. 440.10 and 440.38, and shall be presented each time the employer applies for a building permit.

SUBCONTRACTOR VERIFICATION FORM


APPLICATION NUMBER _____ CONTRACTOR _____ PHONE _____

THIS FORM MUST BE SUBMITTED PRIOR TO THE ISSUANCE OF A PERMIT

In Columbia County one permit will cover all trades doing work at the permitted site. It is **REQUIRED** that we have records of the subcontractors who actually did the trade specific work under the permit. Per Florida Statute 440 and Ordinance 89-6, a contractor shall require all subcontractors to provide evidence of workers' compensation or exemption, general liability insurance and a valid Certificate of Competency license in Columbia County.

Any changes, the permitted contractor is responsible for the corrected form being submitted to this office prior to the start of that subcontractor beginning any work. Violations will result in stop work orders and/or fines.

ELECTRICAL	Print Name _____ License #: _____	Signature _____ Phone #: _____
MECHANICAL/ A/C _____	Print Name _____ License #: _____	Signature _____ Phone #: _____
PLUMBING/ GAS	Print Name _____ License #: _____	Signature _____ Phone #: _____
ROOFING	Print Name _____ License #: _____	Signature _____ Phone #: _____
SHEET METAL	Print Name _____ License #: _____	Signature _____ Phone #: _____
FIRE SYSTEM/ SPRINKLER	Print Name _____ License #: _____	Signature _____ Phone #: _____
SOLAR	Print Name _____ License #: _____	Signature _____ Phone #: _____

Specialty License	License Number	Sub-Contractors Printed Name	Sub-Contractors Signature
MASON			
CONCRETE FINISHER			
FRAMING			
INSULATION			
STUCCO			
DRYWALL			
PLASTER			
CABINET INSTALLER			
PAINTING			
ACOUSTICAL CEILING			
GLASS			
CERAMIC TILE	152	TREVOR BLANK	
FLOOR COVERING			
ALUM/VINYL SIDING			
GARAGE DOOR			
METAL BLDG ERECTOR			

F. S. 440.103 Building permits; identification of minimum premium policy.—Every employer shall, as a condition to applying for and receiving a building permit, show proof and certify to the permit issuer that it has secured compensation for its employees under this chapter as provided in ss. 440.10 and 440.38, and shall be presented each time the employer applies for a building permit.

2010-10-28 10:58

Lynch Well Drilling

386-752-1477 >>

3867522282

(1010-72) 758-2160 P1/1

Water Wells
Pumps & Service

Linda Conner

Phone: (386) 752-6677
Fax: (386) 752-1477

Lynch Well Drilling, Inc.

173 SW Young Place
Lake City, FL 32025

www.lynchwelldrilling.com

October 28, 2010

To Whom It May Concern:

As required by building code regulations for Columbia County in order that a building permit can be issued, the following well information is provided with regard to the well for Linda Conner on Broderick Dr. off 47 -S.

Size of Pump Motor:	1 HP 20 gallons per min.
Size of Pressure Tank:	81 -Gallon Bladder Tank - 25.1 Draw down
Cycle Stop Valve Used:	No
Constant Pressure System:	No

Should you require any additional information, please contact us.

Sincerely,



Linda Newcomb
Lynch Well Drilling, Inc.

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Community Affairs Residential Performance Method A

Project Name: 1009005 Adam'sFramingConnerLinda
 Street: 175 SW Brodrick Dr.
 City, State, Zip: Lake City, FL,
 Owner: Linda Conner
 Design Location: FL, Gainesville

Builder Name: Adam's Framing
 Permit Office: *Columbia County*
 Permit Number: *28974*
 Jurisdiction: *221500*

1. New construction or existing	New (From Plans)	
2. Single family or multiple family	Single-family	
3. Number of units, if multiple family	1	
4. Number of Bedrooms	4	
5. Is this a worst case?	Yes	
6. Conditioned floor area (ft ²)	2886	
7. Windows	Description	Area
a. U-Factor:	.Dbl, default	291.00 ft ²
SHGC:	Clear, default	
b. U-Factor:	N/A	ft ²
SHGC:		
c. U-Factor:	N/A	ft ²
SHGC:		
d. U-Factor:	N/A	ft ²
SHGC:		
e. U-Factor:	N/A	ft ²
SHGC:		
8. Floor Types	Insulation	Area
a. Slab-On-Grade Edge Insulation	R=0.0	2886.00 ft ²
b. N/A	R=	ft ²
c. N/A	R=	ft ²

9. Wall Types	Insulation	Area
a. Face Brick - Wood, Exterior	R=13.0	2431.50 ft ²
b. Frame - Wood, Adjacent	R=13.0	552.00 ft ²
c. N/A	R=	ft ²
d. N/A	R=	ft ²
10. Ceiling Types	Insulation	Area
a. Under Attic (Vented)	R=30.0	2886.00 ft ²
b. Knee Wall (Vented)	R=30.0	144.00 ft ²
c. N/A	R=	ft ²
11. Ducts		
a. Sup: Attic Ret: Attic AH: Garage Sup. R= 6,	577.2 ft ²	
12. Cooling systems		
a. Central Unit	Cap: 62.0 kBtu/hr	SEER: 13
13. Heating systems		
a. Electric Heat Pump	Cap: 62.0 kBtu/hr	HSPF: 7.7
14. Hot water systems		
a. Electric	Cap: 40 gallons	EF: 0.92
b. Conservation features	None	
15. Credits	None	

Glass/Floor Area: 0.101

Total As-Built Modified Loads: 47.98

Total Baseline Loads: 56.51

PASS

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

PREPARED BY: _____

DATE: *9/27/10* *ELAN BEANSLEY*

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: *John Rola*DATE: *10-20-10*

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.



BUILDING OFFICIAL: _____

DATE: _____

PROJECT

Title: 1009005 Adam'sFramingCon	Bedrooms: 4	Address Type: Street Address
Building Type: FLAsBuilt	Conditioned Area: 2886	Lot #
Owner: Linda Conner	Total Stories: 1	SubDivision:
# of Units: 1	Worst Case: Yes	PlatBook:
Builder Name: Adam's Framing	Rotate Angle: 225	Street: 175 SW Brodrick Dr.
Permit Office:	Cross Ventilation:	County: Columbia
Jurisdiction:	Whole House Fan:	City, State, Zip: Lake City , FL ,
Family Type: Single-family		
New/Existing: New (From Plans)		
Comment:		

CLIMATE

✓	Design Location	TMY Site	IECC Zone	Design Temp 97.5 %	Design Temp 2.5 %	Int Design Temp Winter	Int Design Temp Summer	Heating Degree Days	Design Moisture	Daily Temp Range
✓	FL, Gainesville	FL_GAINESVILLE_REGI	2	32	92	75	70	1305.5	51	Medium

FLOORS

✓	#	Floor Type	Perimeter	R-Value	Area	Tile	Wood	Carpet
✓	1	Slab-On-Grade Edge Insulatio	331.5 ft	0	2886 ft²	0.3	0.3	0.4

ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Solar Absor.	Tested	Deck Insul.	Pitch
✓	1	Gable or shed	Composition shingles	3228 ft²	722 ft²	Dark	0.96	No	0	26.6 deg

ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
✓	1	Full attic	Vented	300	2886 ft²	N	N

CEILING

✓	#	Ceiling Type	R-Value	Area	Framing Frac	Truss Type
✓	1	Under Attic (Vented)	30	2886 ft²	0.11	Wood
✓	2	Knee Wall (Vented)	30	144 ft²	0.11	Wood

WALLS

✓	#	Omt	Adjacent To	Wall Type	Cavity R-Value	Area	Sheathing R-Value	Framing Fraction	Solar Absor.
✓	1	N	Exterior	Face Brick - Wood	13	627 ft²	0	0.23	0.75
✓	2	E	Exterior	Face Brick - Wood	13	657 ft²	0	0	0.75
✓	3	S	Exterior	Face Brick - Wood	13	490.5 ft²	0	0	0.75
✓	4	W	Exterior	Face Brick - Wood	13	657 ft²	0	0	0.75
✓	5	N	Garage	Frame - Wood	13	552 ft²		0.23	0.01

DOORS

✓	#	Ornt	Door Type	Storms	U-Value	Area
_____	1	N	Insulated	None	0.400000	20 ft²
_____	2	E	Insulated	None	0.400000	20 ft²
_____	3	S	Insulated	None	0.4	20 ft²
_____	4	W	Insulated	None	0.4	10 ft²
_____	5	N	Insulated	None	0.4	20 ft²
_____	6	N	Insulated	None	0.400000	20 ft²

WINDOWS

Orientation shown is the entered orientation (=>) changed to Worst Case.

✓	#	Ornt	Frame	Panes	NFRC	U-Factor	SHGC	Storms	Area	Overhang Depth Separation	Int Shade	Screening
_____	1	N=>SW	Metal	Low-E Double	No	0.87	0.66	N	9 ft²	1 ft 6 in 2 ft 0 in	HERS 2006	None
_____	2	E=>NW	Metal	Low-E Double	No	0.87	0.66	N	72 ft²	9 ft 6 in 2 ft 0 in	HERS 2006	None
_____	3	E=>NW	Metal	Low-E Double	No	0.87	0.66	N	18 ft²	1 ft 6 in 2 ft 0 in	HERS 2006	None
_____	4	E=>NW	Metal	Low-E Double	No	0.87	0.66	N	18 ft²	0 ft 0 in 0 ft 0 in	HERS 2006	None
_____	5	S=>NE	Metal	Low-E Double	No	0.87	0.66	N	72 ft²	1 ft 6 in 2 ft 0 in	HERS 2006	None
_____	6	W=>SE	Metal	Low-E Double	No	0.87	0.66	N	36 ft²	10 ft 0 in 2 ft 0 in	HERS 2006	None
_____	7	W=>SE	Metal	Low-E Double	No	0.87	0.66	N	30 ft²	10 ft 0 in 2 ft 0 in	HERS 2006	None
_____	8	W=>SE	Metal	Low-E Double	No	0.87	0.66	N	36 ft²	1 ft 6 in 2 ft 0 in	HERS 2006	None

INFILTRATION & VENTING

✓	Method	SLA	CFM 50	ACH 50	ELA	EqLA	---- Forced Ventilation ---- Supply CFM Exhaust CFM		Run Time Fraction	Fan Watts
_____	Default	0.00036	2725	6.30	149.6	281.4	0 cfm	0 cfm	0	0

GARAGE

✓	#	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
_____	1	947.6 ft²	947.6 ft²	77 ft	9 ft	(invalid)

COOLING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Air Flow	SHR	Ducts
_____	1	Central Unit	None	SEER: 13	62 kBtu/hr	1860 cfm	0.75	sys#1

HEATING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Ducts
_____	1	Electric Heat Pump	None	HSPF: 7.7	62 kBtu/hr	sys#1

HOT WATER SYSTEM

✓	#	System Type	EF	Cap	Use	SetPnt	Conservation
_____	1	Electric	0.92	40 gal	70 gal	120 deg	None

SOLAR HOT WATER SYSTEM

✓	FSEC Cert #	Company Name	System Model #	Collector Model #	Collector Area	Storage Volume	FEF
_____	None	None			ft²		

DUCTS

✓	#	--- Supply --- Location	R-Value	Area	--- Return --- Location	Area	Leakage Type	Air Handler	CFM 25	Percent Leakage	QN	RLF
_____	1	Attic	6	577.2 ft	Attic	144.3 ft	Default Leakage	Garage	(Default)	(Default) %		

TEMPERATURES

Programable Thermostat: None						Ceiling Fans:							
Cooling	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec	
Heating	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec	
Venting	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec	
Thermostat Schedule: HERS 2006 Reference													
Schedule Type		1	2	3	4	5	6	7	8	9	10	11	12
Cooling (WD)	AM	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78
Cooling (WEH)	AM	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78
Heating (WD)	AM	68	68	68	68	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	68
Heating (WEH)	AM	68	68	68	68	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	68

Code Compliance Checklist

Residential Whole Building Performance Method A - Details

ADDRESS: 175 SW Brodrick Dr.
Lake City, FL,

PERMIT #:

INFILTRATION REDUCTION COMPLIANCE CHECKLIST

COMPONENTS	SECTION	REQUIREMENTS FOR EACH PRACTICE	CHECK
Exterior Windows & Doors	N1106.AB.1.1	Maximum: .3 cfm/sq.ft. window area; .5 cfm/sq.ft. door area.	
Exterior & Adjacent Walls	N1106.AB.1.2.1	Caulk, gasket, weatherstrip or seal between: windows/doors & frames, surrounding wall; foundation & wall sole or sill plate; joints between exterior wall panels at corners; utility penetrations; between wall panels & top/bottom plates; between walls and floor. EXCEPTION: Frame walls where a continuous infiltration barrier is installed that extends from, and is sealed to, the foundation to the top plate.	
Floors	N1106.AB.1.2.2	Penetrations/openings > 1/8" sealed unless backed by truss or joint members. EXCEPTION: Frame floors where a continuous infiltration barrier is installed that is sealed to the perimeter, penetrations and seams.	
Ceilings	N1106.AB.1.2.3	Between walls & ceilings; penetrations of ceiling plane to top floor; around shafts, chases, soffits, chimneys, cabinets sealed to continuous air barrier; gaps in gyp board & top plate; attic access. EXCEPTION: Frame ceilings where a continuous infiltration barrier is installed that is sealed at the perimeter, at penetrations and seams.	
Recessed Lighting Fixtures	N1106.AB.1.2.4	Type IC rated with no penetrations, sealed; or Type IC or non-IC rated, installed inside a sealed box with 1/2" clearance & 3" from insulation; or Type IC with < 2.0 cfm from conditioned space, tested.	
Multi-story Houses	N1106.AB.1.2.5	Air barrier on perimeter of floor cavity between floors.	
Additional Infiltration reqts	N1106.AB.1.3	Exhaust fans vented to outdoors, dampers; combustion space heaters comply with NFPA, have combustion air.	

OTHER PRESCRIPTIVE MEASURES (must be met or exceeded by all residences.)

COMPONENTS	SECTION	REQUIREMENTS	CHECK
Water Heaters	N1112.AB.3	Comply with efficiency requirements in Table N112.ABC.3. Switch or clearly marked circuit breaker (electric) or cutoff (gas) must be provided. External or built-in heat trap required.	
Swimming Pools & Spas	N1112.AB.2.3	Spas & heated pools must have covers (except solar heated). Non-commercial pools must have a pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%. Heat pump pool heaters shall have a minimum COP of 4.0.	
Shower heads	N1112.AB.2.4	Water flow must be restricted to no more than 2.5 gallons per minute at 80 PSIG.	
Air Distribution Systems	N1110.AB	All ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of Section N1110.AB. Ducts in unconditioned attics: R-6 min. insulation.	
HVAC Controls	N1107.AB.2	Separate readily accessible manual or automatic thermostat for each system.	
Insulation	N1104.AB.1 N1102.B.1.1	Ceilings-Min. R-19. Common walls-frame R-11 or CBS R-3 both sides. Common ceiling & floors R-11.	

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 85

The lower the EnergyPerformance Index, the more efficient the home.

175 SW Brodrick Dr., Lake City, FL,

1. New construction or existing	New (From Plans)	9. Wall Types	Insulation	Area
2. Single family or multiple family	Single-family	a. Face Brick - Wood, Exterior	R=13.0	2431.50 ft ²
3. Number of units, if multiple family	1	b. Frame - Wood, Adjacent	R=13.0	552.00 ft ²
4. Number of Bedrooms	4	c. N/A	R=	ft ²
5. Is this a worst case?	Yes	d. N/A	R=	ft ²
6. Conditioned floor area (ft ²)	2886	10. Ceiling Types	Insulation	Area
7. Windows**	Description	a. Under Attic (Vented)	R=30.0	2886.00 ft ²
a. U-Factor:	Dbl, default	b. Knee Wall (Vented)	R=30.0	144.00 ft ²
SHGC:	Clear, default	c. N/A	R=	ft ²
b. U-Factor:	N/A	11. Ducts		
SHGC:		a. Sup: Attic Ret: Attic AH: Garage Sup. R= 6, 577.2 ft ²		
c. U-Factor:	N/A	12. Cooling systems		
SHGC:		a. Central Unit	Cap: 62.0 kBtu/hr	
d. U-Factor:	N/A		SEER: 13	
SHGC:		13. Heating systems		
e. U-Factor:	N/A	a. Electric Heat Pump	Cap: 62.0 kBtu/hr	
SHGC:			HSPF: 7.7	
8. Floor Types	Insulation	14. Hot water systems		
a. Slab-On-Grade Edge Insulation	R=0.0	a. Electric	Cap: 40 gallons	
b. N/A	R=		EF: 0.92	
c. N/A	R=	b. Conservation features		
		None		
		15. Credits		None

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: _____



*Note: The home's estimated Energy Performance Index is only available through the EnergyGauge USA - FlaRes2008 computer program. This is not a Building Energy Rating. If your Index is below 100, your home may qualify for incentives if you obtain a Florida Energy Gauge Rating. Contact the Energy Gauge Hotline at (321) 638-1492 or see the Energy Gauge web site at energygauge.com for information and a list of certified Raters. For information about Florida's Energy Efficiency Code for Building Construction, contact the Department of Community Affairs at (850) 487-1824.

**Label required by Section 13-104.4.5 of the Florida Building Code, Building, or Section B2.1.1 of Appendix G of the Florida Building Code, Residential, if not DEFAULT.



COLUMBIA COUNTY BUILDING DEPARTMENT RESIDENTIAL CHECK LIST REQUIREMENTS

MINIMUM PLAN REQUIREMENTS FOR THE FLORIDA BUILDING CODE RESIDENTIAL 2007 ONE (1) AND TWO (2) FAMILY DWELLINGS


ALL REQUIREMENTS ARE SUBJECT TO CHANGE

ALL BUILDING PLANS MUST INDICATE COMPLIANCE with the Current 2007 FLORIDA BUILDING CODES RESIDENTIAL. ALL PLANS OR DRAWINGS SHALL PROVIDE CALCULATIONS AND DETAILS THAT HAVE THE SEAL AND SIGNATURE OF A CERTIFIED ARCHITECT OR ENGINEER REGISTERED IN THE STATE OF FLORIDA, OR ALTERNATE METHODOLOGIES, APPROVED BY THE STATE OF FLORIDA BUILDING COMMISSION FOR ONE-AND-TWO FAMILY DWELLINGS.

FOR DESIGN PURPOSES THE FOLLOWING BASIC WIND SPEEDS ARE PER FIGURE R301.2(4) of the FLORIDA BUILDING CODES RESIDENTIAL (Florida Wind speed map) SHALL BE USED.

WIND SPEED LINE SHALL BE DEFINED AS FOLLOWS: THE CENTERLINE OF INTERSTATE 75.

ALL BUILDINGS CONSTRUCTED EAST OF SAID LINE SHALL BE ----- 100 MPH
ALL BUILDINGS CONSTRUCTED WEST OF SAID LINE SHALL BE -----110 MPH
NO AREA IN COLUMBIA COUNTY IS IN A WIND BORNE DEBRIS REGION

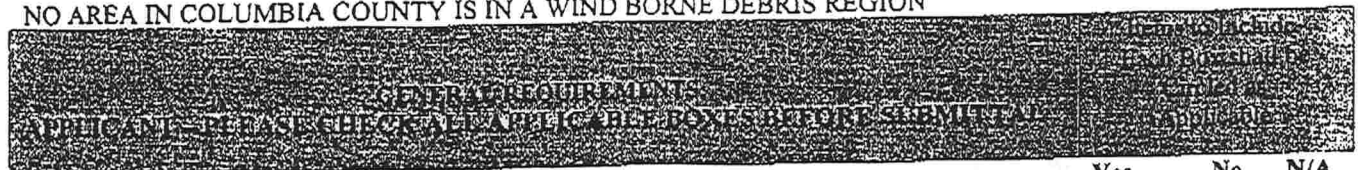

		Yes	No	N/A
1	Two (2) complete sets of plans containing the following:	<input checked="" type="checkbox"/>		
2	All drawings must be clear, concise, drawn to scale, details that are not used shall be marked void	<input checked="" type="checkbox"/>		
3	Condition space (Sq. Ft.)	IIIIII	IIIIII	IIII
	Total (Sq. Ft.) under roof			

Designers name and signature shall be on all documents and a licensed architect or engineer, signature and official embossed seal shall be affixed to the plans and documents as per the FLORIDA BUILDING CODES RESIDENTIAL R101.2.1

Site Plan information including:

4	Dimensions of lot or parcel of land	<input checked="" type="checkbox"/>		
5	Dimensions of all building set backs	<input checked="" type="checkbox"/>		
6	Location of all other structures (include square footage of structures) on parcel, existing or proposed well and septic tank and all utility easements.	<input checked="" type="checkbox"/>		
7	Provide a full legal description of property.	<input checked="" type="checkbox"/>		

Wind-load Engineering Summary, calculations and any details required

GENERAL REQUIREMENTS		YES	NO	N/A
8	Plans or specifications must show compliance with FBCR Chapter 3	✓		
9	Basic wind speed (3-second gust), miles per hour	✓		
10	(Wind exposure – if more than one wind exposure is used, the wind exposure and applicable wind direction shall be indicated)	✓		
11	Wind importance factor and nature of occupancy	✓		
12	The applicable internal pressure coefficient, Components and Cladding	✓		
13	The design wind pressure in terms of psf (kN/m ²), to be used for the design of exterior component, cladding materials not specifically designed by the registered design professional.			

Elevations Drawing including:

14	All side views of the structure	✓		
15	Roof pitch	✓		
16	Overhang dimensions and detail with attic ventilation	✓		
17	Location, size and height above roof of chimneys			
18	Location and size of skylights with Florida Product Approval	✓		
18	Number of stories	✓		
20A	Building height from the established grade to the roofs highest peak			

Floor Plan including:

20	Dimensioned area plan showing rooms, attached garage, breeze ways, covered porches, deck, balconies	✓		
21	Raised floor surfaces located more than 30 inches above the floor or grade	✓		
22	All exterior and interior shear walls indicated	✓		
23	Shear wall opening shown (Windows, Doors and Garage doors)	✓		
24	Emergency escape and rescue opening shown in each bedroom (net clear opening shown)	✓		
25	Safety glazing of glass where needed			
26	Fireplaces types (gas appliance) (vented or non-vented) or wood burning with Hearth (see chapter 10 of FBCR)			
27	Stairs with dimensions (width, tread and riser and total run) details of guardrails, Handrails (see FBCR SECTION 311)	✓		
28	Identify accessibility of bathroom (see FBCR SECTION 322)			

All materials placed within opening or onto/into exterior walls, soffits or roofs shall have Florida product approval number and mfg. installation information submitted with the (see Florida product approval form)

GENERAL REQUIREMENTS
APPLICANT: PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTING

Plans to include:
 Foundation
 Slab
 Walls
 Roof
 Applicable

FBCR 403: Foundation Plans

		YES	NO	N/A
29	Location of all load-bearing walls footings indicated as standard, monolithic, dimensions, size and type of reinforcing.	✓		
30	All posts and/or column footing including size and reinforcing	✓		
31	Any special support required by soil analysis such as piling.	✓		
32	Assumed load-bearing value of soil _____ Pound Per Square Foot	✓		
33	Location of horizontal and vertical steel, for foundation or walls (include # size and type)			

FBCR 506: CONCRETE SLAB ON GRADE

34	Show Vapor retarder (6mil. Polyethylene with joints lapped 6 inches and sealed)	✓		
35	Show control joints, synthetic fiber reinforcement or welded fire fabric reinforcement and Supports	✓		

FBCR 320: PROTECTION AGAINST TERMITES

36	Indicate on the foundation plan if soil treatment is used for subterranean termite prevention or submit other approved termite protection methods. Protection shall be provided by registered termiticides	✓		
----	---	---	--	--

FBCR 606: Masonry Walls and Stem walls (load bearing & shear Walls)

37	Show all materials making up walls, wall height, and Block size, mortar type			
38	Show all Lintel sizes, type, spans and tie-beam sizes and spacing of reinforcement			

Metal frame shear wall and roof systems shall be designed, signed and sealed by Florida Prof. Engineer or Architect

Floor Framing System: First and/or second story

39	Floor truss package shall including layout and details, signed and sealed by Florida Registered Professional Engineer	✓		
40	Show conventional floor joist type, size, span, spacing and attachment to load bearing walls, stem walls and/or piers	✓		
41	Girder type, size and spacing to load bearing walls, stem wall and/or piers	✓		
42	Attachment of joist to girder	✓		
43	Wind load requirements where applicable	✓		
44	Show required under-floor crawl space	✓		
45	Show required amount of ventilation opening for under-floor spaces	✓		
46	Show required covering of ventilation opening	✓		
47	Show the required access opening to access to under-floor spaces	✓		
	Show the sub-floor structural panel sheathing type, thickness and fastener schedule on the edges &	✓		

48	intermediate of the areas structural panel sheathing			
49	Show Draftstopping, Fire caulking and Fire blocking			
50	Show fireproofing requirements for garages attached to living spaces, per FBCR section 309			
51	Provide live and dead load rating of floor framing systems (psf).			

FBCR CHAPTER 6 WOOD WALL FRAMING CONSTRUCTION

GENERAL REQUIREMENTS		YES	NO	N/A
52 Stud type, grade, size, wall height and oc spacing for all load bearing or shear walls		✓		
53 Fastener schedule for structural members per table FBCR 602.3 are to be shown		✓		
54 Show wood structural panel's sheathing attachment to studs, joist, trusses, rafters and structural members, showing fastener schedule attachment on the edges & intermediate of the areas structural panel sheathing				
55 Show all required connectors with a max uplift rating and required number of connectors and oc spacing for continuous connection of structural walls to foundation and roof trusses or rafter systems		✓		
56 Show sizes, type, span lengths and required number of support jack studs, king studs for shear wall opening and girder or header per FBCR Table 502.5 (1)		✓		
57 Indicate where pressure treated wood will be placed				
58 Show all wall structural panel sheathing, grade, thickness and show fastener schedule for structural panel sheathing edges & intermediate areas				
59 A detail showing gable truss bracing, wall balloon framing details or/ and wall hinge bracing detail		✓		

FBCR : ROOF SYSTEMS:

60	Truss design drawing shall meet section FBCR 802.10 Wood trusses	✓		
61	Include a layout and truss details, signed and sealed by Florida Professional Engineer	✓		
62	Show types of connector's assemblies' and resistance uplift rating for all trusses and rafters	✓		
63	Show gable ends with rake beams showing reinforcement or gable truss and wall bracing details	✓		
64	Provide dead load rating of trusses			

FBCR 802:Conventional Roof Framing Layout

65	Rafter and ridge beams sizes, span, species and spacing			
66	Connectors to wall assemblies' include assemblies' resistance to uplift rating			
67	Valley framing and support details			
68	Provide dead load rating of rafter system			

FBCR Table 602,3(2) & FBCR 803 ROOF SHEATHING

69	Include all materials which will make up the roof decking, identification of structural panel sheathing, grade, thickness	✓		
70	Show fastener Size and schedule for structural panel sheathing on the edges & intermediate areas	✓		

FBCR ROOF ASSEMBLIES FRC Chapter 9

71	Include all materials which will make up the roof assemblies covering	<input checked="" type="checkbox"/>		
72	Submit Florida Product Approval numbers for each component of the roof assemblies covering	<input checked="" type="checkbox"/>		

FBCR Chapter 11 Energy Efficiency Code for residential building

Residential construction shall comply with this code by using the following compliance methods in the FBCR chapter 11 Residential buildings compliance methods. Two of the required forms are to be submitted, showing dimensions condition area equal to the total condition living space area

GENERAL REQUIREMENTS		YES	NO	N/A
73	Show the insulation R value for the following areas of the structure	<input checked="" type="checkbox"/>		
74	Attic space	<input checked="" type="checkbox"/>		
75	Exterior wall cavity	<input checked="" type="checkbox"/>		
76	Crawl space	<input checked="" type="checkbox"/>		

HVAC information

77	Submit two copies of a Manual J sizing equipment or equivalent computation study	<input checked="" type="checkbox"/>		
78	Exhaust fans locations in bathrooms	<input checked="" type="checkbox"/>		
79	Show clothes dryer route and total run of exhaust duct	<input checked="" type="checkbox"/>		

Plumbing Fixture layout shown

80	All fixtures waste water lines shall be shown on the foundation plan	<input checked="" type="checkbox"/>		
81	Show the location of water heater	<input checked="" type="checkbox"/>		

Private Potable Water

82	Pump motor horse power			
83	Reservoir pressure tank gallon capacity			
84	Rating of cycle stop valve if used			

Electrical layout shown including


85	Switches, outlets/receptacles, lighting and all required GFCI outlets identified	<input checked="" type="checkbox"/>		
86	Ceiling fans	<input checked="" type="checkbox"/>		
87	Smoke detectors & Carbon dioxide detectors	<input checked="" type="checkbox"/>		
88	Service panel, sub-panel, location(s) and total ampere ratings	<input checked="" type="checkbox"/>		
89	On the electrical plans identify the electrical service overcurrent protection device for the main electrical service. This device shall be installed on the exterior of structures to serve as a disconnecting means for the utility company electrical service. Conductors used from the exterior disconnecting means to a panel or sub panel shall have four-wire conductors, of which one conductor shall be used as an equipment ground. Indicate if the utility company service entrance cable will be of the overhead or underground type.	<input checked="" type="checkbox"/>		

90	Appliances and HVAC equipment and disconnects			
91	Arc Fault Circuits (AFCI) in bedrooms			

Disclosure Statement for Owner Builders If you as the applicant will be acting as an owner/builder under section 489.103(7) of the Florida Statutes, submit the required owner builder disclosure statement form.

Notice Of Commencement

A notice of commencement form recorded in the Columbia County Clerk Office is required to be filed with the building department Before Any Inspections can be preformed.

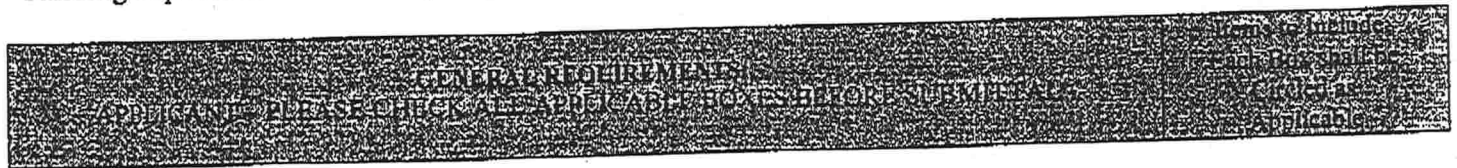

THE FOLLOWING ITEMS MUST BE SUBMITTED WITH BUILDING PLANS

		YES	NO	N/A
92	Building Permit Application A current Building Permit Application form is to be completed and submitted for all residential projects	✓		
93	Parcel Number The parcel number (Tax ID number) from the Property Appraiser (386) 758-1084 is required. A copy of property deed is also requested	✓		
94	Environmental Health Permit or Sewer Tap Approval A copy of a approved Columbia County Environmental Health (386) 758-1058			
95	City of Lake City A permit showing an approved waste water sewer tap			
96	Toilet facilities shall be provided for all construction sites			
97	Town of Fort White (386) 497-2321 If the parcel in the application for building permit is within the Corporate city limits of Fort White an approval land use development letter issued by the Town of Fort is required to be submitted with the application for a building permit.			
98	Flood Information: All projects within the Floodway of the Suwannee or Santa Fe Rivers shall require permitting through the Suwannee River Water Management District, before submitting a application to this office. Any project located within a flood zone where the base flood elevation (100 year flood) has been established shall meet the requirements of Section 8.5.2 of the Columbia County Land Development Regulations. Any project located within a flood zone where the base flood elevation has not been established (Zone A) shall meet the requirements of Section 8.5.3 of the Columbia County Land Development Regulations			
99	CERTIFIED FINISHED FLOOR ELEVATIONS will be required on any project where the base flood elevation (100 year flood) has been established			
100	A development permit will also be required. Development permit cost is \$50.00			
101	Driveway Connection: If the property does not have an existing access to a public road, then an application for a culvert permit (\$25.00) must be made. If the applicant feels that a culvert is not needed, they may apply for a culvert waiver (\$50.00). All culvert waivers are sent to the Columbia County Public Works Department for approval or denial.			
102	911 Address: If the project is located in an area where a 911 address has not been issued, then application for a 911 address must be applied for and received through the Columbia County Emergency Management Office of 911 Addressing Department (386) 758-1125	✓		

Residential System Sizing Calculation

Summary

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title:
1009005 Adam'sFramingConnerLinda


9/27/2010

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(54gr.)			
Winter design temperature(MJ8 99%)	33 F	Summer design temperature(MJ8 99%)	92 F
Winter setpoint	70 F	Summer setpoint	75 F
Winter temperature difference	37 F	Summer temperature difference	17 F
Total heating load calculation	49248 Btuh	Total cooling load calculation	52256 Btuh
Submitted heating capacity	% of calc Btuh	Submitted cooling capacity	% of calc Btuh
Total (Electric Heat Pump)	125.9 62000	Sensible (SHR = 0.75)	109.1 46500
Heat Pump + Auxiliary(0.0kW)	125.9 62000	Latent	161.1 15500
		Total (Electric Heat Pump)	118.6 62000

WINTER CALCULATIONS

Winter Heating Load (for 2886 sqft)


Load component		Load	
Window total	291 sqft	7214	Btuh
Wall total	2583 sqft	6864	Btuh
Door total	110 sqft	1628	Btuh
Ceiling total	3030 sqft	3570	Btuh
Floor total	2886 sqft	14473	Btuh
Infiltration	216 cfm	8768	Btuh
Duct loss		6731	Btuh
Subtotal		49248	Btuh
Ventilation	0 cfm	0	Btuh
TOTAL HEAT LOSS		49248	Btuh

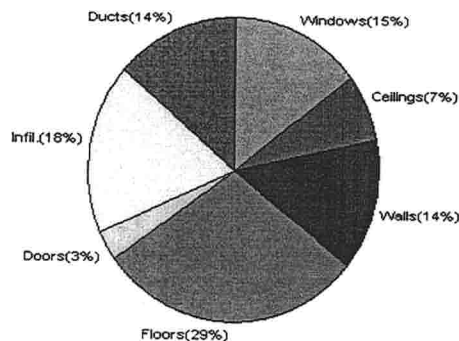

SUMMER CALCULATIONS

Summer Cooling Load (for 2886 sqft)

Load component		Load	
Window total	291 sqft	14790	Btuh
Wall total	2583 sqft	2733	Btuh
Door total	110 sqft	1232	Btuh
Ceiling total	3030 sqft	5018	Btuh
Floor total		0	Btuh
Infiltration	173 cfm	3223	Btuh
Interpal gain		7640	Btuh
Duct gain		7998	Btuh
Sens. Ventilation	0 cfm	0	Btuh
Blower Load		0	Btuh
Total sensible gain		42634	Btuh
Latent gain(ducts)		1694	Btuh
Latent gain(infiltration)		6328	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		1600	Btuh
Total latent gain		9623	Btuh
TOTAL HEAT GAIN		52256	Btuh

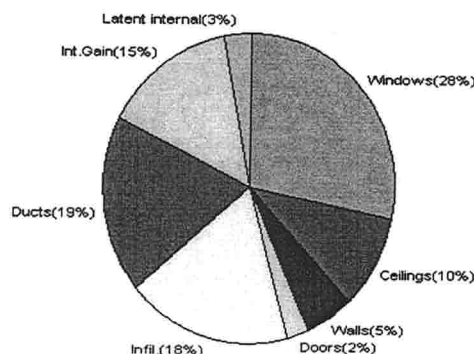

8th Edition

EnergyGauge® System Sizing

PREPARED BY:

DATE: 9/27/10 G.M. B. Conner

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title:
1009005 Adam's Framing Conner Linda
Building Type: User

9/27/2010

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 37.0 F (MJ8 99%)
This calculation is for Worst Case. The house has been rotated 315 degrees.

Component Loads for Whole House

Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	2, Low-E	Metal	0.67	NW	9.0		24.8	223 Btuh
2	2, Low-E	Metal	0.67	NE	72.0		24.8	1785 Btuh
3	2, Low-E	Metal	0.67	NE	18.0		24.8	446 Btuh
4	2, Low-E	Metal	0.67	NE	18.0		24.8	446 Btuh
5	2, Low-E	Metal	0.67	SE	72.0		24.8	1785 Btuh
6	2, Low-E	Metal	0.67	SW	36.0		24.8	892 Btuh
7	2, Low-E	Metal	0.67	SW	30.0		24.8	744 Btuh
8	2, Low-E	Metal	0.67	SW	36.0		24.8	892 Btuh
Window Total					291.0(sqft)			7214 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Face Br - Wood - Ext		(0.080)	13.0/0.0	598		2.95	1765 Btuh
2	Face Br - Wood - Ext		(0.063)	13.0/0.0	529		2.32	1228 Btuh
3	Face Br - Wood - Ext		(0.063)	13.0/0.0	399		2.32	925 Btuh
4	Face Br - Wood - Ext		(0.063)	13.0/0.0	545		2.32	1265 Btuh
5	Frame - Wood - Adj		(0.089)	13.0/0.0	512		3.28	1681 Btuh
Wall Total					2583(sqft)			6864 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Insulated - Exterior, n		(0.400)		20		14.8	296 Btuh
2	Insulated - Exterior, n		(0.400)		20		14.8	296 Btuh
3	Insulated - Exterior, n		(0.400)		20		14.8	296 Btuh
4	Insulated - Exterior, n		(0.400)		10		14.8	148 Btuh
5	Insulated - Garage, n		(0.400)		20		14.8	296 Btuh
6	Insulated - Garage, n		(0.400)		20		14.8	296 Btuh
Door Total					110(sqft)			1628 Btuh
Ceilings	Type/Color/Surface		Ueff.	R-Value	Area	X	HTM=	Load
1	Vented Attic/D/Shing		(0.032)	30.0/0.0	2886		1.2	3401 Btuh
2	Knee Wall/D/Shing		(0.032)	30.0/0.0	144		1.2	170 Btuh
Ceiling Total					3030(sqft)			3570 Btuh
Floors	Type		Ueff.	R-Value	Size	X	HTM=	Load
1	Slab On Grade		(1.180)	0.0	331.5 ft(perim.)		43.7	14473 Btuh
Floor Total					2886 sqft			14473 Btuh
Envelope Subtotal:								33749 Btuh
Infiltration	Type		ACH	Volume(cuft)	Wall Ratio		CFM=	Load
	Natural		0.50	25974	1.00		216.4	8768 Btuh
Duct load	Average sealed, R6.0, Supply(Att), Return(Att) (DLM of 0.158)							6731 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title:
1009005 Adam'sFramingConnerLinda
Building Type: User

9/27/2010

All Zones	Sensible Subtotal All Zones	49248 Btuh
------------------	------------------------------------	-------------------

WHOLE HOUSE TOTALS

Totals for Heating	Subtotal Sensible Heat Loss Ventilation Sensible Heat Loss Total Heat Loss	49248 Btuh 0 Btuh 49248 Btuh
---------------------------	--	------------------------------------

EQUIPMENT

1. Electric Heat Pump	#	62000 Btuh
-----------------------	---	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)
U,- (Window U-Factor)
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title:
1009005 Adam's Framing Conner Linda

9/27/2010

Reference City: Gainesville, FL Temperature Difference: 17.0F (MJ8 99%) Humidity difference: 54gr.
This calculation is for Worst Case. The house has been rotated 315 degrees.

Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load
	Panes	SHGC	U	InSh	IS	Omt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded	
1	2 Low-E	0.61, 0.67	No	No	NW		1.5ft	2.0ft	9.0	0.0	9.0	24	52	471 Btuh
2	2 Low-E	0.61, 0.67	No	No	NE		9.5ft	2.0ft	72.0	0.0	72.0	24	52	3771 Btuh
3	2 Low-E	0.61, 0.67	No	No	NE		1.5ft	2.0ft	18.0	0.0	18.0	24	52	943 Btuh
4	2 Low-E	0.61, 0.67	No	No	NE		0.0ft	0.0ft	18.0	0.0	18.0	24	52	943 Btuh
5	2 Low-E	0.61, 0.67	No	No	SE		1.5ft	2.0ft	72.0	5.6	66.4	24	55	3794 Btuh
6	2 Low-E	0.61, 0.67	No	No	SW		10.0f	2.0ft	36.0	36.0	0.0	24	55	872 Btuh
7	2 Low-E	0.61, 0.67	No	No	SW		10.0f	2.0ft	30.0	30.0	0.0	24	55	727 Btuh
8	2 Low-E	0.61, 0.67	No	No	SW		1.5ft	2.0ft	36.0	2.8	33.2	24	55	1897 Btuh
	Excursion													1372 Btuh
	Window Total								291 (sqft)					14790 Btuh
Walls	Type					U-Value	R-Value	Area(sqft)		HTM		Load		
							Cav/Sheath							
1	Face Brick - Wood - Ext					0.08	13.0/0.0	598.0		1.1		668 Btuh		
2	Face Brick - Wood - Ext					0.06	13.0/0.0	529.0		0.9		465 Btuh		
3	Face Brick - Wood - Ext					0.06	13.0/0.0	398.5		0.9		350 Btuh		
4	Face Brick - Wood - Ext					0.06	13.0/0.0	545.0		0.9		479 Btuh		
5	Frame - Wood - Adj					0.09	13.0/0.0	512.0		1.5		773 Btuh		
	Wall Total								2583 (sqft)			2733 Btuh		
Doors	Type							Area (sqft)		HTM		Load		
1	Insulated - Exterior							20.0		11.2		224 Btuh		
2	Insulated - Exterior							20.0		11.2		224 Btuh		
3	Insulated - Exterior							20.0		11.2		224 Btuh		
4	Insulated - Exterior							10.0		11.2		112 Btuh		
5	Insulated - Garage							20.0		11.2		224 Btuh		
6	Insulated - Garage							20.0		11.2		224 Btuh		
	Door Total								110 (sqft)			1232 Btuh		
Ceilings	Type/Color/Surface					U-Value	R-Value	Area(sqft)		HTM		Load		
1	Vented Attic/DarkShingle					0.032	30.0/0.0	2886.0		1.66		4779 Btuh		
2	Knee Wall/DarkShingle					0.032	30.0/0.0	144.0		1.66		238 Btuh		
	Ceiling Total								3030 (sqft)			5018 Btuh		
Floors	Type						R-Value	Size		HTM		Load		
1	Slab On Grade						0.0	2886 (ft-perimeter)		0.0		0 Btuh		
	Floor Total								2886.0 (sqft)			0 Btuh		
	Envelope Subtotal:													23773 Btuh

Manual J Summer Calculations

Residential Load - Component Details (continued)

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title: Climate:FL_GAINESVILLE_REGIONAL_A
1009005 Adam'sFramingConnerLinda

9/27/2010

Infiltration	Type	ACH	Volume(cuft)	Wall Ratio	CFM=	Load
	SensibleNatural	0.40	25974	2583	216.5	3223 Btuh
Internal gain	Occupants		Btuh/occupant		Appliance	Load
	5	X	230	+	5800	6950 Btuh
	Sensible Envelope Load:					33946 Btuh
Duct load	Average sealed, Supply(R6.0-Attic), Return(R6.0-Attic)			(DGM of 0.231)		7998 Btuh
	Sensible Load All Zones					41944 Btuh

Manual J Summer Calculations

Residential Load - Component Details (continued)

Linda Conner
175 SW Brodrick Dr.
Lake City, FL

Project Title: Climate: FL_GAINESVILLE_REGIONAL_A
1009005 Adam's Framing Conner Linda

9/27/2010

WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	34636 Btuh
	Sensible Duct Load	7998 Btuh
	Total Sensible Zone Loads	42634 Btuh
	Sensible ventilation	0 Btuh
	Blower	0 Btuh
	Total sensible gain	42634 Btuh
	Latent infiltration gain (for 54 gr. humidity difference)	6328 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	1694 Btuh
	Latent occupant gain (8 people @ 200 Btuh per person)	1600 Btuh
	Latent other gain	0 Btuh
	Latent total gain	9623 Btuh
	TOTAL GAIN	52256 Btuh

EQUIPMENT

1. Central Unit	#	62000 Btuh
-----------------	---	------------

*Key: Window types (Panels - Number and type of panes of glass)
 (SHGC - Shading coefficient of glass as SHGC numerical value)
 (U - Window U-Factor)
 (InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))
 - For Blinds: Assume medium color, half closed
 For Draperies: Assume medium weave, half closed
 For Roller shades: Assume translucent, half closed
 (IS - Insect screen: none(N), Full(F) or Half(½))
 (Ornt - compass orientation)



Version 8

Linda Conner

Location:

Project Name:

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and the product approval number(s) on the building components listed below if they will be utilized on the construction project for which you are applying for a building permit on or after April 1, 2004. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. More information about statewide product approval can be obtained at www.floridabuilding.org

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
A. EXTERIOR DOORS			
1. Swinging	Mayfair	entry door	FL 1311
2. Sliding			
3. Sectional			
4. Roll up	General American	garage door	FL 2868
5. Automatic			
6. Other			
B. WINDOWS			
1. Single hung	Danvid	Single hung window	FL 1369
2. Horizontal Slider			
3. Casement			
4. Double Hung			
5. Fixed			
6. Awning			
7. Pass-through			
8. Projected			
9. Mullion			
10. Wind Breaker			
11. Dual Action			
12. Other			
C. PANEL WALL			
1. Siding			
2. Soffits	Ashley Aluminum	Aluminum	FL 406
3. EIFS			
4. Storefronts			
5. Curtain walls			
6. Wall louver			
7. Glass block			
8. Membrane			
9. Greenhouse			
10. Other			
D. ROOFING PRODUCTS			
1. Asphalt Shingles	Tamco	30-year shingles Asphalt	673
2. Underlayments			
3. Roofing Fasteners			
4. Non-structural Metal Rf			
5. Built-Up Roofing			
6. Modified Bitumen			
7. Single Ply Roofing Sys			
8. Roofing Tiles			
9. Roofing Insulation			
10. Waterproofing			
11. Wood shingles /shakes			
12. Roofing Slate			

13. Liquid Applied Roof Sys			
14. Cements-Adhesives - Coatings			
15. Roof Tile Adhesive			
16. Spray Applied Polyurethane Roof			
17. Other			
E. SHUTTERS			
1. Accordion			
2. Bahama			
3. Storm Panels			
4. Colonial			
5. Roll-up			
6. Equipment			
7. Others			
F. SKYLIGHTS			
1. Skylight			
2. Other			
G. STRUCTURAL COMPONENTS			
1. Wood connector/anchor			
2. Truss plates			
3. Engineered lumber			
4. Railing			
5. Coolers-freezers			
6. Concrete Admixtures			
7. Material			
8. Insulation Forms			
9. Plastics			
10. Deck-Roof			
11. Wall			
12. Sheds			
13. Other			
H. NEW EXTERIOR ENVELOPE PRODUCTS			
1.			
2.			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) the performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.

I understand these products may have to be removed if approval cannot be demonstrated during inspection

Linda Roder
Contractor or Contractor's Authorized Agent Signature

Linda Roder 10-21-10
Print Name Date

Location

Permit # (FOR STAFF USE ONLY)

BEARING HEIGHT SCHEDULE

9' 1-1/8"

HANGER SCHEDULE
9 - HTU26

6/12 PITCH
18" O/H

NOTES:

- 1) REFER TO HD 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.
- 2) ALL TRUSSES, INCLUDING TRUSSES UNDER VALLEY FRAMING MUST BE COMPLETELY DECKED OR REFER TO DETAIL VOPS FOR ALTERNATE BRACING REQUIREMENTS.
- 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER
- 4) ALL TRUSSES ARE DESIGNED FOR 2' oc. MAXIMUM SPACINGS, UNLESS OTHERWISE NOTED.
- 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
- 6) 5/42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP
- 7) ALL ROOF TRUSSES HANGERS TO BE SAMPSON HTU26 UNLESS OTHERWISE NOTED. ALL FLOOR TRUSSES HANGERS TO BE SAMPSON TH4422 UNLESS OTHERWISE NOTED.
- 8) BEAM/HEADER/INTEL (HD) TO BE FURNISHED BY BUILDER

SHOP DRAWING APPROVAL

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOPS. ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS, REVISIONS AND APPROVAL OF THIS LAYOUT MUST BE REVIEWED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO MAKE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Revised Drawing Date: _____

Approved By: _____ Date: _____



Bunnell

PHONE: 904-437-3349 FAX: 904-437-3984

PHONE: 904-772-6100 FAX: 904-772-1973

Lake City

PHONE: 386-795-6894 FAX: 386-795-7973

Sanford

PHONE: 407-322-0059 FAX: 407-322-5593

BUILDERS

ADAMS CONST.

CONNER RES.

WEEK CUSTOM


DATE: 9-8-10

BY: K.L.H.


SCALE: NTS

344737


STRONG BACK DETAIL SYSTEM-42 OR FLAT TRUSS

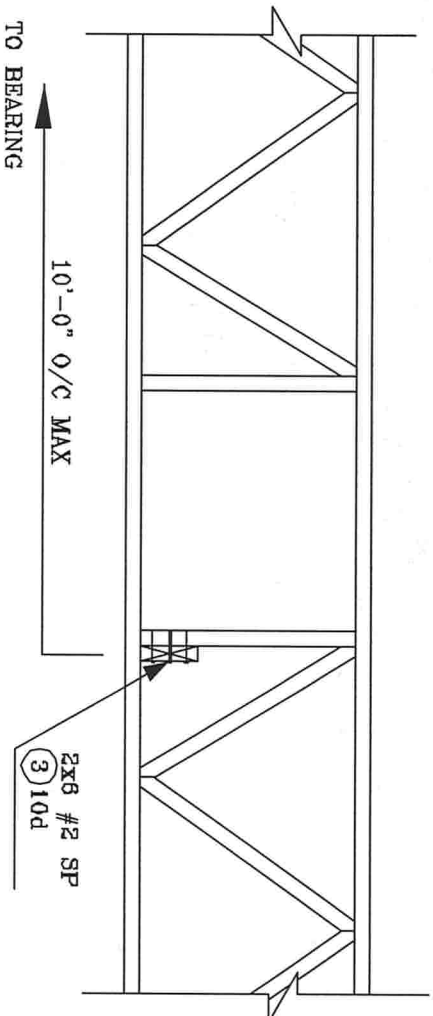

ALTERNATE DETAIL FOR STRONG BACK WITH VERTICAL NOT LINING UP

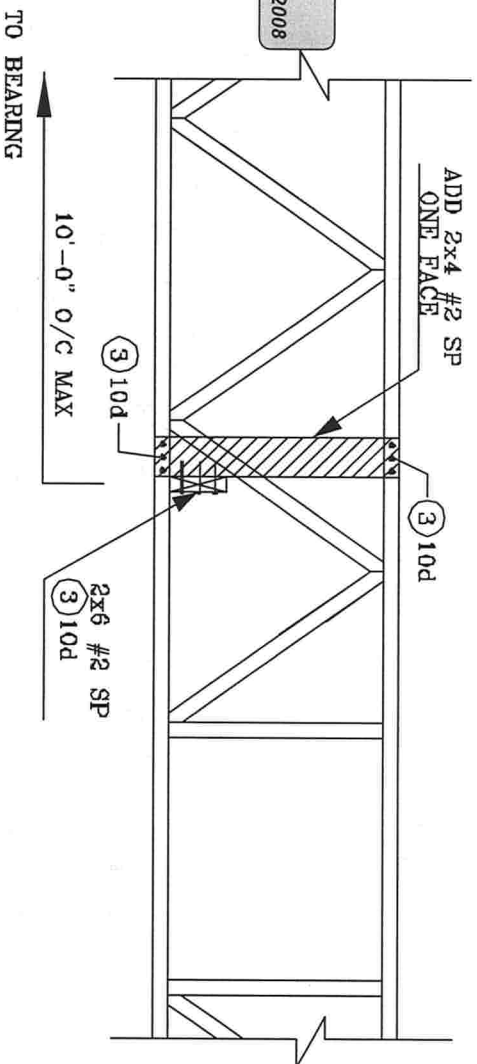

REVIEWED
By Julius Lee at 11:58 am, Jun 11, 2008

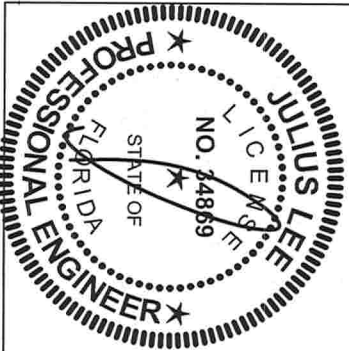

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 SW 45th AVENUE
OCEARAT BEACH, FL 33444-2161

No. 34469
STATE OF FLORIDA

MULTIPLE-MEMBER CONNECTIONS FOR SIDE-LOADED BEAMS

Point Load—Maximum Point Load Applied to Either Outside Member (lbs)


Connector Type	Number of Connectors	Connector Pattern					
		Assembly A	Assembly B	Assembly C	Assembly D	Assembly E	Assembly F
		3 1/4" 2-ply	5 1/4" 3-ply	5 1/4" 2-ply	7" 3-ply	7" 2-ply	7" 4-ply
10d (0.128" x 3") Nail	6	1,110	835	835	740		
	12	2,225	1,670	1,670	1,485		
	18	3,335	2,505	2,505	2,225		
	24	4,450	3,335	3,335	2,965		
SDS Screws 1/4" x 3 1/2" or WS35 1/4" x 6" or WS6 (1)	4	1,915	1,435 (4)	1,435	1,275	1,860 (2)	1,405 (2)
	6	2,870	2,150 (4)	2,150	1,915	2,785 (2)	2,110 (2)
	8	3,825	2,870 (4)	2,870	2,550	3,715 (2)	2,810 (2)
	10	4,780	3,595 (4)	3,595	3,325	4,540 (2)	3,515 (2)
3 3/8" or 5" TrussLok™	4	2,545	1,910 (4)	1,910	1,695	1,925 (3)	1,775 (3)
	6	3,815	2,860 (4)	2,860	2,545	2,890 (3)	2,665 (3)
	8	5,090	3,815 (4)	3,815	3,390	3,855 (3)	3,550 (3)
	10						

- (1) 6" SDS or WS screws can be used with Parallam® PSL and Microllam® LVL, but are not recommended for TimberStrand® LSL.
 (2) 6" long screws required.
 (3) 5" long screws required.
 (4) 3 3/8" and 3 3/4" long screws must be installed on both sides.


See General Notes on page 38

Connections


4 or 6 Screw Connection




8 Screw Connection



Nail Connection



Point Load Design Example



First, verify that a 3-ply 1 3/4" x 14" beam is capable of supporting the 3,000 lb point load as well as all other loads applied. The 3,000 lb point load is being transferred to the beam with a face mount hanger. For a 3-ply 1 3/4" assembly, eight 3 3/8" TrussLok™ screws are good for 3,815 lbs with a face mount hanger.

MULTIPLE-MEMBER CONNECTIONS FOR TOP-LOADED BEAMS

1 3/4" Wide Pieces


- Minimum of three rows of 10d (0.128" x 3") nails at 12" on-center.
- Minimum of four rows of 10d (0.128" x 3") nails at 12" on-center for 14" or deeper.
- If using 12d–16d (0.148"–0.162" diameter) nails, the number of nailing rows may be reduced by one.
- Minimum of two rows of SDS, WS, or TrussLok™ screws at 16" on-center. Use 3 3/8" minimum length with two or three plies; 5" minimum for 4-ply members. 6" SDS and WS screws are not recommended for use with TimberStrand® LSL. For 3- or 4-ply members, connectors must be installed

on both sides. Stagger fasteners on opposite side of beam by 1/2 of the required connector spacing.

- Load must be applied evenly across entire beam width. Otherwise, use connections for side-loaded beams.

3 1/2" Wide Pieces

- Minimum of two rows of SDS, WS, or TrussLok™ screws, 5" minimum length, at 16" on-center. 6" SDS and WS screws are not recommended for use with TimberStrand® LSL. Connectors must be installed on both sides. Stagger fasteners on opposite side of beam by 1/2 of the required connector spacing.

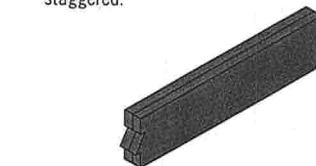

Multiple pieces can be nailed or bolted together to form a header or beam of the required size, up to a maximum width of 7"

Julius Lee

RE: 344737 - ADAMS CONST. - CONNER RES.

**1109 Coastal Bay Blvd.
Boynton Beach, FL 33435**

Site Information:

Project Customer: ADAM'S FRAMING Project Name: 344737 Model: CONNOR RES.
Lot/Block: Subdivision:
Address: 175 SW BRODERICK DR.
City: COLUMBIA CTY State: FL

Name Address and License # of Structural Engineer of Record, if there is one, for the building.

Name: ADAM R. PAPKA License #: CBC1253409
Address: P.O. BOX 1921
City: LAKE CITY, State: FL

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2007/TPI2002 Design Program: MiTek 20/20 7.1
Wind Code: ASCE 7-05 Wind Speed: 110 mph Floor Load: N/A psf
Roof Load: 32.0 psf

This package includes 32 individual, dated Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

This document processed per section 16G15-23.003 of the Florida Board of Professionals Rules

In the event of changes from Builder or E.O.R. additional coversheets and drawings may accompany this coversheet. The latest approval dates supersede and replace the previous drawings.


No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I4476642	T01	9/15/010	18	I4476659	T13G	9/15/010
2	I4476643	T01A	9/15/010	19	I4476660	T14	9/15/010
3	I4476644	T01B	9/15/010	20	I4476661	T14G	9/15/010
4	I4476645	T01G	9/15/010	21	I4476662	T15	9/15/010
5	I4476646	T02	9/15/010	22	I4476663	T15G	9/15/010
6	I4476647	T03	9/15/010	23	I4476664	T16	9/15/010
7	I4476648	T04	9/15/010	24	I4476665	T16G	9/15/010
8	I4476649	T05	9/15/010	25	I4476666	T17	9/15/010
9	I4476650	T06G	9/15/010	26	I4476667	T17G	9/15/010
10	I4476651	T07	9/15/010	27	I4476668	T18	9/15/010
11	I4476652	T07G	9/15/010	28	I4476669	T18G	9/15/010
12	I4476653	T08	9/15/010	29	I4476670	T19	9/15/010
13	I4476654	T09	9/15/010	30	I4476671	T20	9/15/010
14	I4476655	T10	9/15/010	31	I4476672	T21	9/15/010
15	I4476656	T11	9/15/010	32	I4476673	V1	9/15/010
16	I4476657	T12	9/15/010				
17	I4476658	T13	9/15/010				

The truss drawing(s) referenced above have been prepared by MiTek Industries, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Lake City).

Truss Design Engineer's Name: Julius Lee


My license renewal date for the state of Florida is February 28, 2011.

NOTE: The seal on these drawings indicate acceptance of professional engineering responsibility solely for the truss components shown. The suitability and use of this component for any particular building is the responsibility of the building designer, per ANSI/TPI-1 Chapter 2.

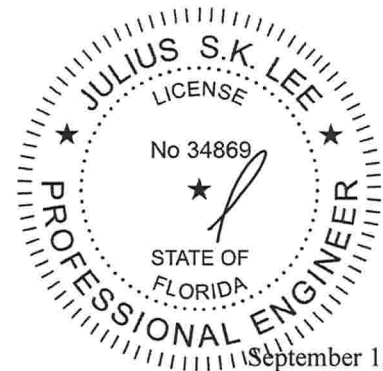

September 15, 2010

Job 344737	Truss T01	Truss Type COMMON	Qty 8	Ply 1	ADAMS CONST. - CONNER RES.	14476642
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:48 2010 Page 1			

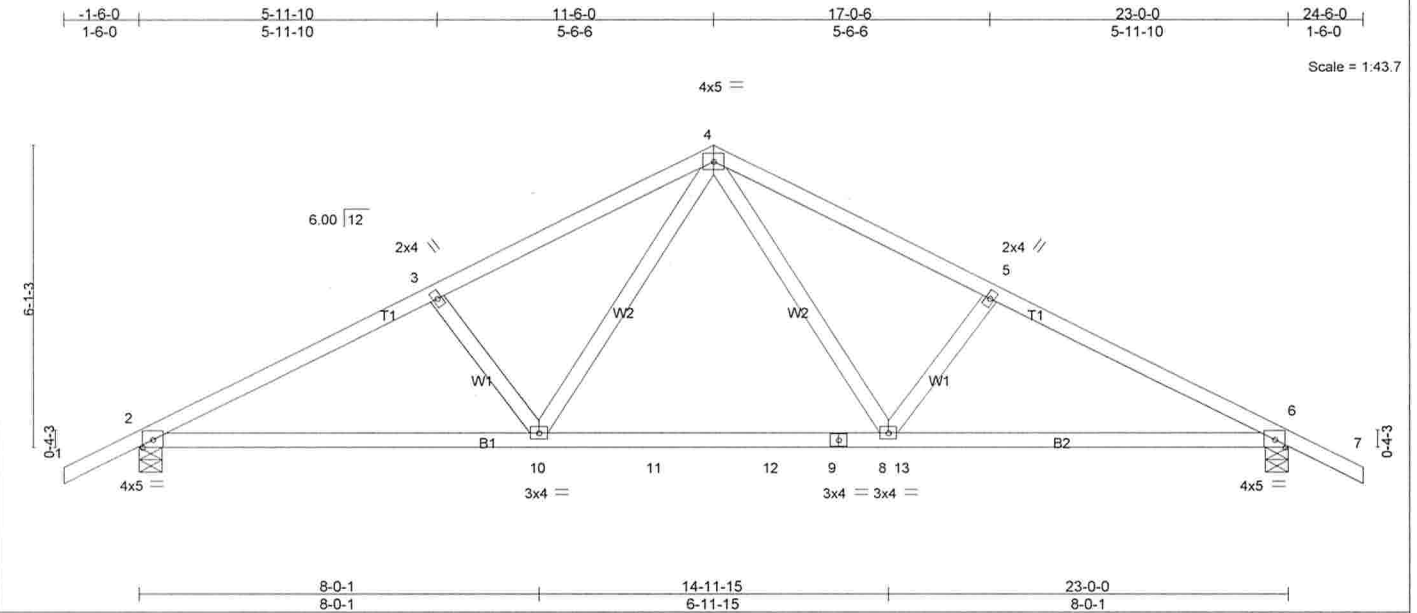

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.40	Vert(LL)	-0.30	8-10	>890	360	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.79	Vert(TL)	-0.43	8-10	>630	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.35	Horz(TL)	0.05	6	n/a	n/a		
BCDL 5.0	Code FBC2007/TPI2002		(Matrix)	Wind(LL)	0.22	8-10	>999	240		
									Weight: 107 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-5-13 oc purlins.
Rigid ceiling directly applied or 6-8-9 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1077/0-5-8, 6=1083/0-5-8
Max Horz 2=119(LC 6)
Max Uplift 2=393(LC 6), 6=395(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1853/1165, 3-4=-1674/1134, 4-5=-1687/1140, 5-6=-1865/1171
BOT CHORD 2-10=-852/1578, 10-11=-429/1088, 11-12=-429/1088, 9-12=-429/1088, 8-9=-429/1088,
8-13=-858/1589, 6-13=-858/1589
WEBS 4-8=-427/699, 5-8=-264/358, 4-10=-416/677, 3-10=-264/358

NOTES (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 393 lb uplift at joint 2 and 395 lb uplift at joint 6.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-7=-54, 2-10=-10, 10-11=-70(F=-60), 11-12=-110(F=-60), 12-13=-70(F=-60), 6-13=-10

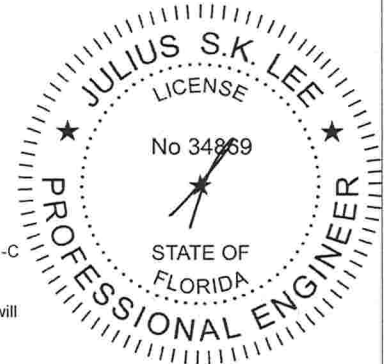

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Oroff Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T01A	Truss Type ATTIC	Qty 13	Ply 1	ADAMS CONST. - CONNER RES.	14476643
---------------	---------------	---------------------	-----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:49 2010 Page 2

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 2-14=-10, 12-14=-110, 10-12=-10, 1-4=-54, 4-5=-64, 5-6=-54, 6-7=-54, 7-8=-124(F=-60), 8-16=-114(F=-60), 11-16=-54, 5-7=-10
 Drag: 4-14=-10, 8-12=-10



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T01B	Truss Type ATTIC	Qty 2	Ply 1	ADAMS CONST. - CONNER RES. Job Reference (optional)	14476644
---------------	---------------	---------------------	----------	----------	--	----------

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 Mitek Industries, Inc. Wed Sep 15 12:47:50 2010 Page 2

15) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

16) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 2-16=-13, 14-16=-137, 12-14=-13, 1-5=-68, 5-6=-80, 6-7=-67, 7-8=-67, 8-9=-140(F=-60), 9-22=-127(F=-60), 13-22=-67, 6-8=-13

Drag: 5-16=-13, 9-14=-13



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE M11-7473 BEFORE USE.

Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job	Truss	Truss Type	Qty	Ply	ADAMS CONST. - CONNER RES.	I4476645
344737	T01G	GABLE	1	1	Job Reference (optional)	

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:50 2010 Page 2

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-8=-99(F=-45), 8-15=-99(F=-45), 2-14=-10




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

7 140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:51 2010 Page 1



MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

LOAD CASE(S) Standard
1) Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 1-8=-10, 8-9=-70(F=-60), 9-10=-110(F=-60), 10-11=-70(F=-60), 5-11=-10

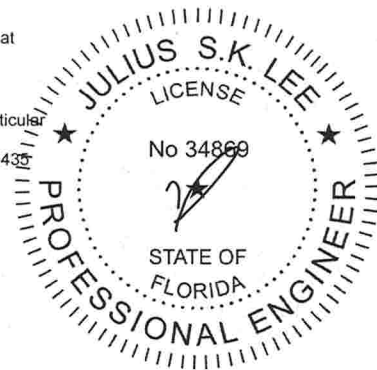

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.
Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for an individual building component.
Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BC311 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T04	Truss Type ATTIC	Qty 5	Ply 1	ADAMS CONST. - CONNER RES. Job Reference (optional)	I4476648
---------------	--------------	---------------------	----------	----------	--	----------

Builders FrstSource, Lake City, FL 32055 7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:52 2010 Page 2

LOAD CASE(S) Standard
Uniform Loads (plf)
Vert: 1-13=-10, 11-13=-110, 9-11=-10, 1-3=-54, 3-4=-64, 4-5=-54, 5-6=-54, 6-7=-124(F=-60), 7-15=-114(F=-60), 10-15=-54, 4-6=-10
Drag: 3-13=-10, 7-11=-10

Job 344737	Truss T06G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476650
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:53 2010 Page 1

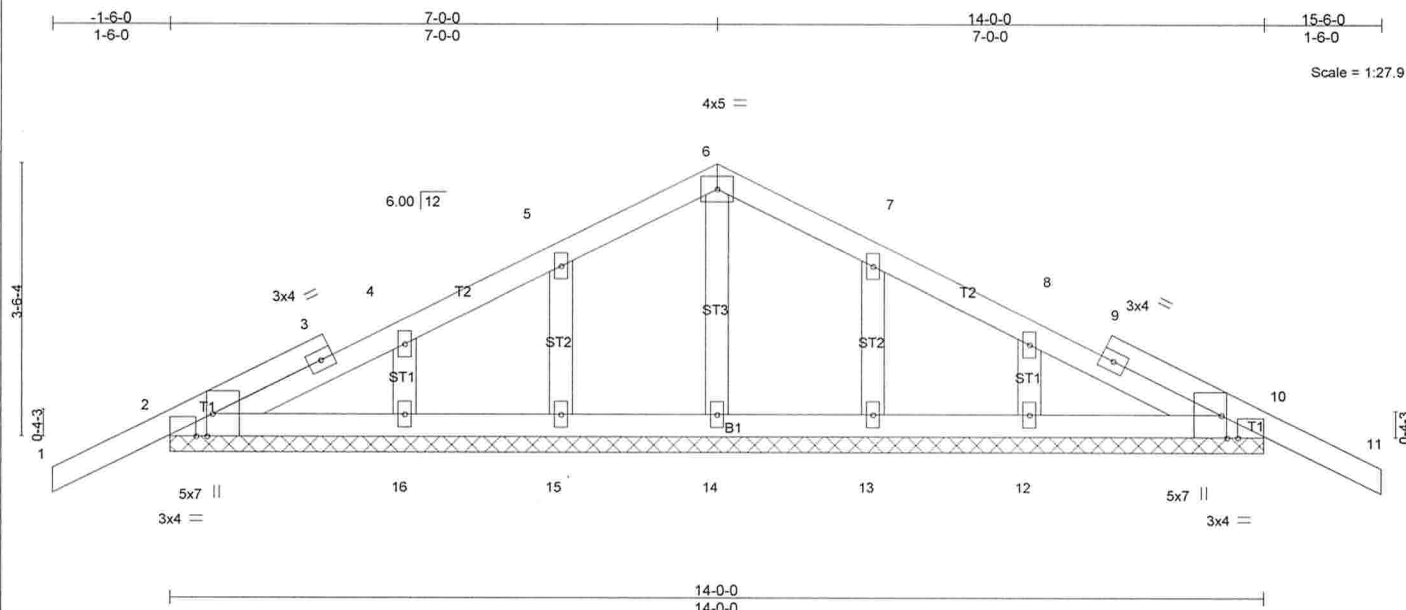


Plate Offsets (X,Y): [2:0-3-8,Edge], [2:0-2-8,Edge], [10:0-3-8,Edge], [10:0-2-8,Edge]

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.28	Vert(LL)	-0.01	11	n/r	120	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.04	Vert(TL)	-0.02	11	n/r	90		
BCLL 0.0	Rep Stress Incr	NO	WB 0.06	Horz(TL)	0.00	10	n/a	n/a		
BCDL 5.0	Code FBC2007/TPI2002		(Matrix)							
									Weight: 67 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

All bearings 14-0-0.
(lb) - Max Horz 2=92(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) 14 except 2=-287(LC 6), 10=-302(LC 7), 15=-192(LC 6),
16=-172(LC 6), 13=-190(LC 7), 12=-177(LC 7)
Max Grav All reactions 250 lb or less at joint(s) 14, 15, 13 except 2=337(LC 1), 10=337(LC 1), 16=256(LC 1),
12=256(LC 1)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=lb) 2=287, 10=302, 15=192, 16=172, 13=190, 12=177.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-99(F=-45), 6-11=-99(F=-45), 2-10=-10

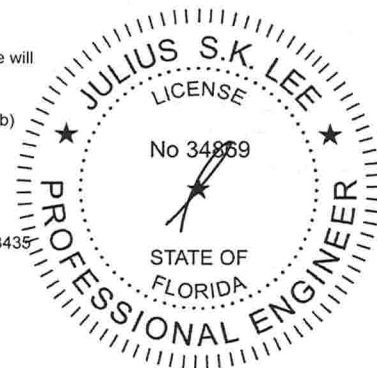

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not Truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T07G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476652
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:54 2010 Page 1

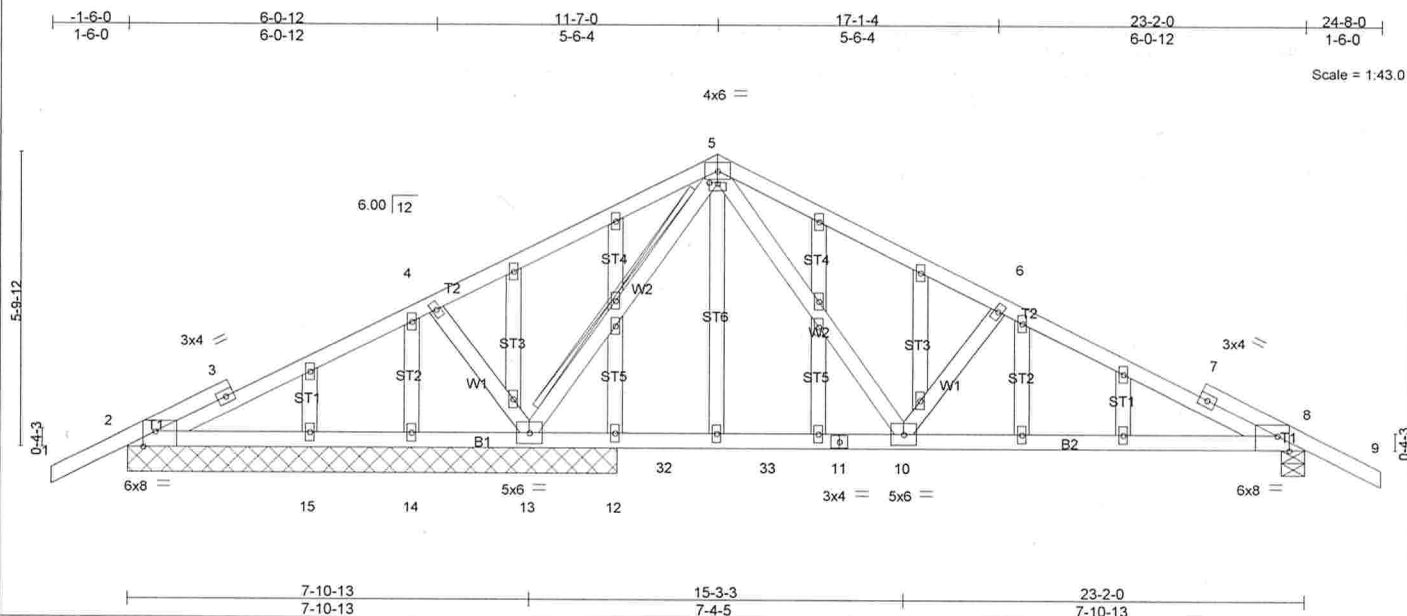


Plate Offsets (X,Y): [2:0-2-13,Edge], [5:0-2-0,0-0-4], [8:0-2-13,Edge]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.58	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.31	Ver(TL) -0.09 8-10 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.39	Ver(TL) -0.17 8-10 >924 240		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.01 8 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.06 8-10 >999 240		
				Weight: 150 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-7-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS T-Brace: 2 X 4 SYP No.3 - 5-13
Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
Brace must cover 90% of web length.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS


All bearings 9-7-8 except (jt=length) 8=0-5-8.
(lb) - Max Horz 2=132(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) 15 except 2=-223(LC 6), 8=-546(LC 7), 13=-903(LC 6)
Max Grav All reactions 250 lb or less at joint(s) 12, 14, 15 except 2=326(LC 10), 8=873(LC 11), 13=1517(LC 1)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-202/304, 3-4=-214/458, 4-5=-323/794, 5-6=-752/508, 6-7=-996/608, 7-8=-1081/615
BOT CHORD 2-15=-289/332, 14-15=-289/332, 13-14=-289/332, 8-10=-397/891
WEBS 5-10=-459/706, 6-10=-596/524, 5-13=-1339/825, 4-13=-570/516

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15 except (jt=lb) 2=223, 8=546, 13=903.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

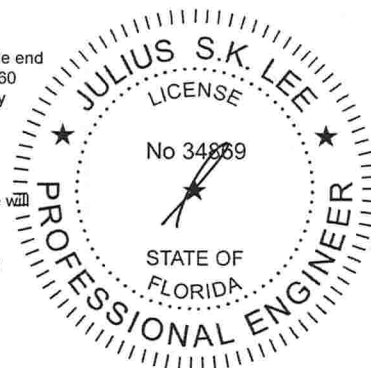

Continued on page 2

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T08	Truss Type SPECIAL	Qty 5	Ply 1	ADAMS CONST. - CONNER RES.	14476653
---------------	--------------	-----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:54 2010 Page 1

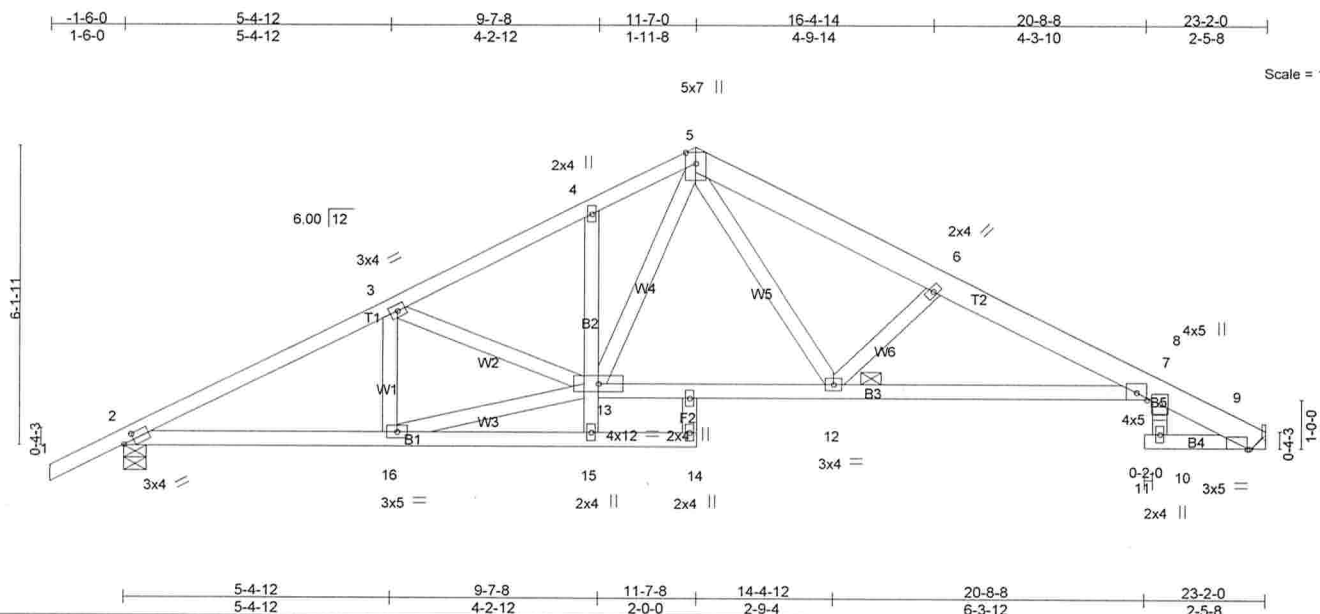

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.79	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.93	Vert(LL) -0.17 7-12 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.34	Vert(TL) -0.35 7-12 >763 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.21 9 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.26 7-12 >999 240		
				Weight: 133 lb	

LUMBER
 TOP CHORD 2 X 4 SYP No.2 *Except*
 T2: 2 X 6 SYP No.1D
 BOT CHORD 2 X 4 SYP No.2 *Except*
 B2,B5: 2 X 4 SYP No.3
 WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-3-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 7-6-10 oc bracing: 2-16.
 6-0-0 oc bracing: 7-13
 10-0-0 oc bracing: 13-15

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


REACTIONS (lb/size) 2=827/0-5-8, 9=726/Mechanical
 Max Horz 2=131(LC 6)
 Max Uplift 2=-333(LC 6), 9=-231(LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1291/908, 3-4=-1238/923, 4-5=-1203/1013, 5-6=-1394/1084, 6-7=-1670/1236,
 8-9=-610/464
 BOT CHORD 2-16=-702/1084, 12-13=-407/859, 7-12=-1058/1572
 WEBS 13-16=-668/1059, 5-13=-403/501, 5-12=-471/599, 6-12=-586/589

NOTES (10-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=333, 9=231.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435
- Use Simpson HTU26 to attach Truss to Carrying member

LOAD CASE(S) Standard

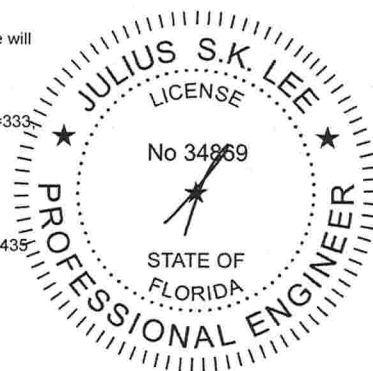

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.


Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T10	Truss Type MONO HIP	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476655
---------------	--------------	------------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:55 2010 Page 1

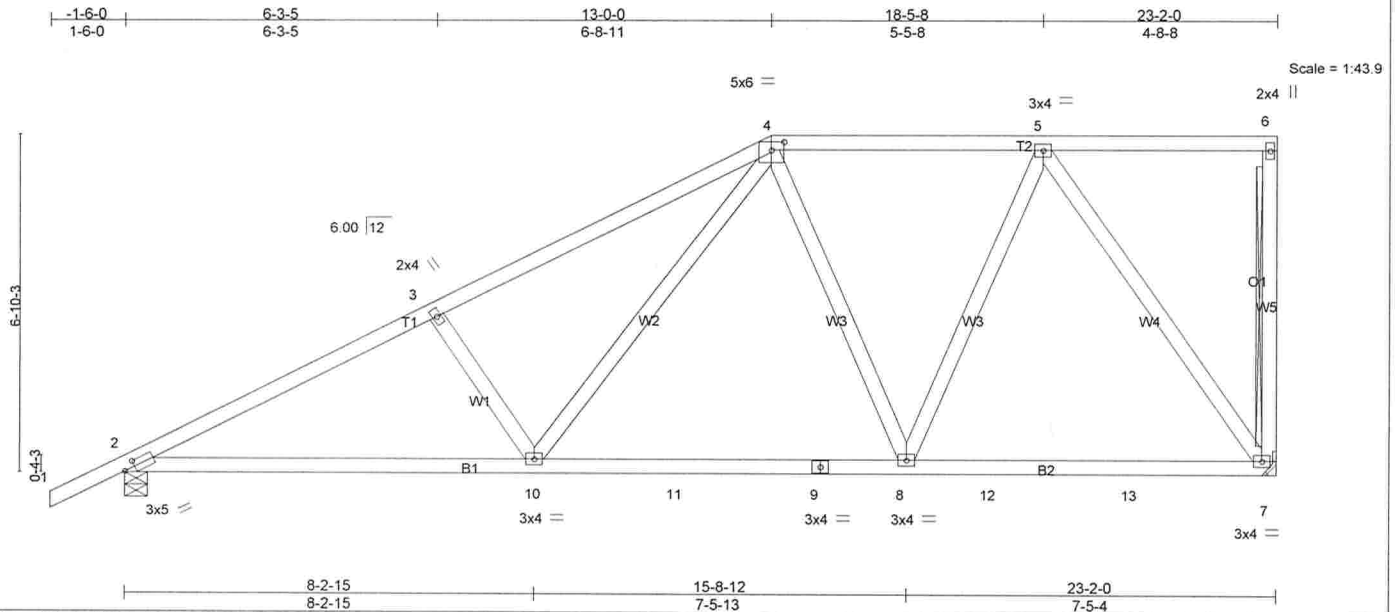

LOADING (psf)	SPACING 2-0-0	CSI	DEFL in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.40	Vert(LL) -0.11 8-10 >999 360	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.38	Vert(TL) -0.20 2-10 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.99	Horz(TL) 0.03 7 n/a n/a		
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)	Wind(LL) 0.07 10 >999 240		
				Weight: 132 lb	


LUMBER	BRACING
TOP CHORD 2 X 4 SYP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-4 oc purlins, except end verticals.
BOT CHORD 2 X 4 SYP No.2	Rigid ceiling directly applied or 6-2-14 oc bracing.
WEBS 2 X 4 SYP No.3	T-Brace: 2 X 4 SYP No.3 - 6-7
	Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
	Brace must cover 90% of web length.
	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 7=880/Mechanical, 2=900/0-5-8
Max Horz 2=310(LC 6)
Max Uplift 7=283(LC 5), 2=325(LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1440/811, 3-4=-1256/790, 4-5=-683/451
BOT CHORD 2-10=-1034/1217, 10-11=-566/757, 9-11=-566/757, 8-9=-566/757, 8-12=-356/509, 12-13=-356/509, 7-13=-356/509
WEBS 3-10=-320/437, 4-10=-389/485, 4-8=-192/298, 5-8=-248/452, 5-7=-876/620

- NOTES** (10-12)
- 1) Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
 - 5) All bearings are assumed to be SYP No.2.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=283, 2=325.
 - 8) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
 - 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
 - 10) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
 - 11) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435
 - 12) Use Simpson HTU26 to attach Truss to Carrying member

LOAD CASE(S) Standard

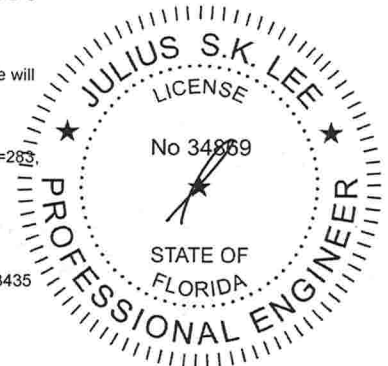

September 15, 2010




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MI-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not Truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D5B-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T12	Truss Type MONO HIP	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476657
---------------	--------------	------------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:55 2010 Page 1

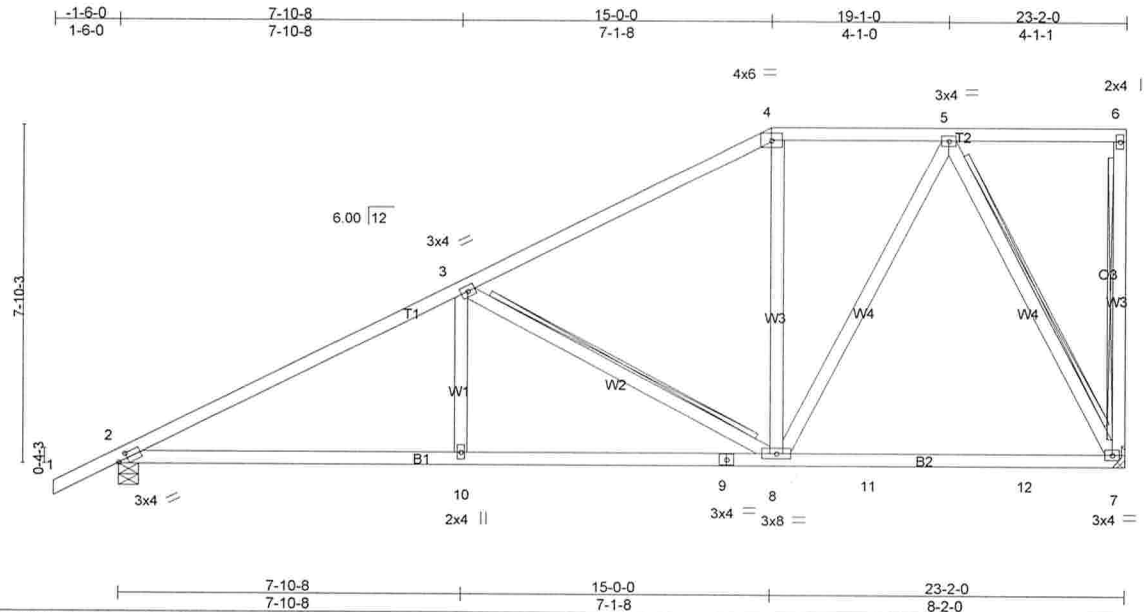

Scale = 1:50.3

Plate Offsets (X,Y): [2:0-2-10,0-1-8]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.46	Vert(LL) -0.18 7-8 >999 360		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.48	Vert(TL) -0.26 7-8 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.03 7 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.09 2-10 >999 240		
				Weight: 138 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-1-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-3-4 oc bracing.
WEBS T-Brace: 2 X 4 SYP No.3 - 6-7, 3-8, 5-7
Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
Brace must cover 90% of web length.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 7=845/Mechanical, 2=851/0-5-8
Max Horz 2=351(LC 6)
Max Uplift 7=278(LC 5), 2=325(LC 6)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1270/708, 3-4=-740/417, 4-5=-573/457
BOT CHORD 2-10=-980/1052, 9-10=-980/1052, 8-9=-980/1052, 8-11=-284/351, 11-12=-284/351, 7-12=-284/351
WEBS 3-8=-547/594, 5-8=-376/479, 5-7=-735/612

NOTES (10-12)

- 1) Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- 5) All bearings are assumed to be SYP No.2.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=278, 2=325.
- 8) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
- 10) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- 11) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435
- 12) Use Simpson HTU26 to attach Truss to Carrying member

LOAD CASE(S) Standard

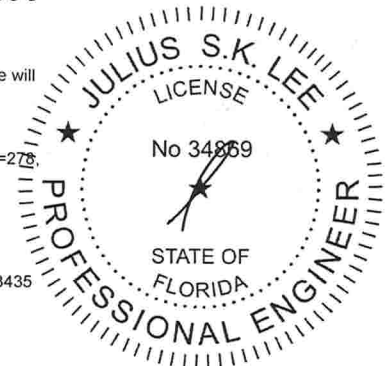

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T13G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	I4476659
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:56 2010 Page 1

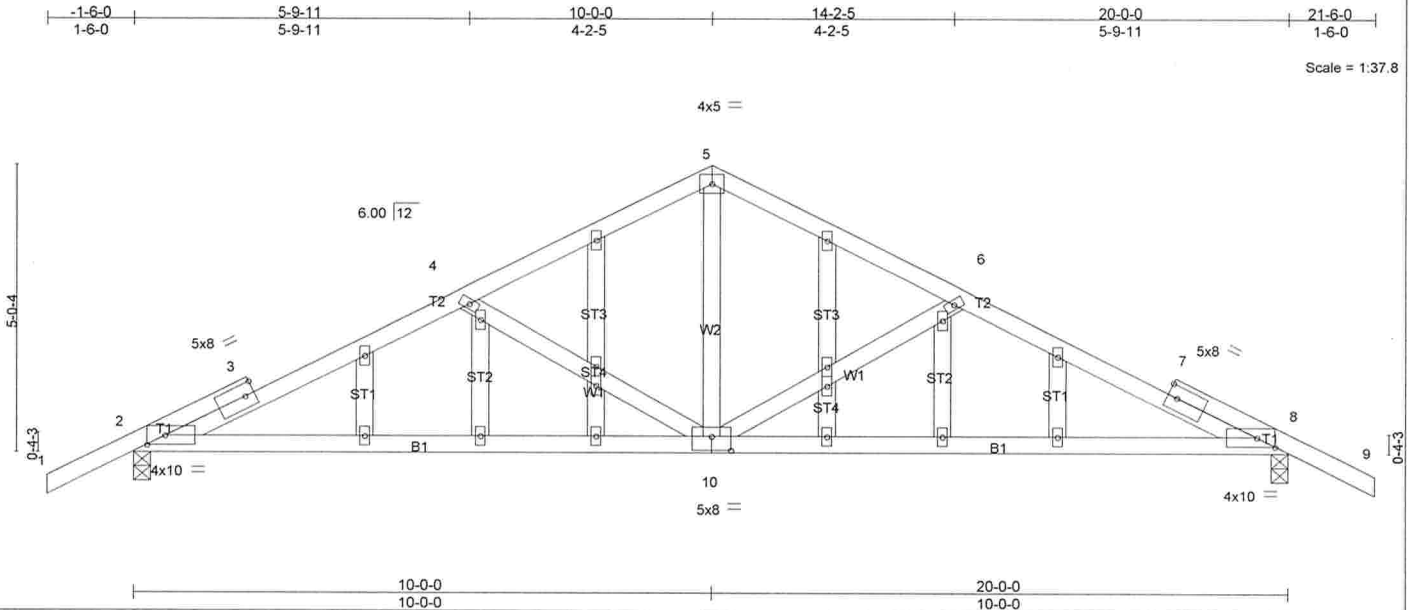


Plate Offsets (X,Y): [2:0-3-12, 0-2-0], [8:0-3-12, 0-2-0], [10:0-4-0, 0-3-0]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.97	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.98	Vert(LL) -0.17 2-10 >999 360		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.73	Vert(TL) -0.35 2-10 >681 240		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) -0.08 8 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.74 2-10 >321 240		
				Weight: 114 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.1D *Except*
T1: 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.1D
WEBS 2 X 4 SYP No.3
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-2-0 oc purlins.
BOT CHORD Rigid ceiling directly applied.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

(lb/size) 2=1237/0-3-8, 8=1237/0-3-8
Max Horz 2=118(LC 6)
Max Uplift 2=1421(LC 6), 8=1421(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1974/3452, 3-4=-1909/3405, 4-5=-1385/2676, 5-6=-1385/2676, 6-7=-1909/3405, 7-8=-1974/3436
BOT CHORD 2-10=-2947/1713, 8-10=-2947/1713
WEBS 5-10=-1872/809, 6-10=-674/1116, 4-10=-674/1116

NOTES (12-13)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=1421, 8=1421.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

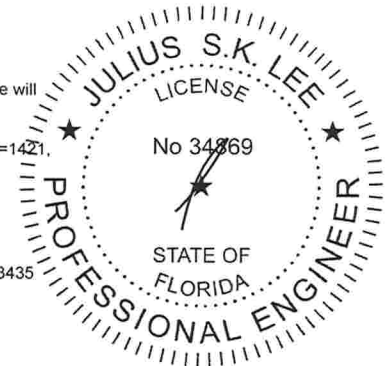

Continued on page 2

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T14	Truss Type COMMON	Qty 3	Ply 1	ADAMS CONST. - CONNER RES.	14476660
---------------	--------------	----------------------	----------	----------	----------------------------	----------


Builders FrstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:56 2010 Page 1



Scale = 1:22.3

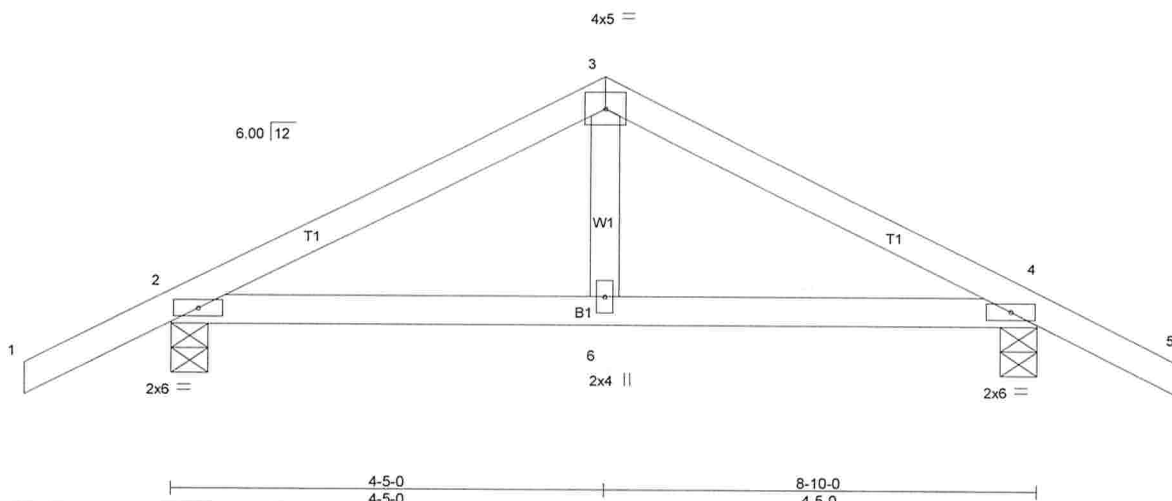

LOADING (psf)	SPACING	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.23	Vert(LL) -0.01	2-6	>999	360		MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.14	Vert(TL) -0.02	2-6	>999	240			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.05	Horz(TL) -0.01	4	n/a	n/a			
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)	Wind(LL) 0.03	2-6	>999	240			
								Weight: 36 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 9-6-4 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=362/0-4-8, 4=362/0-4-8
Max Horz 2=-66(LC 7)
Max Uplift 2=-326(LC 6), 4=-326(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-339/670, 3-4=-339/670
BOT CHORD 2-6=-419/248, 4-6=-419/248
WEBS 3-6=-348/148

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=326, 4=326.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

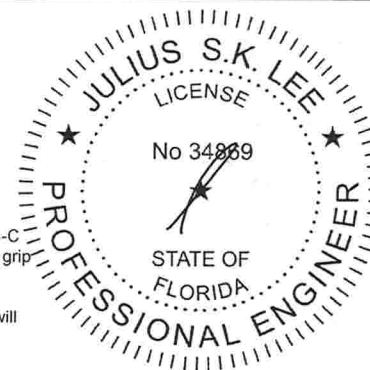

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.


Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Oonofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T15	Truss Type COMMON	Qty 2	Ply 1	ADAMS CONST. - CONNER RES.	14476662
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:57 2010 Page 1

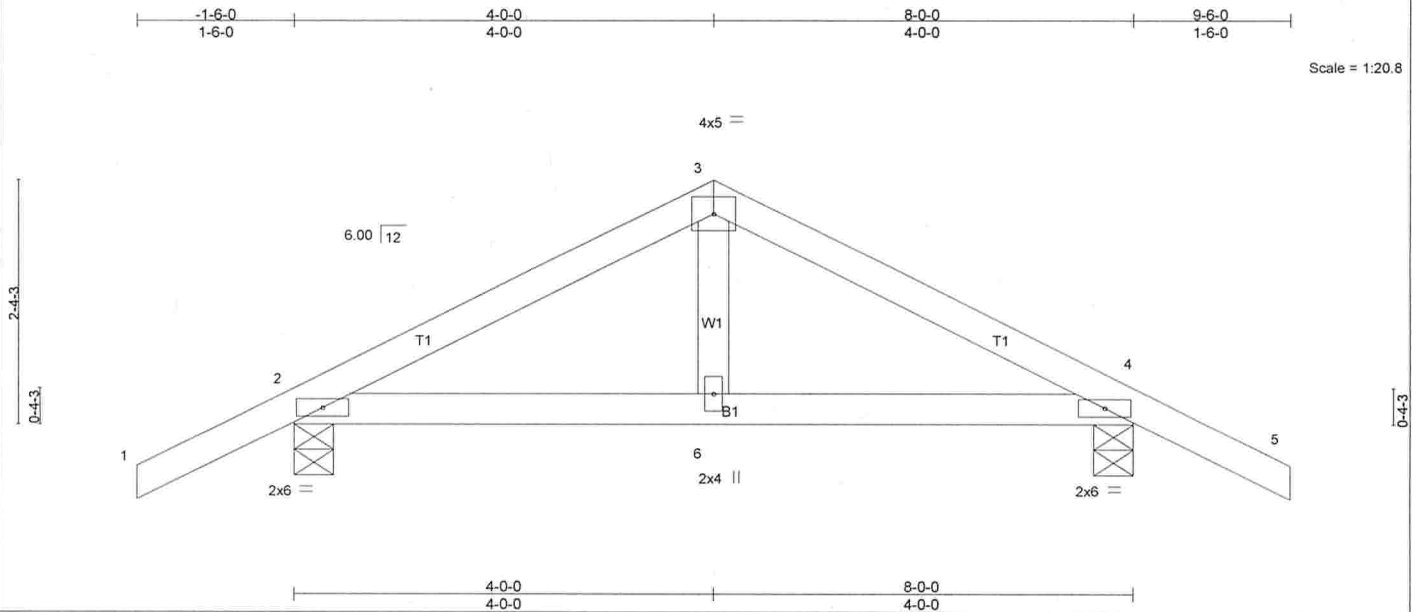

LOADING (psf)	SPACING	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.23	Vert(LL)	-0.01	2-6	>999	360	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.11	Vert(TL)	-0.01	2-6	>999	240		
BCLL 0.0	Rep Stress Incr YES	WB 0.04	Horz(TL)	-0.00	4	n/a	n/a		
BCDL 5.0	Code FBC2007/TP12002	(Matrix)	Wind(LL)	0.02	4-6	>999	240		
								Weight: 33 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=335/0-4-8, 4=335/0-4-8
Max Horz 2=-63(LC 7)
Max Uplift 2=-305(LC 6), 4=-305(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-294/591, 3-4=-294/591
BOT CHORD 2-6=-354/212, 4-6=-354/212
WEBS 3-6=-306/131

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=305, 4=305.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

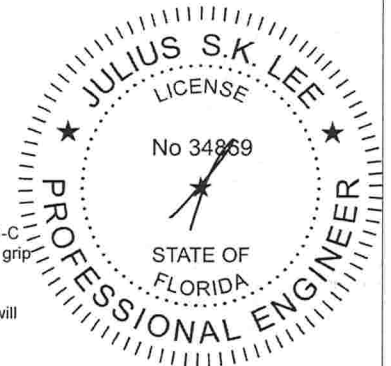

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T16	Truss Type COMMON	Qty 2	Ply 1	ADAMS CONST. - CONNER RES.	14476664
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Job Reference (optional)

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:58 2010 Page 1

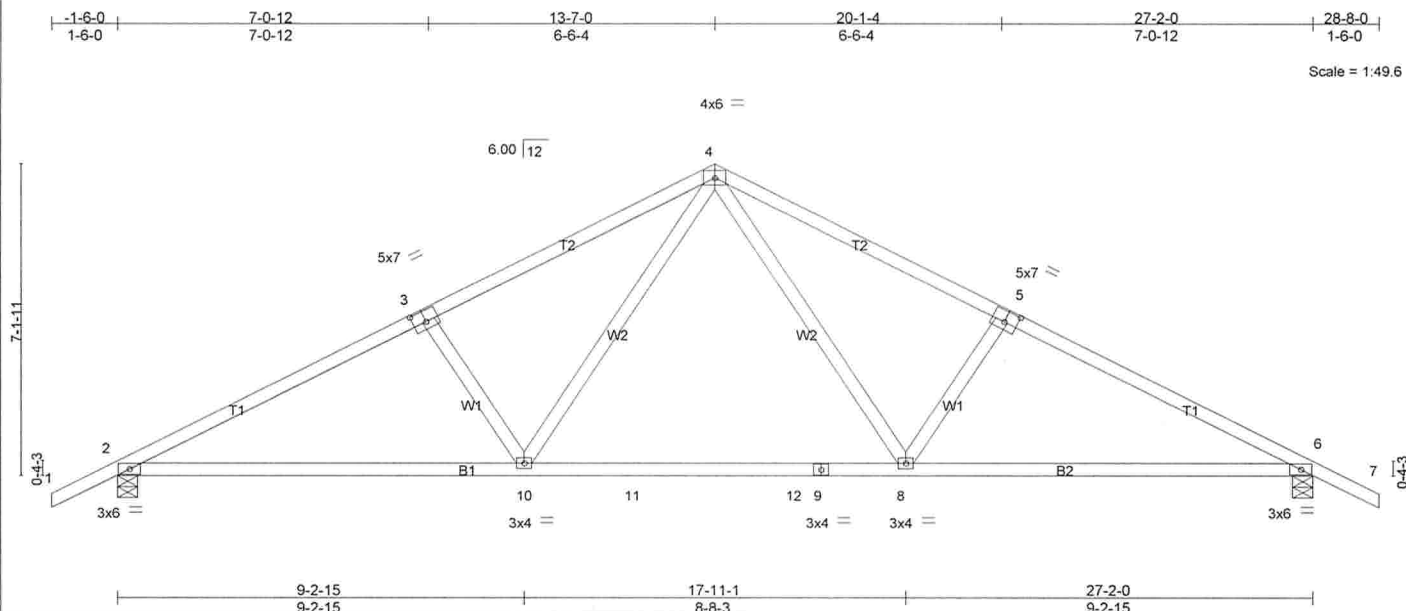


Plate Offsets (X,Y): [3:0-3-8,0-3-0], [5:0-3-8,0-3-0]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.46	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.55	Vert(LL) -0.28 8-10 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.44	Vert(TL) -0.35 8-10 >904 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.06 6 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.10 10 >999 240		
				Weight: 126 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-7-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 7-0-10 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1021/0-5-8, 6=1021/0-5-8
Max Horz 2=135(LC 6)
Max Uplift 2=383(LC 6), 6=383(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1676/1125, 3-4=-1473/1101, 4-5=-1473/1101, 5-6=-1676/1125
BOT CHORD 2-10=-806/1419, 10-11=-355/946, 11-12=-355/946, 9-12=-355/946, 8-9=-355/946,
6-8=-806/1419
WEBS 4-8=-381/558, 5-8=-343/448, 4-10=-381/558, 3-10=-343/448

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=383, 6=383.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435.

LOAD CASE(S) Standard

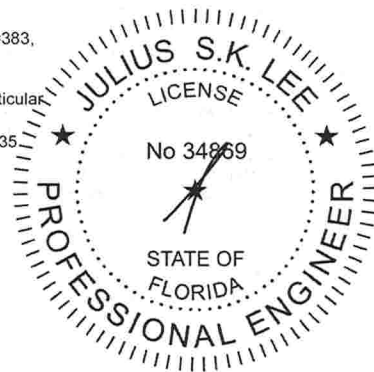

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Oroff Drive, Madison, WI 53719.

Your Company Name

Job	Truss	Truss Type	Qty	Ply	ADAMS CONST. - CONNER RES.	14476665
344737	T16G	GABLE	1	1	Job Reference (optional)	

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:58 2010 Page 2

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-9=-99(F=-45), 9-17=-99(F=-45), 2-16=-10




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

14476667

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:00 2010 Page 1




Weight: 352 lb

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Max Grav All reactions 250 lb or less at joint(s) 13, 14 except 2=1550(LC 1), 12=2974(LC 1), 10=304(LC 11)

13) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

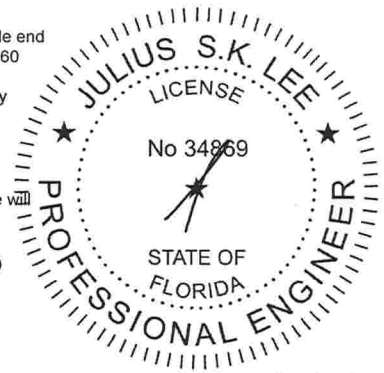

September 15, 2010

Design valid for use only with Miktek connectors. This design is based only upon parameters shown, and is for individual building component. Applicability of design parameters and proper incorporation of connector design is the responsibility of the building design engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D88-89 and BC511 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 344737	Truss T18	Truss Type COMMON	Qty 5	Ply 1	ADAMS CONST. - CONNER RES.	14476668
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:01 2010 Page 1

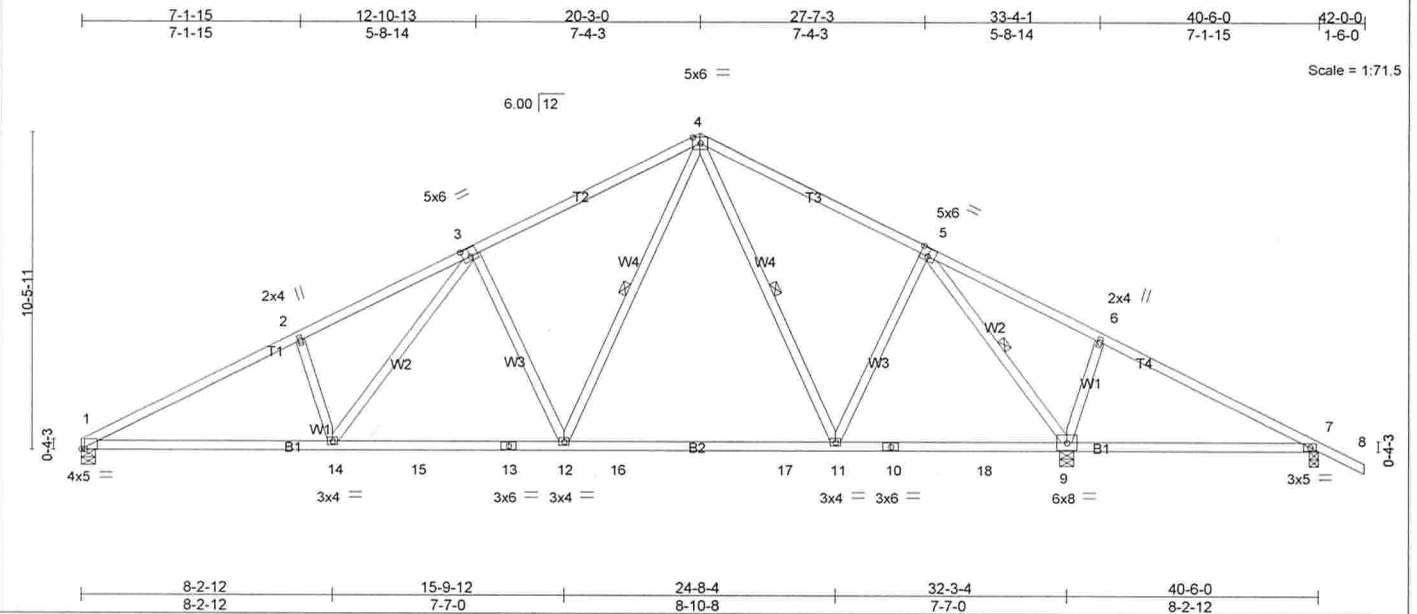


Plate Offsets (X,Y): [1:0-1-4,0-0-2], [3:0-3-0,0-3-4], [5:0-3-0,0-3-4]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.59	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.57	Vert(LL) -0.25 11-12 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.57	Vert(TL) -0.38 11-12 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.06 9 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.35 7-9 >279 240		
				Weight: 216 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-9-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 4-11, 5-9, 4-12

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


REACTIONS (lb/size) 1=1131/0-5-8, 9=1884/0-5-8, 7=97/0-3-8
Max Horz 1=-196(LC 7)
Max Uplift 1=-335(LC 6), 9=-617(LC 7), 7=-259(LC 7)
Max Grav 1=1131(LC 1), 9=1884(LC 1), 7=182(LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2113/1321, 2-3=-1990/1413, 3-4=-1434/1080, 4-5=-961/756, 5-6=-164/582, 6-7=-265/501
BOT CHORD 1-14=-981/1805, 14-15=-610/1433, 13-15=-610/1433, 12-13=-610/1433, 12-16=-110/856, 16-17=-110/856, 11-17=-110/856, 10-11=-39/555, 10-18=-39/555, 9-18=-39/555, 7-9=-364/401
WEBS 5-11=-55/548, 5-9=-1762/989, 6-9=-324/437, 4-12=-585/869, 3-12=-571/636, 3-14=-432/494, 2-14=-288/408

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=335, 9=617, 7=259.
- *Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

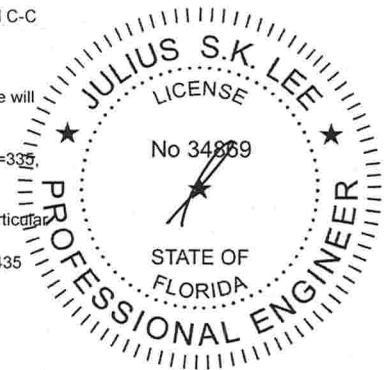

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MI-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Ondrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T18G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES. Job Reference (optional)	14476669
---------------	---------------	---------------------	----------	----------	--	----------

Builders FrstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:02 2010 Page 2

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-44=-54, 4-44=-99(F=-45), 4-5=-126(F=-72), 5-45=-126(F=-72), 10-45=-99(F=-45), 1-46=-10, 16-46=-50, 16-47=-10, 47-48=-50, 13-48=-10, 13-49=-50, 9-49=-10



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T19	Truss Type SPECIAL	Qty 6	Ply 1	ADAMS CONST. - CONNER RES.	14476670
---------------	--------------	-----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:02 2010 Page 2

9) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

10) Truss Design Engineer: Julius Lee, PE; Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Ondrie Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T21	Truss Type COMMON	Qty 1	Ply 2	ADAMS CONST. - CONNER RES.	14476672
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:04 2010 Page 1

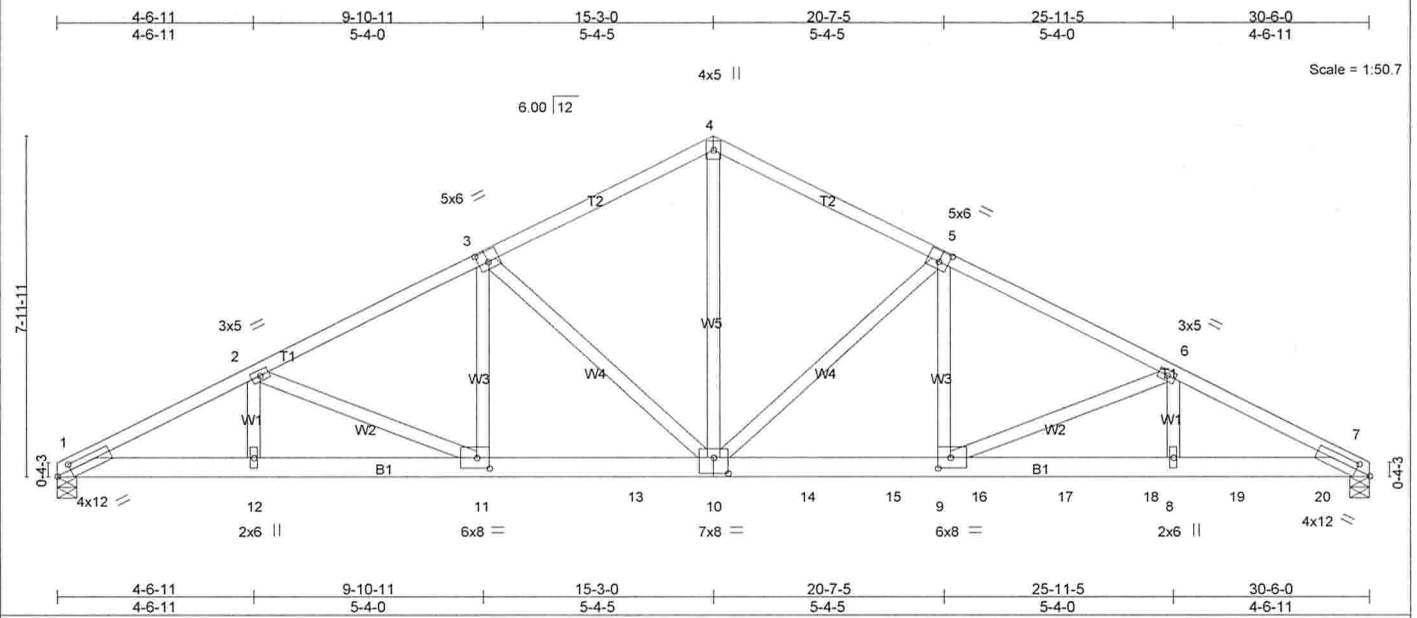


Plate Offsets (X,Y): [1:0-4-2,0-1-12], [3:0-2-12,0-3-0], [5:0-2-12,0-3-0], [7:0-4-2,0-1-12], [9:0-3-8,0-3-0], [10:0-4-0,0-4-8], [11:0-3-8,0-3-0]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.48	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.72	Vert(LL) -0.22 9-10 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.77	Vert(TL) -0.39 9-10 >918 240		
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)	Horz(TL) 0.10 7 n/a n/a		
			Wind(LL) 0.18 9-10 >999 240		
				Weight: 377 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 6 SYP No.1D
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-9-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS


(lb/size) 1=3095/0-5-8, 7=5758/0-5-8
Max Horz 1=-122(LC 3)
Max Uplift 1=-1027(LC 5), 7=-1908(LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-6386/2099, 2-3=-6257/2074, 3-4=-5757/1953, 4-5=-5757/1953, 5-6=-8345/2767, 6-7=-10669/3520
BOT CHORD 1-12=-1931/5632, 11-12=-1815/5538, 10-13=-1815/5538, 10-14=-2317/7390, 14-15=-2317/7390, 9-15=-2317/7390, 9-16=-3081/9449, 16-17=-3081/9449, 17-18=-3081/9449, 8-18=-3081/9449, 8-19=-3081/9449, 19-20=-3081/9449, 7-20=-3081/9449
WEBS 4-10=-1610/4815, 5-10=-3150/1158, 5-9=-973/2996, 6-9=-2205/820, 6-8=-540/1762, 3-10=-622/324, 3-11=-97/342

NOTES (11-12)

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2 X 4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2 X 6 - 2 rows at 0-7-0 oc.
Webs connected as follows: 2 X 4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1027 lb uplift at joint 1 and 1908 lb uplift at joint 7.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 877 lb down and 288 lb up at 13-5-4, 834 lb down and 284 lb up at 15-5-4, 875 lb down and 289 lb up at 17-5-4, 762 lb down and 249 lb up at 19-5-4, 716 lb down and 237 lb up at 21-5-4, 716 lb down and 237 lb up at 23-5-4, 716 lb down and 237 lb up at 25-5-4, and 716 lb down and 237 lb up at 27-5-4, and 716 lb down and 237 lb up at 29-5-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

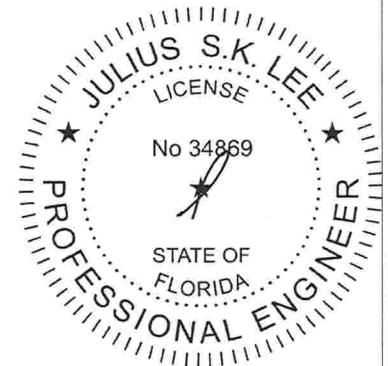

Continued on page 2

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.


Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Oroff Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss V1	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476673
---------------	-------------	---------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:04 2010 Page 1

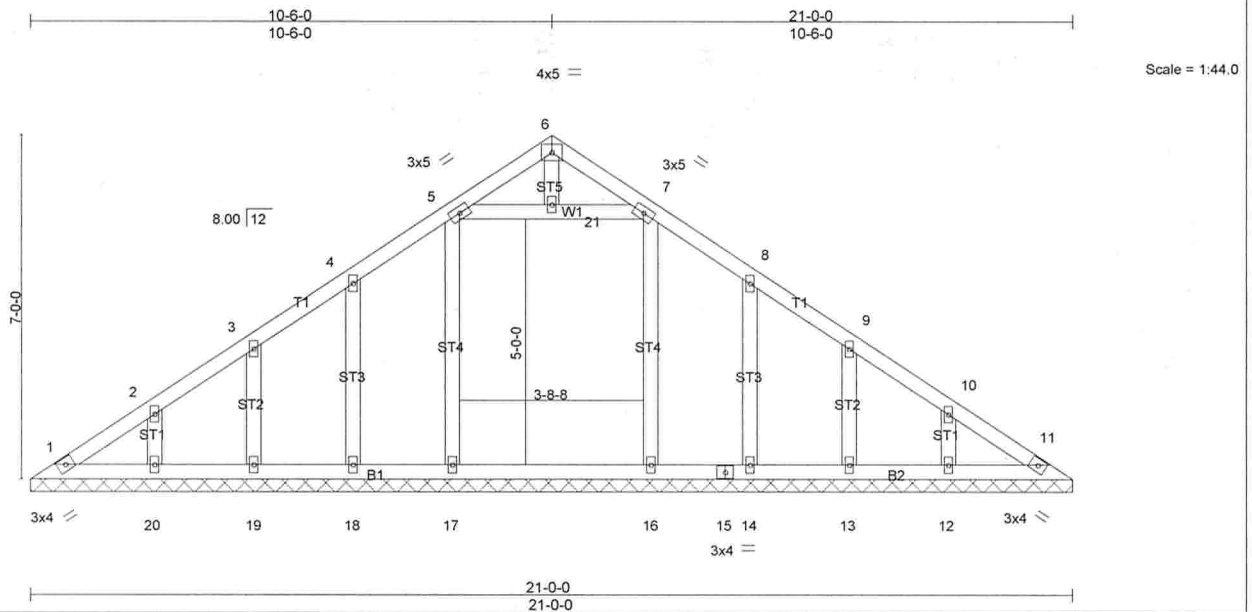

LOADING (psf)	SPACING	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2'-0"	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.12	Vert(TL)	n/a	-	n/a		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.09	Horz(TL)	0.00	11	n/a		
BCDL 5.0	Rep Stress Incr NO	(Matrix)						
	Code FBC2007/TPI2002							
							Weight: 111 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6'-0" oc purlins.
Rigid ceiling directly applied or 10'-0" oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

All bearings 21'-0".
(lb) - Max Horz 1=-292(LC 4)
Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 17, 16 except 18=-148(LC 6), 19=-143(LC 6), 20=-168(LC 6), 14=-147(LC 7), 13=-143(LC 7), 12=-167(LC 7)
Max Grav All reactions 250 lb or less at joint(s) 1, 11, 18, 19, 20, 14, 13, 12 except 17=312(LC 1), 16=312(LC 1)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES (11-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 17, 16 except (jt=lb) 18=148, 19=143, 20=168, 14=147, 13=143, 12=167.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-64(F=-10), 6-11=-64(F=-10), 1-17=-10, 16-17=-50, 11-16=-10

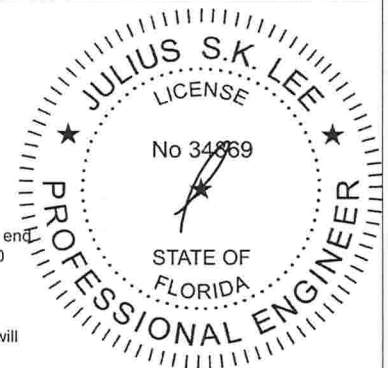

September 15, 2010




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Oroff Drive, Madison, WI 53719.


Your Company Name

Setback 7' or Less

UPLIFT BASED ON 7.2 PSF TOTAL DEAD LOAD. WIND
SPEED=120 "B" MPH. MEAN HGT (of jacks)=28 FT. ENCLOSED. (ASCE 7-02)

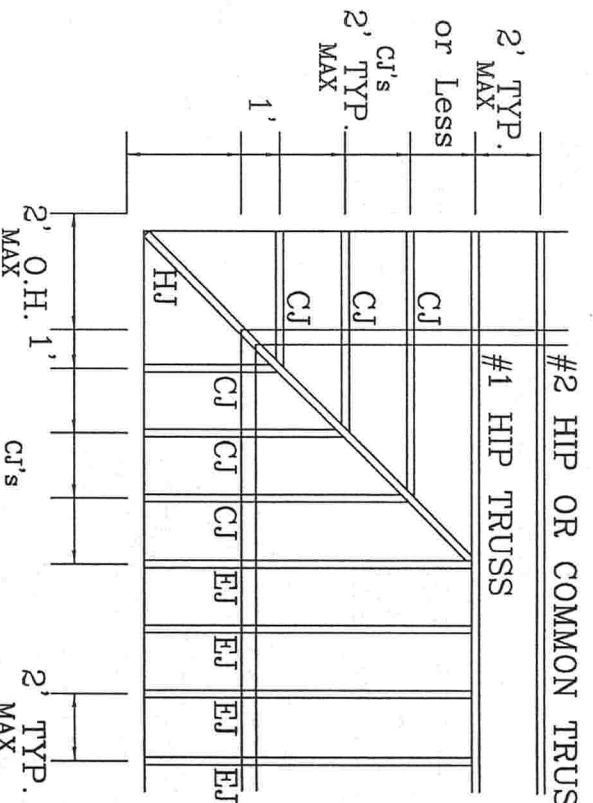

SEE FOR FOR THE DOWN

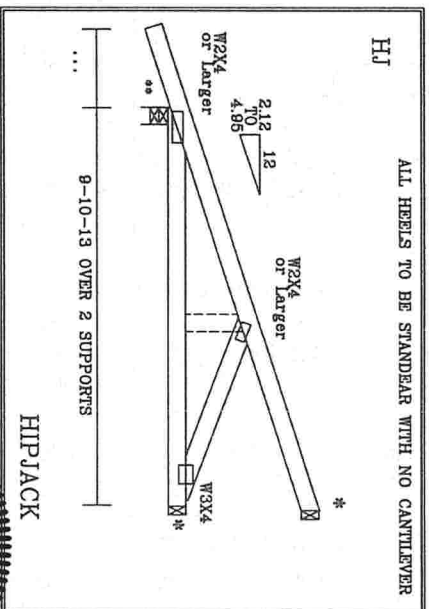


TRIPLET VALUES DO TAKE INTO ACCOUNT PORCHES EXPOSED

CORNER SET
SETBACK
7'0" MAX

DRAWING SHALL BECOME EYEWEAR CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST 1-03 BUILDING COMPONENT SAFETY INFORMATION, PUBLISHED BY TPI STEEL PLATE INSTITUTE, 988 DORRIDGE LN, SUITE 200, MADISON, WI 53719 AND A/CIA CHORD TRUSS CONNECT OF AMERICA, 6300 ENTERPRISE LN, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT: FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. ANGE ENGINEERED PRODUCTS SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION AND ALL OTHERS. APPLICABLE CODES AND STANDARDS SHALL BE USED IN THIS DESIGN. POSITION PER DRAWINGS 1604-2. ANY INSPECTION OF PLATES FOLLOWED BY CD SHALL BE PROVIDED AS OF TPI PER DRAWING 1604-2. A STEELER OF THE TRUSS COMPONENTS DESIGN SHALL BE AVAILABLE AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNED, PER ANSI/TPI 1 SEC. 2.

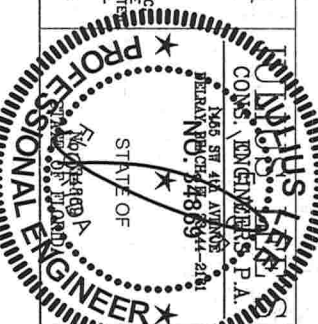

SCHEDULE					
BC LIVE LOAD IS NON CONCURRENT 10*					
T/C	DL	20	MAX	PSF	
T/C	LL	7	MAX	PSF	
B/C	DL	10*	MAX	PSF	
B/C	LL	5	MAX	PSF	
DRWG					
- ENG					
REVIEWED					
By Julius Lee at 10:52 am, Jun 27, 2008					



ASCE 7-02: 130 MPH WIND SPEED, 30' MEAN HEIGHT, ENCLOSED, I = 1.00, EXPOSURE C

MAX GABLE VERTICAL LENGTH														
GABLE VERTICAL SPACING	2x4 SPECIES	BRACE GRADE	NO BRACES	(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE **		(1) 2x6 "L" BRACE *		(2) 2x8 "L" BRACE *		
				GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	
24" O.C.	SPF	#1 / #2	3' 2"	5' 6"	6' 8"	6' 8"	6' 8"	7' 10"	8' 0"	10' 3"	10' 7"	12' 3"	12' 7"	
		#3	3' 1"	4' 5"	4' 5"	5' 10"	5' 10"	7' 10"	7' 10"	9' 1"	9' 1"	12' 3"	12' 3"	
	HF	STUD	3' 1"	4' 5"	4' 5"	5' 10"	5' 10"	7' 10"	7' 10"	9' 1"	9' 1"	12' 3"	12' 3"	
		STANDARD	2' 11"	3' 9"	3' 9"	5' 0"	5' 0"	6' 9"	6' 9"	7' 10"	7' 10"	10' 7"	10' 7"	
	SP	#1	3' 6"	5' 8"	5' 11"	6' 8"	7' 0"	7' 10"	8' 5"	10' 3"	11' 1"	12' 3"	13' 2"	
		#2	3' 6"	5' 6"	5' 11"	6' 6"	7' 0"	7' 10"	8' 5"	10' 3"	11' 1"	12' 3"	13' 2"	
	DFL	#3	3' 3"	4' 6"	4' 6"	5' 11"	6' 0"	7' 10"	8' 1"	9' 4"	9' 4"	12' 3"	12' 6"	
		STUD	3' 3"	4' 6"	4' 6"	5' 11"	6' 0"	7' 10"	8' 0"	9' 3"	9' 3"	12' 3"	12' 6"	
	16" O.C.	SPF	STANDARD	3' 0"	3' 10"	3' 10"	6' 1"	6' 1"	6' 11"	6' 11"	8' 0"	8' 0"	10' 10"	10' 10"
			#1 / #2	3' 8"	6' 4"	6' 6"	7' 6"	7' 8"	8' 11"	8' 2"	11' 9"	12' 1"	14' 0"	14' 0"
HF		#3	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"	11' 2"	11' 2"	14' 0"	14' 0"	
		STUD	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"	11' 1"	11' 1"	14' 0"	14' 0"	
SP		#1	4' 0"	6' 4"	6' 4"	7' 6"	7' 6"	8' 1"	8' 11"	8' 7"	11' 9"	12' 8"	14' 0"	
		#2	3' 11"	6' 4"	6' 10"	7' 6"	8' 1"	8' 11"	8' 7"	11' 9"	12' 8"	14' 0"	14' 0"	
DFL		#3	3' 8"	5' 6"	6' 7"	7' 4"	7' 4"	7' 4"	8' 11"	8' 6"	11' 6"	11' 6"	14' 0"	
		STUD	3' 8"	5' 6"	6' 7"	7' 4"	7' 4"	7' 4"	8' 11"	8' 5"	11' 4"	11' 4"	14' 0"	
12" O.C.		SPF	STANDARD	3' 8"	4' 9"	4' 9"	6' 3"	6' 3"	6' 3"	8' 5"	8' 5"	9' 9"	13' 3"	13' 3"
			#1 / #2	4' 0"	6' 11"	7' 2"	8' 3"	8' 3"	8' 6"	9' 10"	10' 1"	12' 11"	13' 4"	14' 0"
	HF	#3	3' 11"	6' 3"	6' 3"	8' 3"	8' 3"	8' 6"	9' 10"	9' 10"	12' 11"	14' 0"	14' 0"	
		STUD	3' 11"	6' 3"	6' 3"	8' 3"	8' 3"	8' 6"	9' 10"	9' 10"	12' 10"	14' 0"	14' 0"	
	SP	#1	3' 11"	5' 4"	5' 4"	7' 1"	7' 1"	7' 1"	9' 6"	9' 6"	11' 1"	14' 0"	14' 0"	
		#2	4' 5"	6' 11"	7' 6"	8' 3"	8' 3"	8' 11"	9' 10"	10' 7"	12' 11"	13' 11"	14' 0"	
	DFL	#3	4' 2"	6' 6"	6' 6"	8' 3"	8' 3"	8' 6"	9' 10"	10' 4"	12' 11"	13' 1"	14' 0"	
		STUD	4' 0"	5' 6"	5' 6"	7' 3"	7' 3"	7' 3"	8' 9"	9' 9"	11' 4"	11' 4"	14' 0"	

BRACING GROUP SPECIES AND GRADES:	
GROUP A:	
SPRUCE-PINE-LARCH	GROUP B:
#1 / #2 STUD	DOUGLAS FIR-LARCH
#3 STUD	#1 STUD
STANDARD	STANDARD

GABLE TRUSS DETAIL NOTES:


LIVE LOAD DEFLECTION CRITERIA IS L/240.
 PROVIDE UPLIFT CONNECTIONS FOR 150 PSF OVER CONTINUOUS BEAMING (6 PSF VC DEAD LOAD).
 GABLE END SUPPORTS LOAD FROM 4' 0" OUTLINES WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.
 ATTACH EACH "T" BRACE WITH 10d NAILS.
 * FOR (1) "T" BRACE, SPACE NAILS AT 8" O.C. IN 18" END ZONES AND 4" O.C. BETWEEN ZONES.
 ** FOR (2) "T" BRACES, SPACE NAILS AT 3" O.C. IN 18" END ZONES AND 6" O.C. BETWEEN ZONES.
 "T" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.

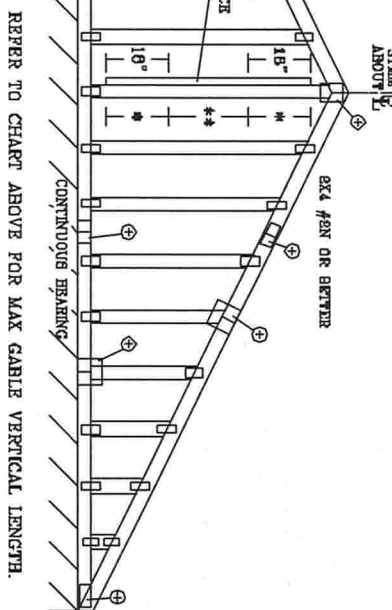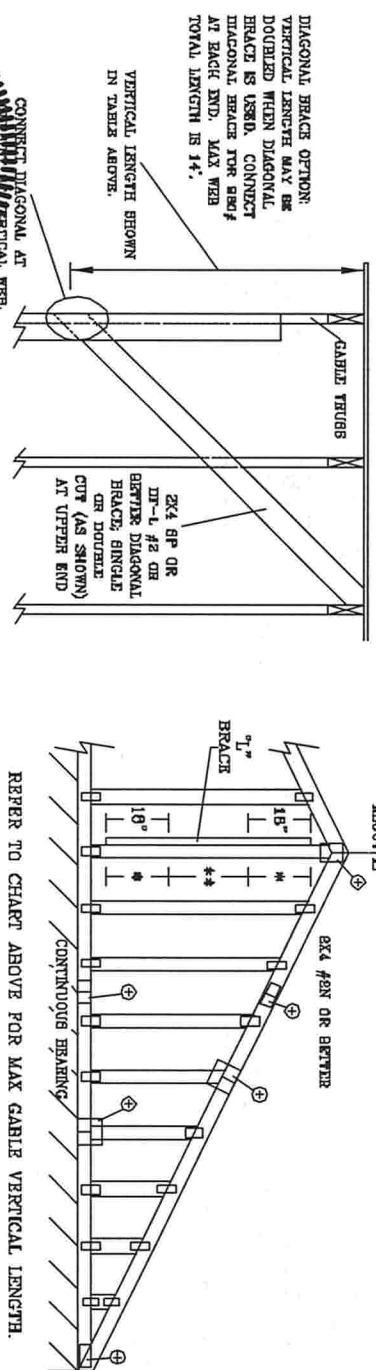

REFER TO CHART ABOVE FOR MAX GABLE VERTICAL LENGTH.

GABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SETBACK
LESS THAN 4' 0"	1x4 OR 2x4
GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2x4
GREATER THAN 11' 6"	2.5x4

+ REFER TO COMMON TRUSS DESIGN FOR PEAK, SPRUCE, AND HEBEL PLATES.

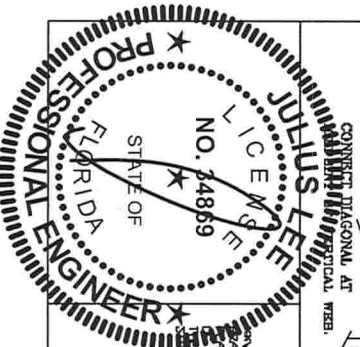

REVIEWED
 By Julius Lee at 12:00 pm, Jun 11, 2008

CONTRACTOR: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND ERECTING. ALL TRUSSES MUST BE ERECTED BY A LICENSED TRUSS ERECTOR. THE TRUSS COMPANY, 6300 ENTERPRISE LN, MOBILE, AL 36688, (205) 651-1234, IS THE TRUSS MANUFACTURER. THESE INSTRUCTIONS, UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
 CONSULTING ENGINEERS P.A.
 1466 BR 4th AVENUE
 ORLANDO, FL 32804-2611

No. 34869
 STATE OF FLORIDA

MAX. TOT. LD. 60 PSF
 MAX. SPACING 24.0"

REF ASCE 7-02-CAB13030
 DATE 11/26/03
 DWG MARK STD GABLE 30' E 117
 -ENG

TOP CHORD 2X4 #2 OR BETTER
BOT CHORD 2X4 #2 OR BETTER
WEBS 2X4 #3 OR BETTER

PIGGYBACK DETAIL

REFER TO SEALED DESIGN FOR DASHED PLATES.

SPACE PIGGYBACK VERTICALS AT 4' OC MAX.

TOP AND BOTTOM CHORD SPLICES MUST BE STAGGERED SO THAT ONE SPLICE IS NOT DIRECTLY OVER ANOTHER.

PIGGYBACK BOTTOM CHORD MAY BE OMITTED. ATTACH VERTICAL WEBS TO TRUSS TOP CHORD WITH 1.5X3 PLATE.

ATTACH PURLINS TO TOP OF FLAT TOP CHORD. IF PIGGYBACK IS SOLID LUMBER OR THE BOTTOM CHORD IS OMITTED, PURLINS MAY BE APPLIED BENEATH THE TOP CHORD OF SUPPORTING TRUSS.

REFER TO ENGINEER'S SEALED DESIGN FOR REQUIRED PURLIN SPACING.

THIS DETAIL IS APPLICABLE FOR THE FOLLOWING WIND CONDITIONS:

110 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG, LOCATED ANYWHERE IN ROOF, 1 MI FROM COAST


CAT 1, EXP C, WIND TC DL=6 PSF, WIND BC DL=6 PSF

110 MPH WIND, 30' MEAN HGT, ENG ENCLOSED BLDG, LOCATED ANYWHERE IN ROOF

WIND TC DL=6 PSF, WIND BC DL=6 PSF


FRONT FACE (E,*) PLATES MAY BE OFFSET FROM BACK FACE

PLATES AS LONG AS BOTH FACES ARE SPACED 4' OC MAX.

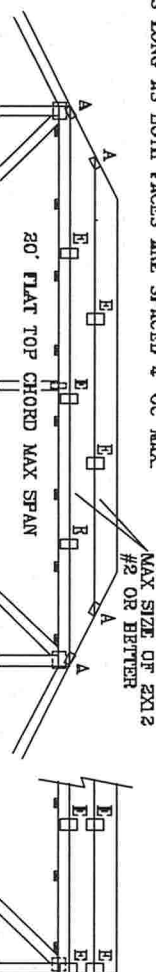

ETHER PLATE LOCATION IS ACCEPTABLE

OPTIONAL SPLICE

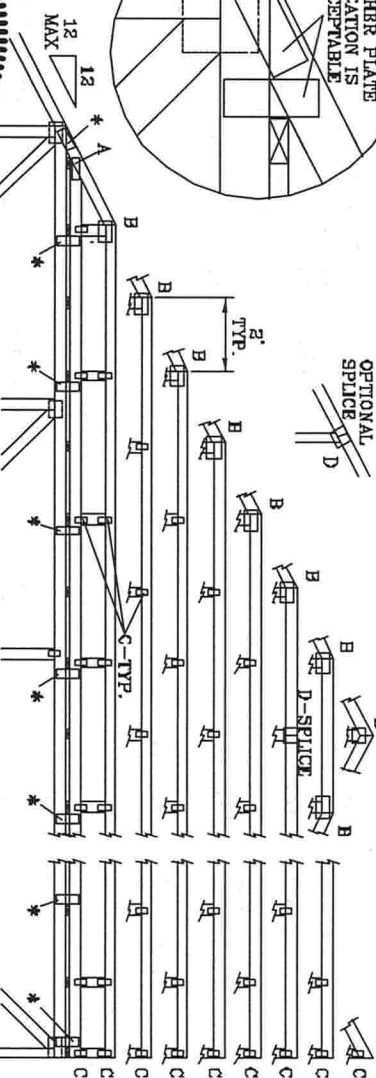

130 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG, LOCATED ANYWHERE IN ROOF, CAT 1, EXP. C, WIND TC DL=6 PSF, WIND BC DL=6 PSF


JOINT TYPE	SPANS UP TO			
	30'	34'	38'	62'
A	2X4	2.5X4	2.5X4	3X6
B	4X6	6X6	6X6	6X6
C	1.5X3	1.5X4	1.5X4	1.5X4
D	5X4	6X6	6X6	6X6
E	4X6 OR 3X6 TRUSS AT 4' OC, ROTATED VERTICALLY			

ATTACH TRUSS PLATES WITH (6) 0.120" X 1.375" NAILS OR EQUAL, PER FACE PER PLY. (4) NAILS IN EACH MEMBER TO BE CONNECTED. REFER TO DRAWING 160 TL FOR TRUSS INFORMATION.

WEB LENGTH	WEB BRACING CHART
0' TO 7'9"	NO BRACING
7'9" TO 10'	1X4 "T" BRACE, SAME GRADE, SPECIES AS WEB MEMBER, OR BETTER, AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 8d NAILS AT 4" OC.
10' TO 14'	2X4 "T" BRACE, SAME GRADE, SPECIES AS WEB MEMBER, OR BETTER, AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 16d NAILS AT 4" OC.

* PIGGYBACK SPECIAL PLATE


ATTACH TEETH TO THE PIGGYBACK AT THE TIME OF FABRICATION. ATTACH TO SUPPORTING TRUSS WITH (4) 0.120" X 1.375" NAILS PER FACE PER PLY. APPLY PIGGYBACK SPECIAL PLATE TO EACH TRUSS FACE AND SPACE 4' OC OR LESS.

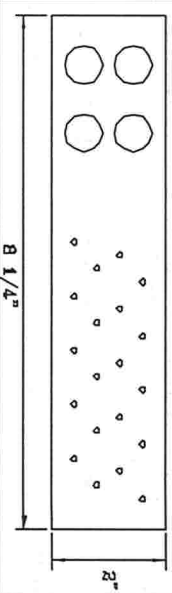

THIS DRAWING REPLACES DRAWINGS 634.016 634.017 & 647.045

JULIUS LEE'S
CONS. ENGINEERS P.A.
1400 SW 4TH AVENUE
ODDWAY BEACH, FL 33444-2161

MAX LOADING	REF	PIGGYBACK
55 PSF AT	DATE	09/12/07
1.33 DUR. FAC.	DRWG/MTK	STD PIGGY
50 PSF AT	-ENG	JL
1.25 DUR. FAC.		
47 PSF AT		
1.15 DUR. FAC.		
SPACING		24.0"

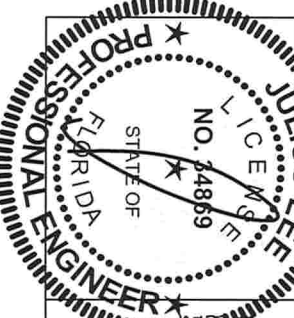

REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008

No. 34869
STATE OF FLORIDA

TOE-NAIL DETAIL

TOE-NAILS TO BE DRIVEN AT AN ANGLE OF APPROXIMATELY THIRTY DEGREES WITH THE PIECE AND STARTED APPROXIMATELY ONE-THIRD THE LENGTH OF THE NAIL FROM THE END OF THE MEMBER.

PER ANSI/AP&PA NDS-2001 SECTION 12.4.1 - EDGE DISTANCE, END DISTANCE, SPACING, "EDGE DISTANCES, END DISTANCES AND SPACINGS FOR NAILS AND SPIKES SHALL BE SUFFICIENT TO PREVENT SPLITTING OF THE WOOD."



THE NUMBER OF TOE-NAILS TO BE USED IN A SPECIFIC APPLICATION IS DEPENDENT UPON PROPERTIES FOR THE CHORD SIZE, LUMBER SPECIES, AND NAIL TYPE. PROPER CONSTRUCTION PRACTICES AS WELL AS GOOD JUDGEMENT SHOULD DETERMINE THE NUMBER OF NAILS TO BE USED.

THIS DETAIL DISPLAYS A TOE-NAILED CONNECTION FOR JACK FRAMING INTO A SINGLE OR DOUBLE PLY SUPPORTING GIRDER.

MAXIMUM VERTICAL RESISTANCE OF 16d (0.162"x3.5") COMMON TOE-NAILS


NUMBER OF TOE-NAILS	SOUTHERN PINE		DOUGLAS FIR-LARCH		HEM-FIR		SPRUCE PINE FIR	
	1 PLY	2 PLYS	1 PLY	2 PLYS	1 PLY	2 PLYS	1 PLY	2 PLYS
2	187#	256#	181#	234#	156#	203#	154#	199#
3	296#	383#	271#	351#	234#	304#	230#	298#
4	394#	511#	361#	468#	312#	406#	307#	397#
5	493#	638#	452#	585#	390#	507#	384#	496#

ALL VALUES MAY BE MULTIPLIED BY APPROPRIATE DURATION OF LOAD FACTOR.

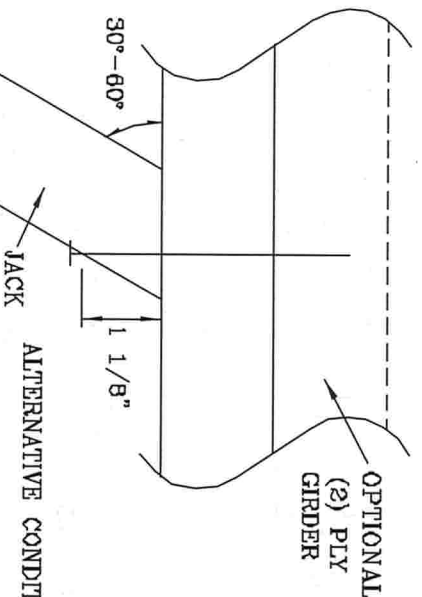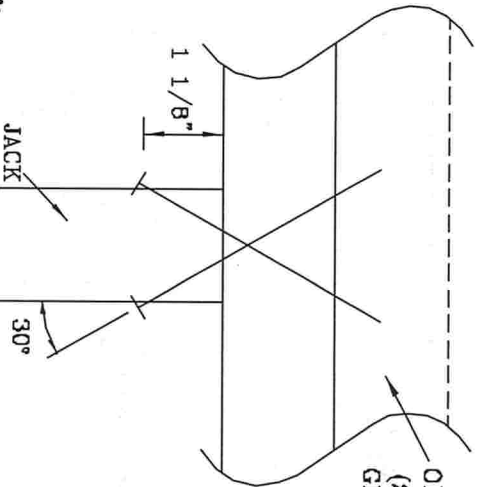

ALTERNATIVE CONDITION

THIS DRAWING REPLACES DRAWING 784040

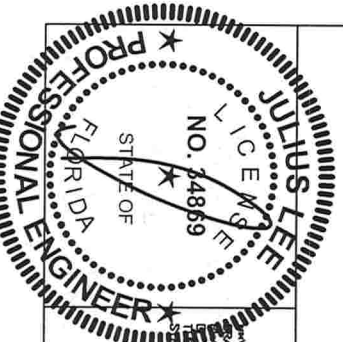

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST PRACTICES FOR TRUSS CONSTRUCTION. THIS DRAWING IS THE PROPERTY OF JULIUS LEE'S CONSULTING ENGINEERS P.A. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT PERMISSION IN WRITING FROM JULIUS LEE'S CONSULTING ENGINEERS P.A., NO PART OF THIS DRAWING MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

REVIEWED

By Julius Lee at 11:59 am, Jun 11, 2008

JULIUS LEE'S
CONS. ENGINEERS P.A.

1405 RT 4TH AVENUE
DELRAY BEACH, FL 33441-2161


No: 34889
STATE OF FLORIDA

TC LL	PSF	REF	TOE-NAIL
TC DL	PSF	DATE	09/12/07
BC DL	PSF	DRWG	CNTONAIL1103
BC LL	PSF	-ENG	JL
TOT. LD.	PSF		
DUR. FAC.	1.00		
SPACING			

1/2" DIAMETER BOLT SPACING FOR LOAD APPLIED PARALLEL TO GRAIN.

* GRADE AND SPECIES AS SPECIFIED ON THE ALPINE DESIGN.
BOLT HOLES SHALL BE A MINIMUM OF 1/32" TO A MAXIMUM OF 1/16" LARGER THAN BOLT DIAMETER.


TYPICAL LOCATION OF 1/2" DIAMETER THRU BOLTS. BOLT QUANTITIES AS NOTED ON SEALED DESIGN MUST BE APPLIED IN ONE OF THE PATTERNS SHOWN BELOW.
WASHERS REQUIRED UNDER BOLT HEAD AND NUT

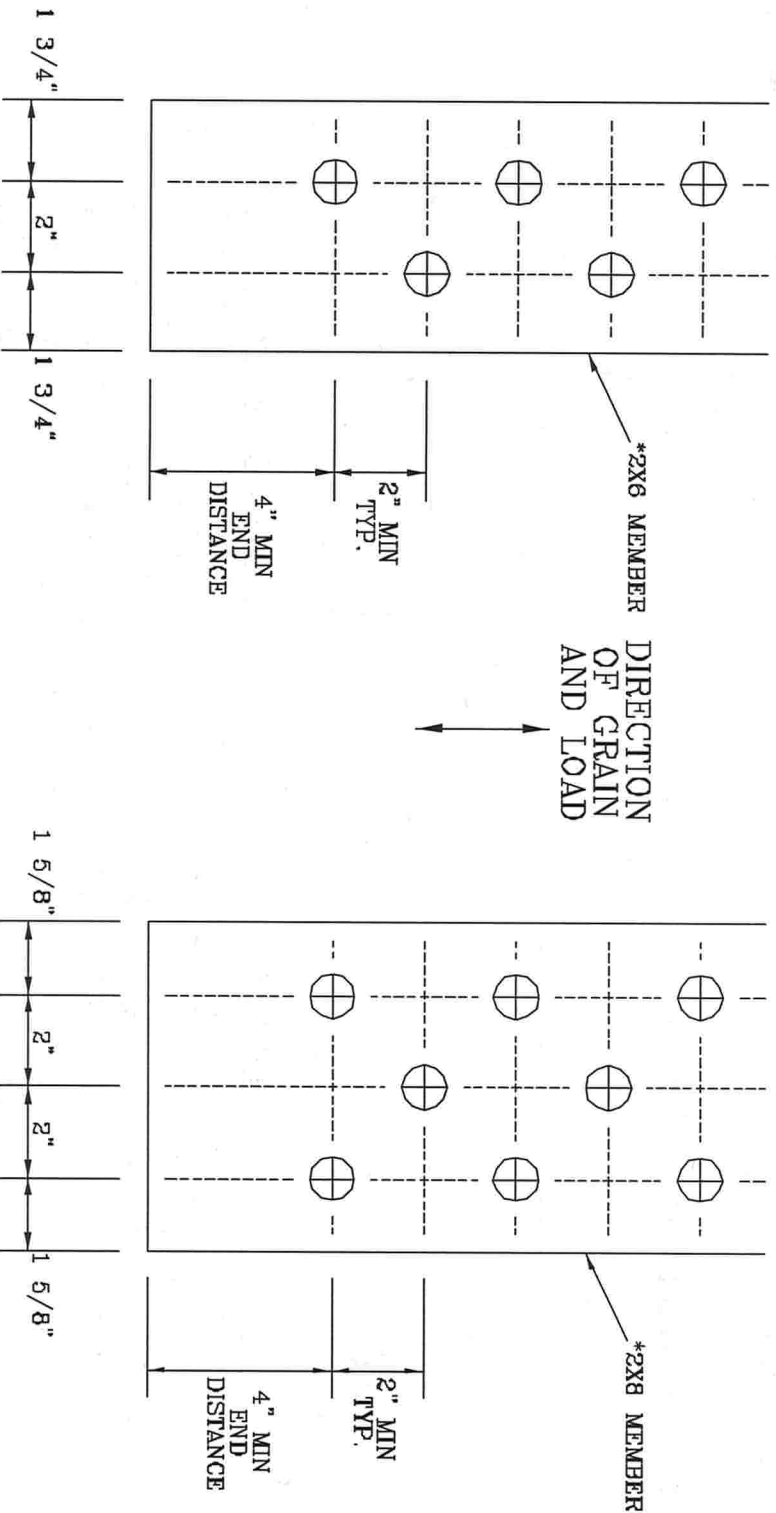

2X6 DETAIL

2X8 DETAIL

THIS DRAWING REPLACES DRAWING A628.016

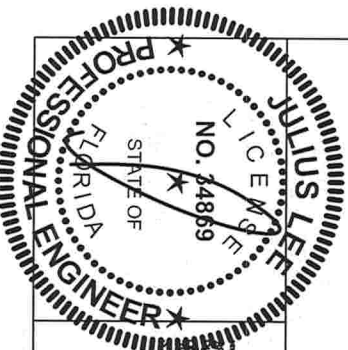

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO ECST-1-93 GUIDING CONSTRUCTION SAFETY INFORMATION, PUBLISHED BY THE TRUSS ASSOCIATION, 386 OGDON DR., SUITE 800, MADISON, VT 05750 AND VICA CYCLED TRUSS COUNCIL, 1000 AMERICA, 6300 ENTERPRISE LN, MADISON, VT 05750 FOR SAFETY PRACTICES PRIOR TO PERFORMING TRUSS FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008

JULIUS LEE'S CONS. ENGINEERS P.A.				TC LL	PSF	REF	BOLT SPACING
1405 IV 4TH AVENUE DELMAR BEACH, FL 39444-2161				TC DL	PSF	DATE	11/26/03
				BC DL	PSF	DRWG	CNBOLTSPI1103
				BC LL	PSF	-ENG	JL
				TOT. LD.	PSF		
				DUR. FAC.			
				SPACING			

No: 34869
STATE OF FLORIDA





VALLEY TRUSS DETAIL

TOP CHORD 2X4 SP #2 OR SPF #1/#2 OR BETTER.
BOT CHORD 2X3(*) OR 2X4 SP #2N OR SPF #1/#2 OR BETTER.
WEBS 2X4 SP #3 OR BETTER.


* 2X3 MAY BE RIPPED FROM A 2X6 (PITCHED OR SQUARE).

** ATTACH EACH VALLEY TO EVERY SUPPORTING TRUSS WITH:

(2) 16d BOX (0.135" X 3.5") NAILS TOE-NAILED FOR
FBC 2004 110 MPH, ASCE 7-02 110 MPH WIND OR (3) 16d FOR
ASCE 7-02 130 MPH WIND. 16' MEAN HEIGHT, ENCLOSED
BUILDING, EXP. C, RESIDENTIAL, WIND TC DL=5 PSF.

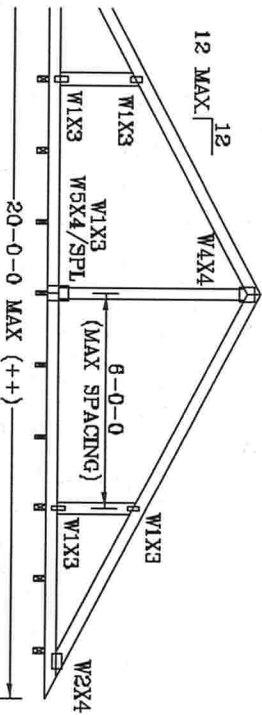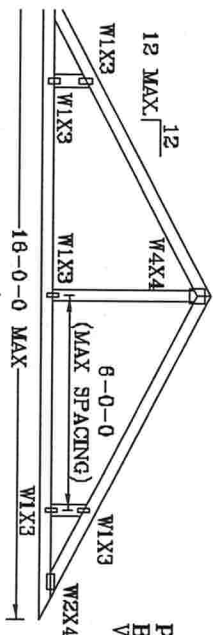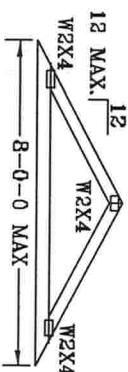


*** NOTE THAT THE PURLIN SPACING FOR BRACING THE TOP CHORD OF THE TRUSS
BENEATH THE VALLEY IS MEASURED ALONG THE SLOPE OF THE TOP CHORD.
++ LARGER SPANS MAY BE BUILT AS LONG AS THE VERTICAL HEIGHT DOES
NOT EXCEED 12'0".
BOTTOM CHORD MAY BE SQUARE OR PITCHED CUT AS SHOWN.

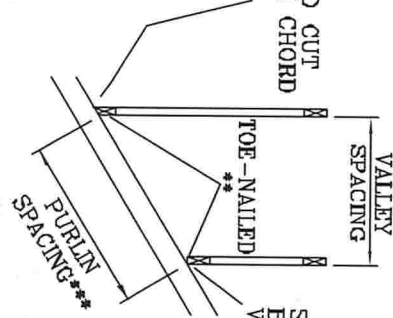

SQUARE CUT
BOTTOM CHORD
VALLEY

OPTIONAL STUB
END DETAIL

OPTIONAL HIP
JOINT DETAIL

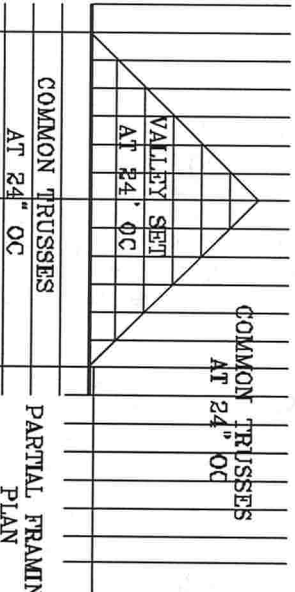

COMMON TRUSSES
AT 24" OC

PARTIAL FRAMING
PLAN

THIS DRAWING REPLACES DRAWING A105


UNLESS SPECIFIED ON ENGINEER'S SEALED DESIGN, APPLY 1X4 "T"-BRACE, 80%
LENGTH OF WEB, VALLEY WEB, SAME SPECIES AND GRADE OR BETTER, ATTACHED
WITH 8d BOX (0.113" X 2.5") NAILS AT 6" OC, OR CONTINUOUS LATERAL BRACING,
EQUALLY SPACED, FOR VERTICAL VALLEY WEBS GREATER THAN 7'9".
MAXIMUM VALLEY VERTICAL HEIGHT MAY NOT EXCEED 12'0".
TOP CHORD OF TRUSS BENEATH VALLEY SET MUST BE BRACED WITH:
PROPERTY ATTACHED, RATED SHEATHING APPLIED PRIOR TO VALLEY TRUSS
INSTALLATION
OR
PURLINS AT 24" OC OR AS OTHERWISE SPECIFIED ON ENGINEERS' SEALED DESIGN
OR
BY VALLEY TRUSSES USED IN LIEU OF PURLIN SPACING AS SPECIFIED ON
ENGINEERS' SEALED DESIGN.

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 SW 4th AVENUE
DEALY BRICK, FL 33444-8101


TC IL	20	20	PSF	REF	VALLEY DETAIL
TC DL	7	15	PSF	DATE	11/26/03
BC DL	5	5	PSF	DRWG	VALTRUSS1103
BC IL	0	0	PSF	ENG	JL
TOT. LD.	32	40	PSF		
DURFAC.125	1.25				
SPACING	24"				

REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008


No. 34568
STATE OF FLORIDA

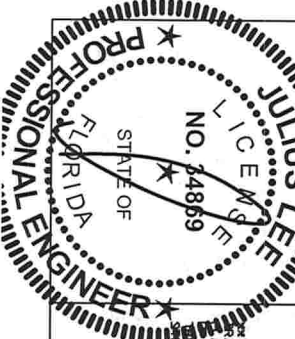


TYPICAL ATTIC TRUSS BRACING

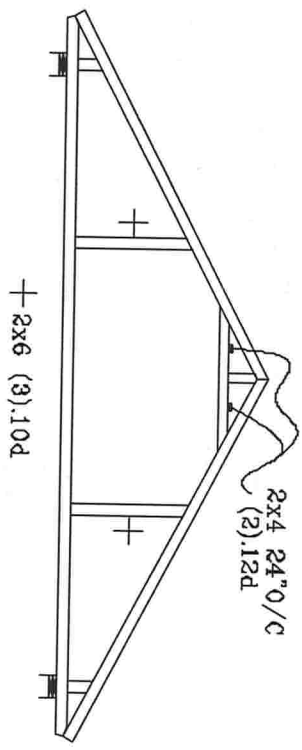


TYPICAL ALTERNATE BRACING DETAIL FOR EXTERIOR FLAT GIRDER TRUSS

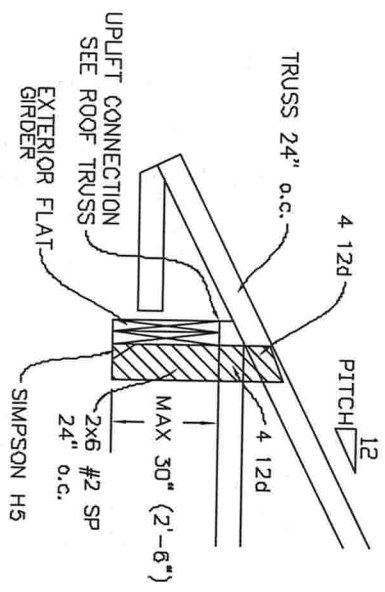

GABLE END TRUSS DETAIL

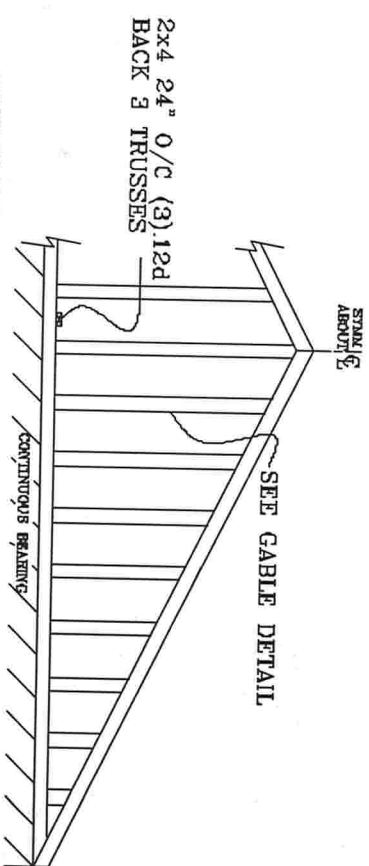



TYPICAL WALL GIRDER VERTICAL WEB BRACING DETAIL

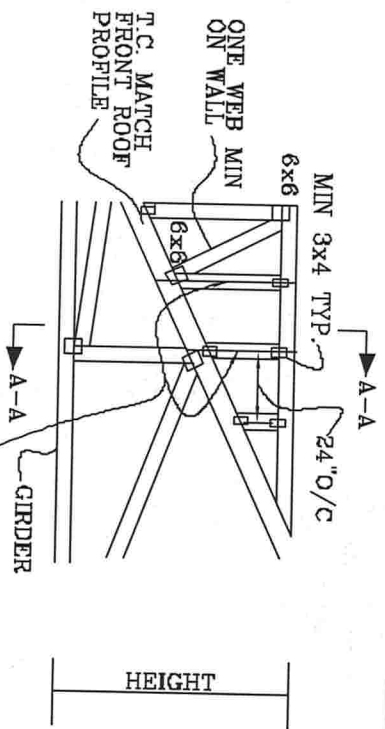

SEE ROOF TRUSSES FOR UPLIFT

ROOF 24" o/c

SEE GABLE END DETAIL FOR T-BRACE BEHIND EACH VERTICAL

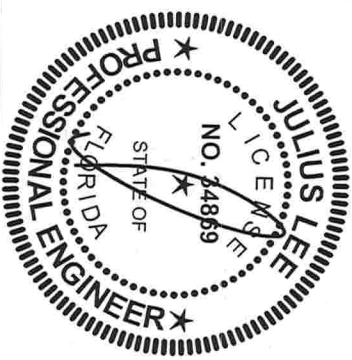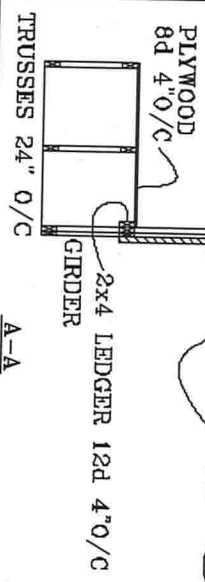



REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008

JULIUS LEE'S
CONS. ENGINEERS P.A.
1425 SW 4th AVENUE
DIKEBT Bldg. 7th 33444-2101

No. 34869
STATE OF FLORIDA


MAX GABLE VERTICAL LENGTH

GABLE VERTICAL SPECIES	BRACE	NO. BRACES	(1) 1X4 "L" BRACE *				(1) 2X4 "L" BRACE *				(2) 2X4 "L" BRACE **				(1) 2X6 "L" BRACE *				(2) 2X8 "L" BRACE *			
			GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
24" O.C.	SPF	#1 / #2	3' 4"	5' 10"	6' 0"	6' 11"	7' 1"	8' 3"	8' 6"	10' 10"	11' 2"	12' 11"	13' 3"									
		#3	3' 3"	4' 11"	4' 11"	6' 6"	6' 6"	8' 3"	8' 3"	10' 1"	10' 1"	12' 11"	12' 11"									
		STUD	3' 3"	4' 11"	4' 11"	6' 6"	6' 6"	8' 3"	8' 3"	10' 0"	10' 0"	12' 11"	12' 11"									
		STANDARD	3' 3"	4' 2"	4' 2"	5' 6"	5' 6"	7' 5"	7' 5"	9' 5"	9' 5"	11' 8"	11' 8"									
24" O.C.	SP	#1	3' 8"	5' 10"	6' 3"	6' 11"	7' 5"	8' 3"	8' 11"	10' 10"	11' 8"	12' 11"	13' 11"									
		#2	3' 7"	5' 10"	6' 3"	6' 11"	7' 5"	8' 3"	8' 11"	10' 10"	11' 8"	12' 11"	13' 11"									
		#3	3' 7"	5' 10"	6' 3"	6' 11"	7' 5"	8' 3"	8' 11"	10' 10"	11' 8"	12' 11"	13' 11"									
		STUD	3' 6"	5' 0"	5' 0"	6' 8"	6' 8"	8' 3"	8' 3"	10' 4"	10' 4"	12' 11"	13' 7"									
24" O.C.	DFL	STANDARD	3' 4"	4' 3"	4' 3"	5' 6"	5' 6"	7' 5"	7' 5"	9' 5"	9' 5"	11' 8"	11' 8"									
		#1 / #2	3' 10"	6' 3"	6' 10"	7' 11"	8' 1"	9' 5"	9' 5"	12' 6"	12' 6"	14' 0"	14' 0"									
		#3	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 4"	12' 4"	14' 0"	14' 0"									
		STUD	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 4"	12' 4"	14' 0"	14' 0"									
16" O.C.	SPF	STANDARD	3' 8"	5' 2"	5' 2"	6' 10"	6' 10"	8' 2"	8' 2"	10' 7"	10' 7"	12' 11"	12' 11"									
		#1	4' 3"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	9' 5"	12' 5"	12' 5"	14' 0"	14' 0"									
		#2	4' 2"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	9' 5"	12' 5"	12' 5"	14' 0"	14' 0"									
		#3	4' 0"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	9' 5"	12' 5"	12' 5"	14' 0"	14' 0"									
16" O.C.	SP	STANDARD	3' 10"	5' 3"	5' 3"	6' 11"	6' 11"	8' 4"	8' 4"	10' 10"	10' 10"	12' 6"	12' 6"									
		#1 / #2	4' 3"	7' 4"	7' 4"	8' 9"	8' 9"	10' 6"	10' 6"	13' 8"	13' 8"	15' 0"	15' 0"									
		#3	4' 2"	7' 4"	7' 4"	8' 9"	8' 9"	10' 6"	10' 6"	13' 8"	13' 8"	15' 0"	15' 0"									
		STUD	4' 2"	6' 11"	6' 11"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
16" O.C.	DFL	STANDARD	4' 2"	6' 11"	6' 11"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#1	4' 8"	7' 4"	7' 4"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#2	4' 7"	7' 4"	7' 4"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#3	4' 4"	7' 2"	7' 2"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
12" O.C.	SPF	STANDARD	4' 4"	7' 1"	7' 1"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#1	4' 4"	7' 1"	7' 1"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#2	4' 4"	7' 1"	7' 1"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
		#3	4' 4"	7' 1"	7' 1"	8' 9"	8' 9"	10' 5"	10' 5"	13' 8"	13' 8"	15' 0"	15' 0"									
12" O.C.	SP	STANDARD	4' 3"	6' 1"	6' 1"	8' 0"	8' 0"	9' 2"	9' 2"	10' 11"	10' 11"	12' 6"	12' 6"									
		#1	4' 3"	6' 1"	6' 1"	8' 0"	8' 0"	9' 2"	9' 2"	10' 11"	10' 11"	12' 6"	12' 6"									
		#2	4' 3"	6' 1"	6' 1"	8' 0"	8' 0"	9' 2"	9' 2"	10' 11"	10' 11"	12' 6"	12' 6"									
		#3	4' 3"	6' 1"	6' 1"	8' 0"	8' 0"	9' 2"	9' 2"	10' 11"	10' 11"	12' 6"	12' 6"									

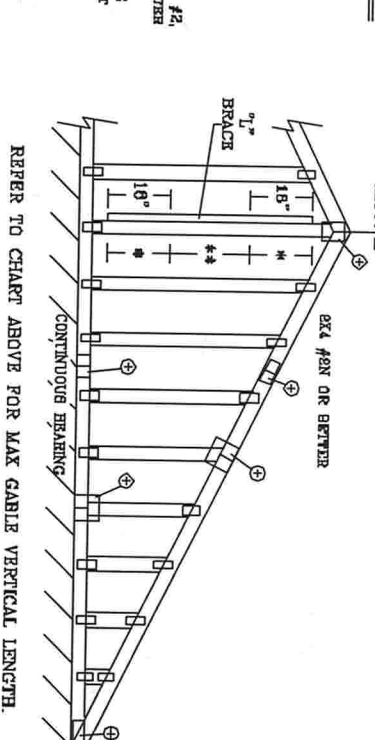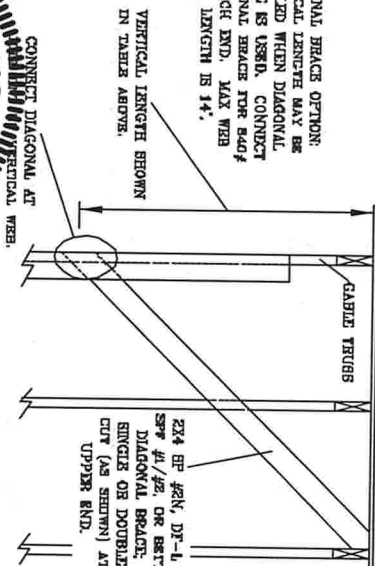

CABLE TRUSS DETAIL NOTES:			
LIVE LOAD DEFLECTION CRITERIA IS L/240.			
PROVIDE UPLIFT CONNECTIONS FOR 136 PSF OVER CONTINUOUS BEARING (6 PSF FC DEAD LOAD).			
CABLE END SUPPORTS LOAD FROM 4' 0" OUTLEAKERS WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.			
ATTACH EACH "L" BRACE WITH 10d NAILS.			
* FOR (1) "L" BRACE, SPACE NAILS AT 8" O.C.			
IN 18" END ZONES AND 4" O.C. BETWEEN ZONES.			
* FOR (2) "L" BRACES, SPACE NAILS AT 8" O.C.			
IN 18" END ZONES AND 6" O.C. BETWEEN ZONES.			
"L" BRACING MUST BE A MINIMUM OF 60% OF WEB MEMBER LENGTH.			

CABLE TRUSS DETAIL NOTES:			
LIVE LOAD DEFLECTION CRITERIA IS L/240.			
PROVIDE UPLIFT CONNECTIONS FOR 136 PSF OVER CONTINUOUS BEARING (6 PSF FC DEAD LOAD).			
CABLE END SUPPORTS LOAD FROM 4' 0" OUTLEAKERS WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.			
ATTACH EACH "L" BRACE WITH 10d NAILS.			
* FOR (1) "L" BRACE, SPACE NAILS AT 8" O.C.			
IN 18" END ZONES AND 4" O.C. BETWEEN ZONES.			
* FOR (2) "L" BRACES, SPACE NAILS AT 8" O.C.			
IN 18" END ZONES AND 6" O.C. BETWEEN ZONES.			
"L" BRACING MUST BE A MINIMUM OF 60% OF WEB MEMBER LENGTH.			

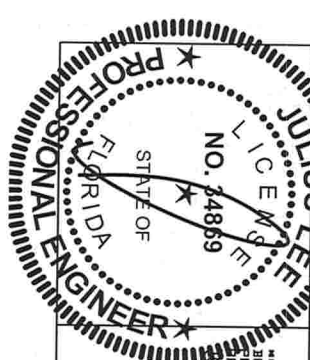

REVIEWED
By Julius Lee at 12:00 pm, Jun 11, 2008


WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO THE TRUSS MANUFACTURER'S INSTRUCTIONS FOR SAFETY INFORMATION. PUBLISHED BY TPI TRUSS BRACING INSTITUTE, 384 DUNDON RD., SUITE 100, WILSONVILLE, NC 27158. (704) 371-1111. FAX (704) 371-1112. E-MAIL: TPI@TPI-TRUSS.COM. TRUSS MANUFACTURER'S INSTRUCTIONS MUST BE FOLLOWED. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.
1465 HWY 48, APT. 205
DELAWARE BEACH, FL 33444-2161
No. 34869
STATE OF FLORIDA


MAX. TOT. LD. 60 PSF	MAX. SPACING 24.0"
REF ASCT7-02-CAB13015	
DATE 11/26/03	
DRAWN NITKA STD CABLE 15 E HT	
-ENG	

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

*Plate location details available in Mitek 20/20 software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCS11: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

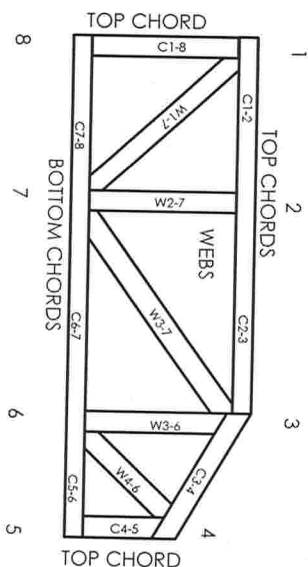

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ER-5243, 9604B, 9730, 95-43, 96-31, 9667A
NER-487, NER-561
95110, 84-32, 96-67, ER-3907, 9432A

© 2006 Mitek® All Rights Reserved

Your Company Information and logo



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCS11.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stock materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and waste at joint locations are regulated by ANSI/TP1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.

Job 344737	Truss T21	Truss Type COMMON	Qty 1	Ply 2	ADAMS CONST. - CONNER RES.	I4476672
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 Mitek Industries, Inc. Wed Sep 15 12:48:04 2010 Page 2

- 11) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- 12) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-7=-54, 1-7=-10

Concentrated Loads (lb)

Vert: 10=-834(F) 13=-877(F) 14=-875(F) 15=-762(F) 16=-716(F) 17=-716(F) 18=-716(F) 19=-716(F) 20=-716(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.
Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, DSB-89 and ECSI1 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T20	Truss Type COMMON	Qty 4	Ply 1	ADAMS CONST. - CONNER RES.	14476671
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:03 2010 Page 1

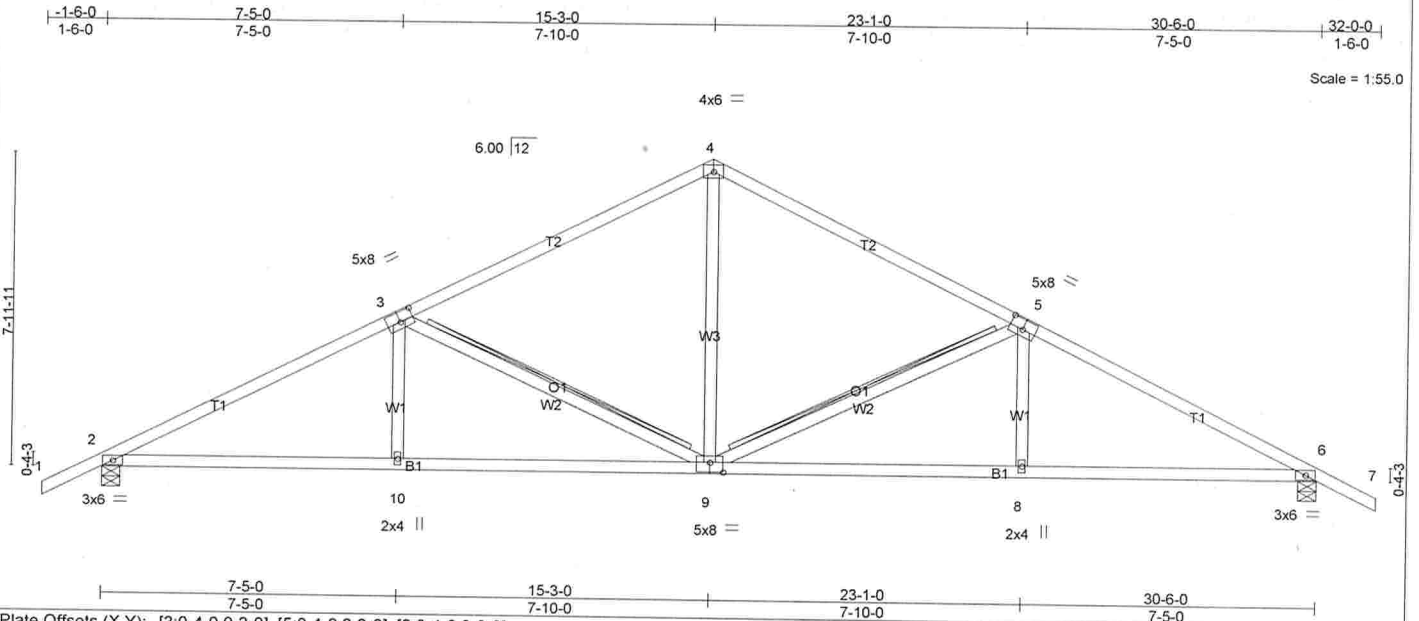


Plate Offsets (X,Y): [3:0-4:0,0-3:0], [5:0-4:0,0-3:0], [9:0-4:0,0-3:0]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.43	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.38	Vert(LL) -0.08 9-10 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.48	Vert(TL) -0.18 8-9 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.08 6 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.13 9 >999 240		
				Weight: 148 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.1D
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD
WEBS

Structural wood sheathing directly applied or 4-9-14 oc purlins.
Rigid ceiling directly applied or 6-5-8 oc bracing.
T-Brace: 2 X 4 SYP No.3 - 5-9, 3-9
Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
Brace must cover 90% of web length.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1055/0-5-8, 6=1055/0-5-8
Max Horz 2=147(LC 6)
Max Uplift 2=419(LC 6), 6=419(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1742/1292, 3-4=-1175/979, 4-5=-1175/979, 5-6=-1742/1292
BOT CHORD 2-10=-952/1477, 9-10=-951/1477, 8-9=-951/1477, 6-8=-952/1477
WEBS 4-9=-463/571, 5-9=-595/594, 3-9=-595/594

NOTES (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 419 lb uplift at joint 2 and 419 lb uplift at joint 6.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

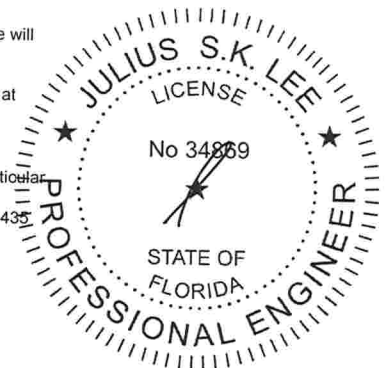

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T19	Truss Type SPECIAL	Qty 6	Ply 1	ADAMS CONST. - CONNER RES.	14476670
---------------	--------------	-----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:02 2010 Page 1

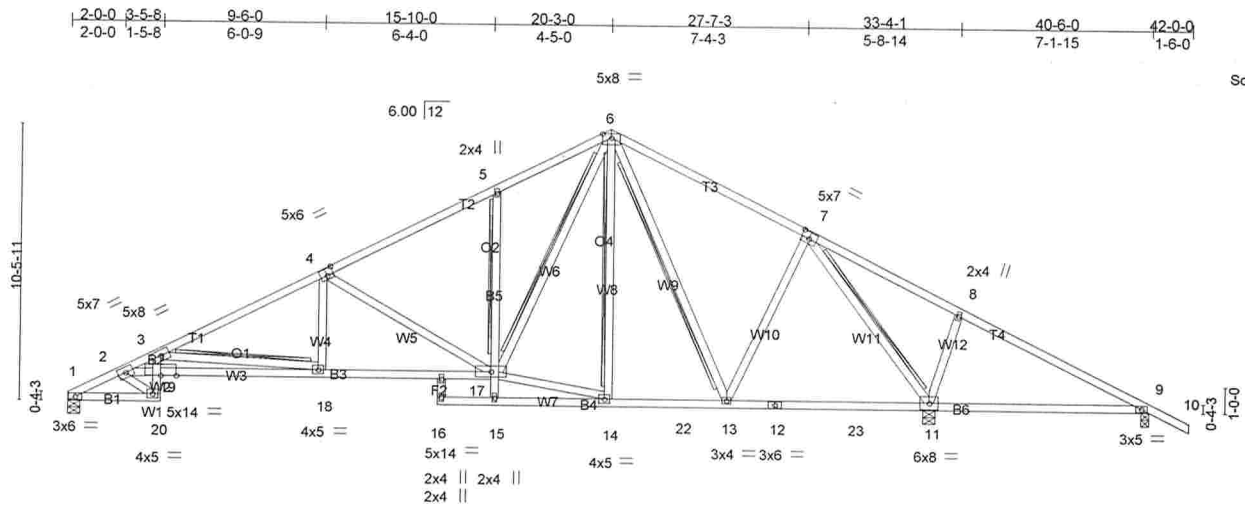


Plate Offsets (X,Y):	[4:0-3:0,0-3:4], [7:0-3:8,0-3:0]
----------------------	----------------------------------

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	Plates Increase 2.0-0	TC 0.62	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.84	Vert(LL) -0.24 18-19 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.85	Vert(TL) -0.45 18-19 >846 240		
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)	Horz(TL) 0.22 11 n/a n/a		
			Wind(LL) 0.34 9-11 >287 240		
				Weight: 254 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2 *Except*
B5: 2 X 4 SYP No.3
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-1-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 3-11-12 oc bracing. Except:
T-Brace: 2 X 4 SYP No.3 - 5-17
10-0-0 oc bracing: 15-17
WEBS 2 X 4 SYP No.3 - 3-18, 6-17, 6-14, 6-13, 7-11
Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
Brace must cover 90% of web length.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


REACTIONS (lb/size) 1=950/0-5-8, 11=2156/0-5-8, 9=-197/0-3-8
Max Horz 1=-196(LC 7)
Max Uplift 1=-298(LC 6), 11=-731(LC 6), 9=-361(LC 10)
Max Grav 1=950(LC 1), 11=2156(LC 1), 9=50(LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1748/1255, 2-3=-3462/2373, 3-4=-1914/1312, 4-5=-1221/900, 5-6=-1176/1070,
6-7=-587/565, 7-8=-625/1214, 8-9=-727/1134
BOT CHORD 1-20=-959/1467, 19-20=-452/732, 3-19=-459/798, 18-19=-2373/3595, 17-18=-892/1668,
5-17=-287/358, 14-22=-20/611, 13-22=-20/611, 12-13=-2/254, 12-23=-2/254,
11-23=-2/254, 9-11=-926/812
WEBS 2-20=-1262/809, 2-19=-1677/2647, 3-18=-1933/1488, 4-18=-143/378, 4-17=-760/688,
14-17=-0/592, 6-17=-714/939, 6-13=-446/280, 7-13=-173/659, 7-11=-2057/1299,
8-11=-330/441

NOTES (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 298 lb uplift at joint 1, 731 lb uplift at joint 11 and 361 lb uplift at joint 9.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

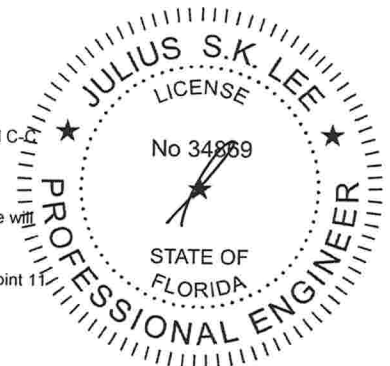

Continued on page 2

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T18G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476669
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:01 2010 Page 1

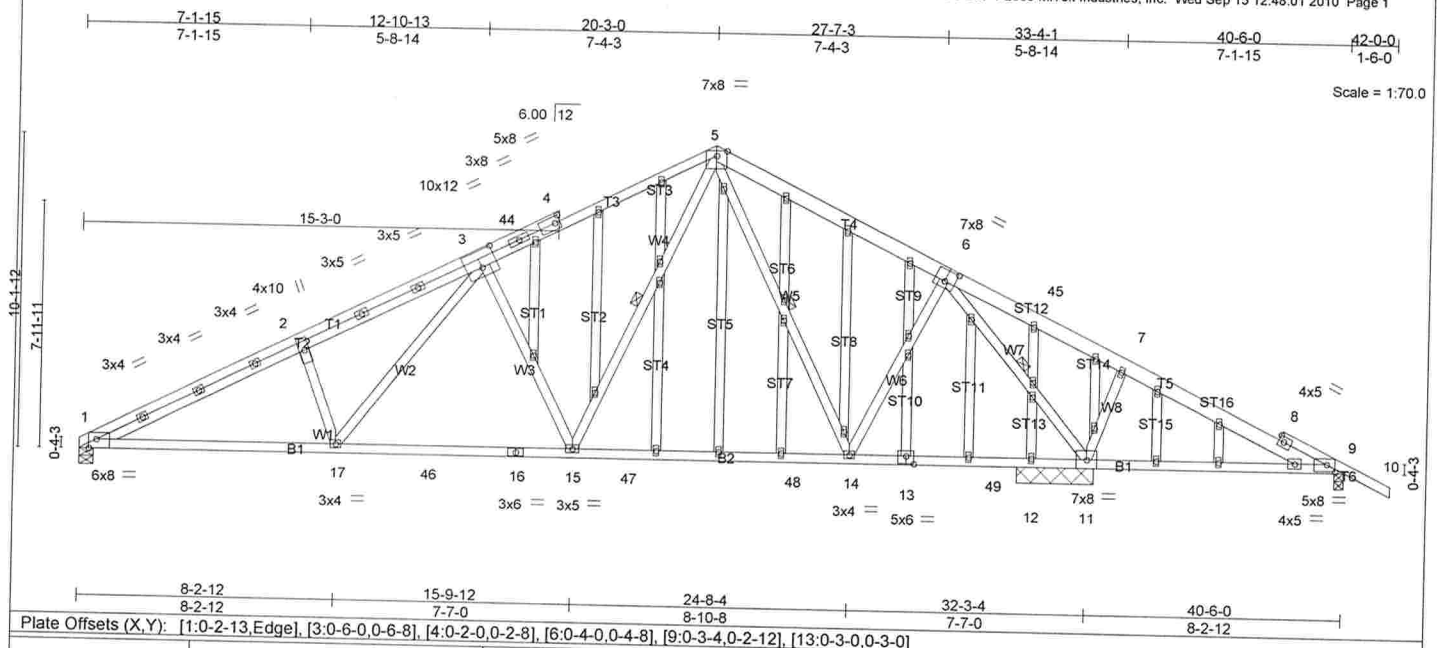

LOADING (psf)		SPACING		CSI		DEFL		PLATES		GRIP	
TCLL	20.0	Plates Increase	2-0-0	TC	0.95	in (loc)	l/defl	L/d	MT20	244/190	
TCDL	7.0	Lumber Increase	1.25	BC	0.77	Vert(LL)	-0.30 14-15	>999			
BCLL	0.0	Rep Stress Incr	NO	WB	0.89	Vert(TL)	-0.44 14-15	>824			
BCDL	5.0	Code FBC2007/TPI2002		(Matrix)		Horz(TL)	0.09 11	n/a			
						Wind(LL)	0.23 9-11	>418			
									Weight: 352 lb		

LUMBER

TOP CHORD 2 X 4 SYP No.2 *Except*
T4, T5: 2 X 6 SYP No.1D
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD
WEBS

Structural wood sheathing directly applied.
Rigid ceiling directly applied or 4-11-7 oc bracing.
1 Row at midpt 5-14, 6-11, 5-15

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

All bearings 2-5-8 except (jt=length) 1=0-5-8, 9=0-3-8.
(lb) - Max Horz 1=-231(LC 7)
Max Uplift All uplift 100 lb or less at joint(s) except 1=-826(LC 6), 11=-2029(LC 7), 9=-375(LC 7)
Max Grav All reactions 250 lb or less at joint(s) 12 except 1=1443(LC 1), 11=2980(LC 1), 9=317(LC 11)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2812/2013, 2-3=-2685/2071, 3-44=-2241/1829, 4-44=-2213/1831, 4-5=-2080/1777,
5-6=-1694/1432, 6-45=-628/997, 7-45=-514/736, 7-8=-583/777, 8-9=-518/570
BOT CHORD 1-17=-1611/2456, 17-46=-1381/2217, 16-46=-1381/2217, 15-16=-1381/2217,
15-47=-676/1427, 47-48=-676/1427, 14-48=-676/1427, 13-14=-528/1059,
13-49=-528/1059, 12-49=-528/1059, 11-12=-528/1059, 9-11=-551/626
WEBS 5-14=-309/240, 6-14=-187/593, 6-11=-2996/2294, 7-11=-582/677, 5-15=-781/1074,
3-15=-783/852, 3-17=-249/333, 2-17=-158/261

NOTES (12-13)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 826 lb uplift at joint 1, 2029 lb uplift at joint 11 and 375 lb uplift at joint 9.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

Continued on page 2
LOAD CASE(S) Standard

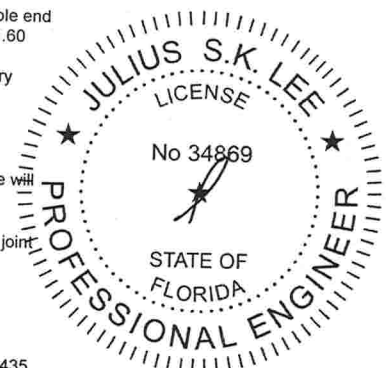

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MIT-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult - ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T17G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	I4476667
Builders FrstSource, Lake City, FL 32055			Job Reference (optional) 7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:48:00 2010 Page 2			
<p>LOAD CASE(S) Standard</p> <p>1) Regular: Lumber Increase=1.25, Plate Increase=1.25</p> <p>Uniform Loads (plf)</p> <p>Vert: 1-5=-54, 5-6=-126(F=-72), 6-45=-126(F=-72), 11-45=-99(F=-45), 2-46=-10, 18-46=-50, 18-47=-10, 47-48=-50, 15-48=-10, 15-49=-50, 10-49=-10</p>						



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Oro Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T17	Truss Type COMMON	Qty 6	Ply 1	ADAMS CONST. - CONNER RES.	1447666
---------------	--------------	----------------------	----------	----------	----------------------------	---------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:59 2010 Page 1

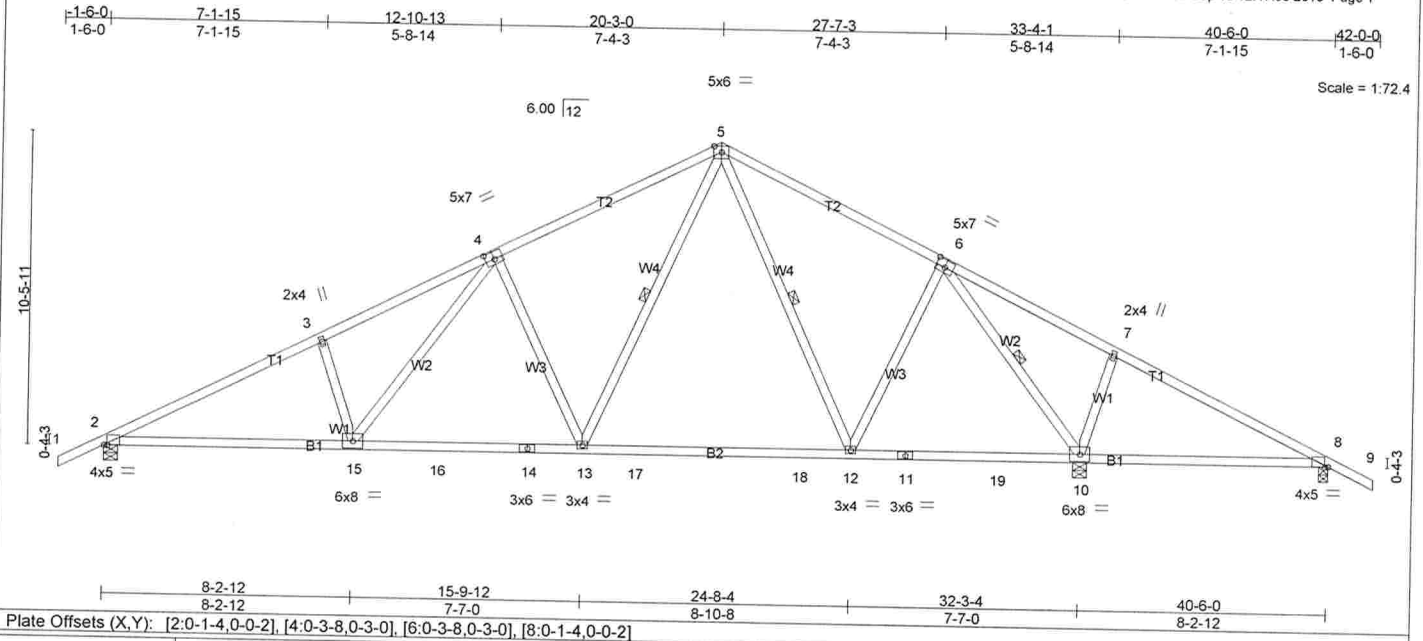

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.60	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.57	Vert(LL) -0.25 12-13 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.56	Vert(TL) -0.38 12-13 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.06 10 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.35 8-10 >279 240		
				Weight: 218 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD
WEBS

Structural wood sheathing directly applied or 3-11-7 oc purlins.
Rigid ceiling directly applied or 6-0-0 oc bracing.
1 Row at midpt 5-12, 6-10, 5-13

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1227/0-5-8, 10=1879/0-5-8, 8=99/0-3-8
Max Horz 2=-184(LC 7)
Max Uplift 2=-434(LC 6), 10=-616(LC 7), 8=-259(LC 7)
Max Grav 2=1227(LC 1), 10=1879(LC 1), 8=183(LC 11)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2093/1280, 3-4=-1967/1366, 4-5=-1430/1069, 5-6=-960/753, 6-7=-155/578, 7-8=-257/497
BOT CHORD 2-15=-934/1781, 15-16=-604/1434, 14-16=-604/1434, 13-14=-604/1434, 13-17=-106/854, 17-18=-106/854, 12-18=-106/854, 11-12=-40/556, 11-19=-40/556, 10-19=-40/556, 8-10=-360/394
WEBS 6-12=-52/545, 6-10=-1756/976, 7-10=-324/437, 5-13=-572/861, 4-13=-566/625, 4-15=-382/466, 3-15=-269/373

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 434 lb uplift at joint 2, 616 lb uplift at joint 10 and 259 lb uplift at joint 8.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

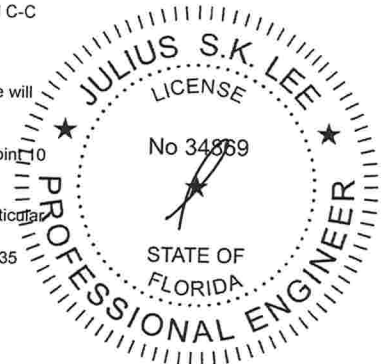

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T15G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476663
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:57 2010 Page 1

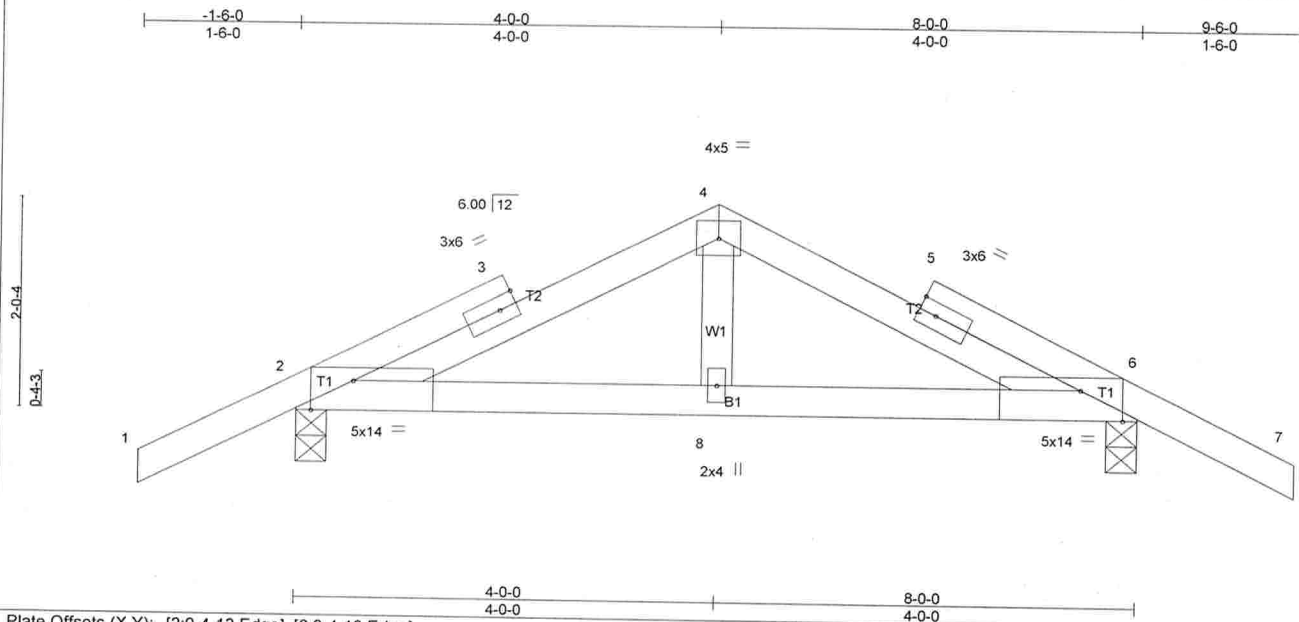

Scale = 1:20.8

Plate Offsets (X,Y): [2:0-4-13,Edge], [6:0-4-13,Edge]

LOADING (psf)	SPACING	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.47	Vert(LL) -0.01	8	>999	360		MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.13	Vert(TL) -0.02	8	>999	240			
BCLL 0.0	Rep Stress Incr NO	WB 0.04	Horz(TL) -0.01	6	n/a	n/a			
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)	Wind(LL) 0.04	6-8	>999	240			
								Weight: 37 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 6-7-12 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=583/0-3-8, 6=583/0-3-8
Max Horz 2=-65(LC 7)
Max Uplift 2=-691(LC 6), 6=-691(LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-555/1180, 3-4=-484/1116, 4-5=-484/1116, 5-6=-555/1180
BOT CHORD 2-8=-873/437, 6-8=-873/437
WEBS 4-8=-320/133

NOTES (11-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=691 6=691.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 2-6=-10, 1-4=-99(F=-45), 4-7=-99(F=-45)

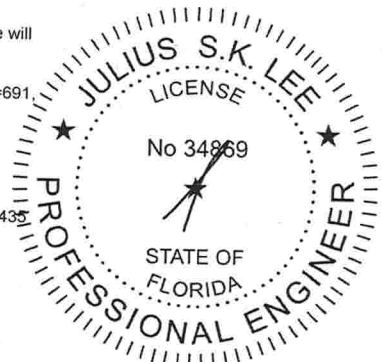

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T14G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476661
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:57 2010 Page 1

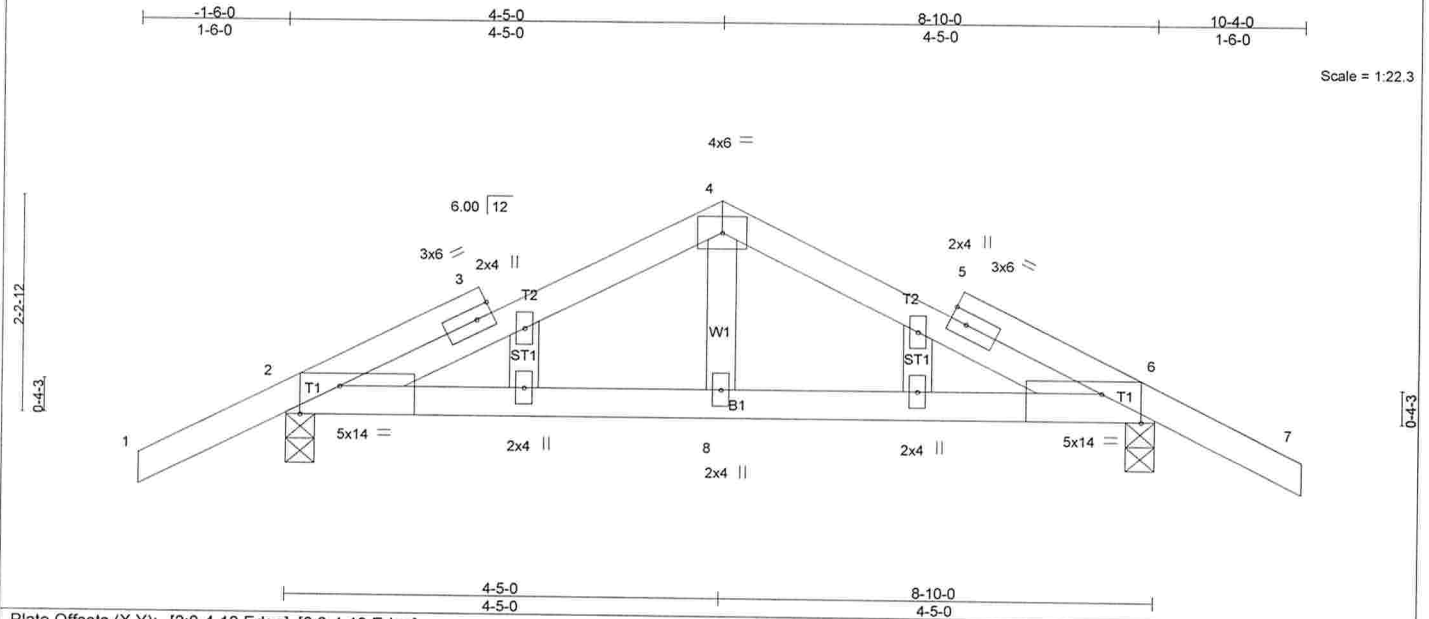


Plate Offsets (X, Y): [2:0-4-13, Edge], [6:0-4-13, Edge]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.21	Vert(LL) -0.01 8 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.05	Vert(TL) -0.03 2-8 >999 240		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) -0.01 6 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.07 2-8 >999 240		
				Weight: 42 lb	

LUMBER
TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3
OTHERS 2 X 4 SYP No.3

BRACING
TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 6-0-14 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=628/0-3-8, 6=628/0-3-8
Max Horz 2=-69(LC 7)
Max Uplift 2=-741(LC 6), 6=-741(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-633/1321, 3-4=-561/1260, 4-5=-561/1260, 5-6=-633/1321
BOT CHORD 2-8=-993/502, 6-8=-993/502
WEBS 4-8=-368/152

NOTES (11-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=741, 6=741.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 2-6=-10, 1-4=-99(F=-45), 4-7=-99(F=-45)

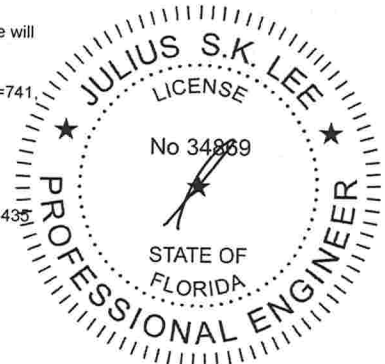

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and 8CSI1 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T13G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476659
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:56 2010 Page 2

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-99(F=-45), 5-9=-99(F=-45), 2-8=-10

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component.
Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T13	Truss Type COMMON	Qty 5	Ply 1	ADAMS CONST. - CONNER RES.	14476658
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:56 2010 Page 1


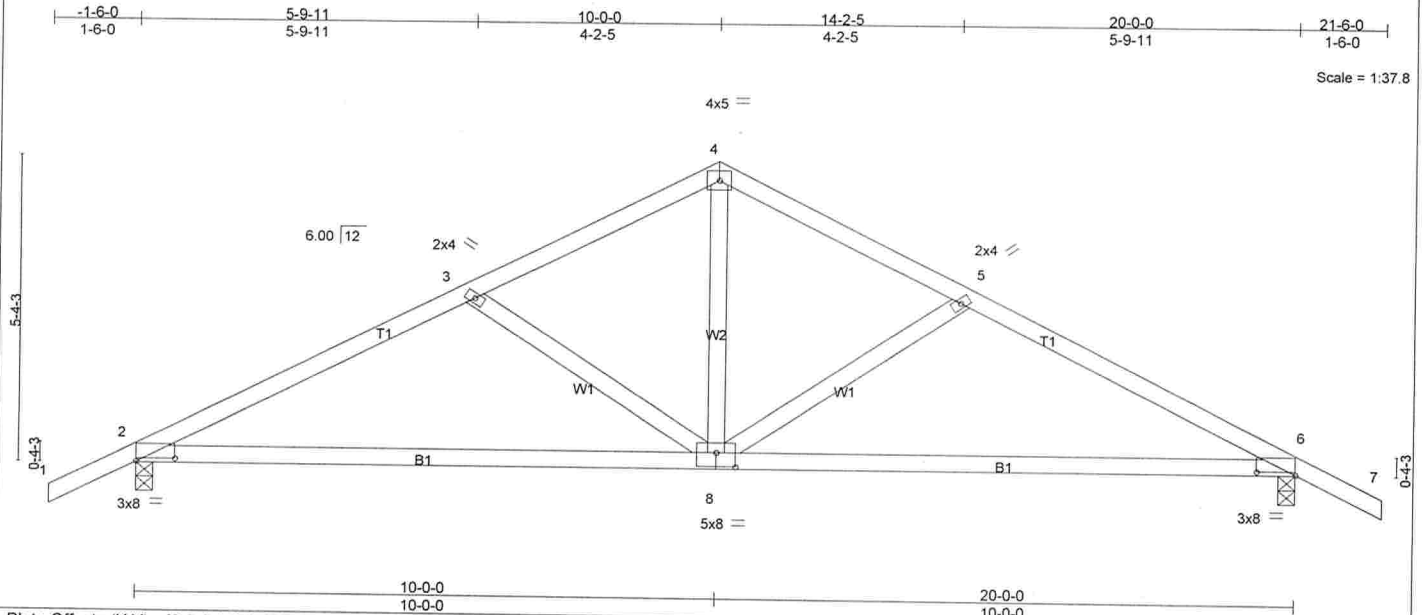


Plate Offsets (X,Y): [2:0-8-0,0-0-10], [6:0-8-0,0-0-10], [8:0-4-0,0-3-0]					
LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCDL 20.0	2-0-0	TC 0.52	in (loc) l/defl L/d	MT20	244/190
BCLL 7.0	Plates Increase 1.25	BC 0.72	Vert(LL) -0.18 2-8 >999 360		
BCDL 0.0	Lumber Increase 1.25	WB 0.53	Vert(TL) -0.33 2-8 >725 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) -0.04 6 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.66 2-8 >356 240		
				Weight: 90 lb	

LUMBER	BRACING
TOP CHORD 2 X 4 SYP No.2	TOP CHORD
BOT CHORD 2 X 4 SYP No.2	BOT CHORD
WEBS 2 X 4 SYP No.3	
	Structural wood sheathing directly applied or 5-11-3 oc purlins. Rigid ceiling directly applied or 4-2-6 oc bracing.
	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.
REACTIONS (lb/size) 2=720/0-3-8, 6=720/0-3-8	
Max Horz 2=108(LC 6)	
Max Uplift 2=-616(LC 6), 6=-616(LC 7)	
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-1049/1734, 3-4=-768/1545, 4-5=-768/1545, 5-6=-1049/1734	
BOT CHORD 2-8=-1381/875, 6-8=-1381/875	
WEBS 4-8=-1195/446, 5-8=-302/417, 3-8=-302/417	

- NOTES** (8-9)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SYP No.2.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=616, 6=616.
 - "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
 - Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

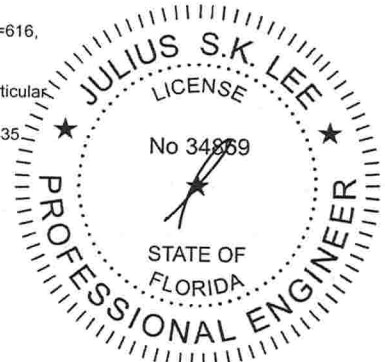

September 15, 2010


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T11	Truss Type MONO HIP	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476656
---------------	--------------	------------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)
7:140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:55 2010 Page 1

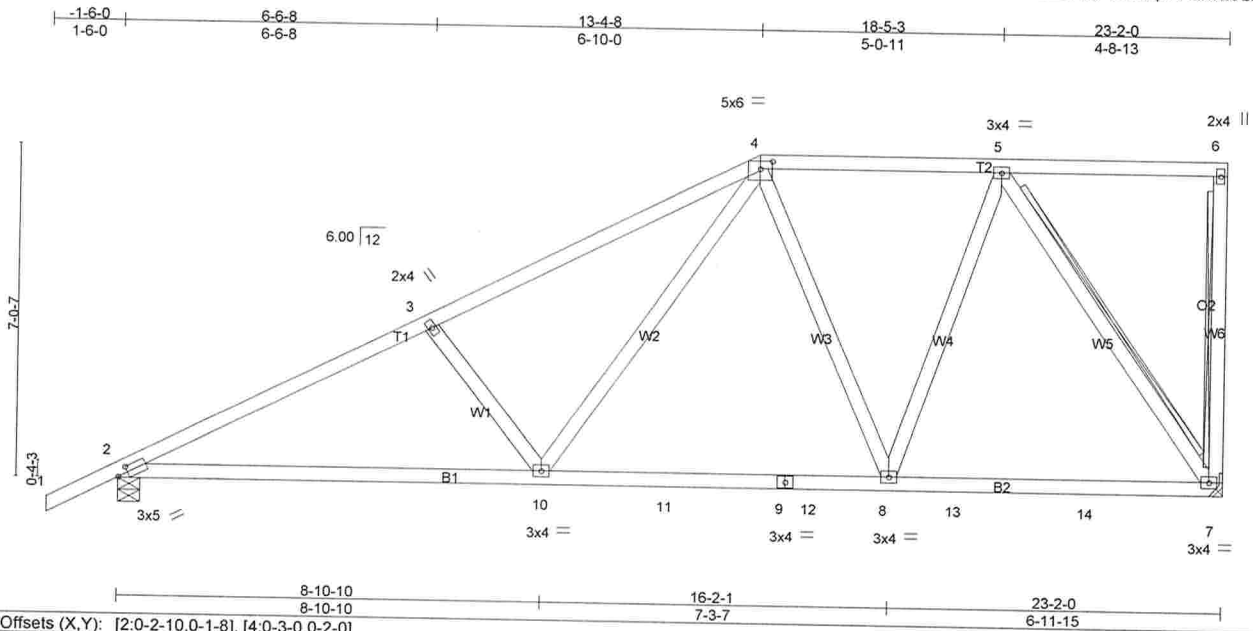

Scale = 1:45.9

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.42	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.43	Vert(LL) -0.14 2-10 >999 360		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.44	Vert(TL) -0.26 2-10 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.03 7 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.07 10 >999 240		
				Weight: 133 lb	

LUMBER
TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING
TOP CHORD
BOT CHORD
WEBS

Structural wood sheathing directly applied or 5-0-5 oc purlins, except end verticals.
Rigid ceiling directly applied or 6-2-15 oc bracing.
T-Brace: 2 X 4 SYP No.3 - 6-7, 5-7
Fasten T and I braces to narrow edge of web with 10d Common wire nails, 9in o.c., with 4in minimum end distance.
Brace must cover 90% of web length.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


REACTIONS (lb/size) 7=882/Mechanical, 2=898/0-5-8
Max Horz 2=318(LC 6)
Max Uplift 7=282(LC 5), 2=326(LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1423/799, 3-4=-1210/749, 4-5=-646/429
BOT CHORD 2-10=-1032/1201, 10-11=-549/730, 9-11=-549/730, 9-12=-549/730, 8-12=-549/730,
8-13=-348/500, 13-14=-348/500, 7-14=-348/500
WEBS 3-10=-338/458, 4-10=-378/485, 4-8=-218/311, 5-8=-256/460, 5-7=-875/614

NOTES (10-12)

- 1) Wind: ASCE 7-05; 110mph (3-second gust); TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- 5) All bearings are assumed to be SYP No.2.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=282, 2=326.
- 8) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
- 10) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- 11) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435
- 12) Use Simpson HTU26 to attach Truss to Carrying member

LOAD CASE(S) Standard

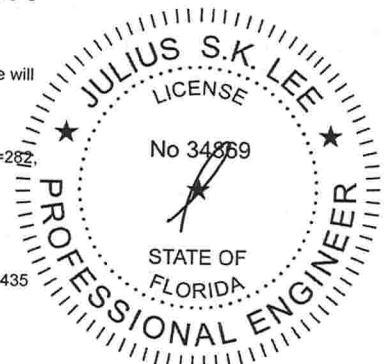

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T09	Truss Type MONO HIP	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476654
---------------	--------------	------------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:54 2010 Page 1

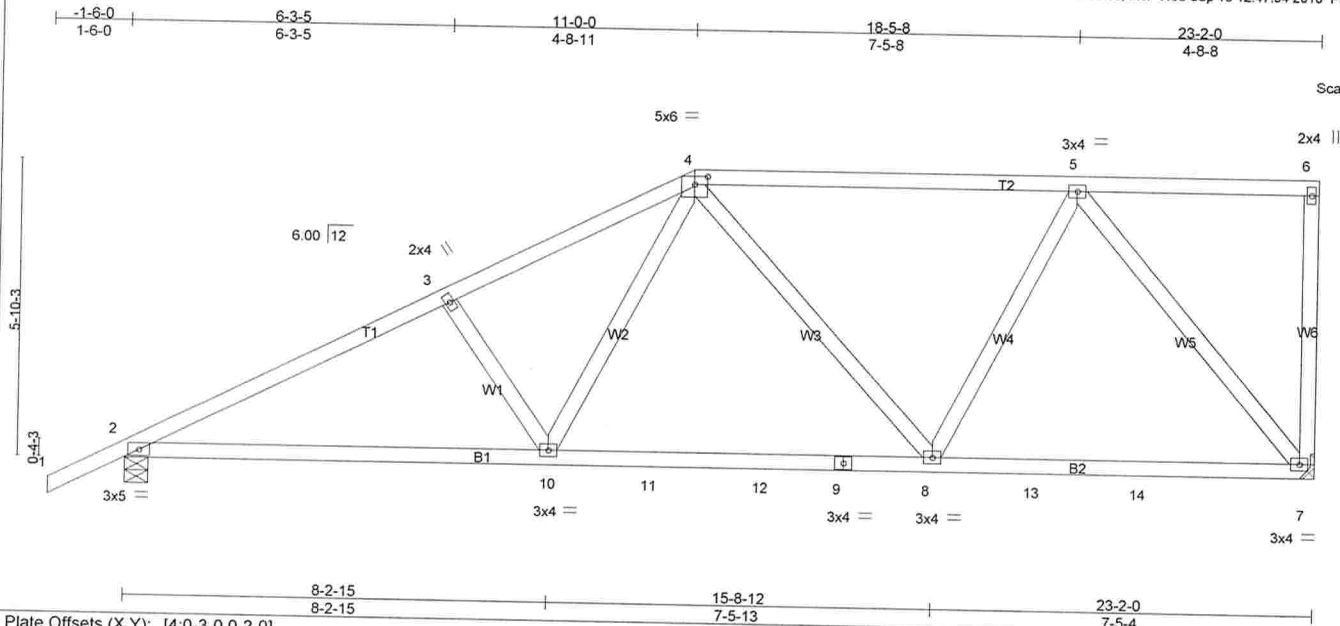


Plate Offsets (X,Y): [4-0-3,0,0-2-0]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.45	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.37	Vert(LL) -0.10 2-10 >999 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.84	Vert(TL) -0.20 2-10 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.03 7 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.06 10 >999 240		
				Weight: 125 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD

Structural wood sheathing directly applied or 5-1-5 oc purlins, except end verticals.

BOT CHORD

Rigid ceiling directly applied or 6-5-12 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 7=834/Mechanical, 2=885/0-5-8
Max Horz 2=270(LC 6)
Max Uplift 7=286(LC 5), 2=322(LC 6)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1386/809, 3-4=-1210/791, 4-5=-742/490
BOT CHORD 2-10=-960/1163, 10-11=-649/856, 11-12=-649/856, 9-12=-649/856, 8-9=-649/856,
8-13=-421/588, 13-14=-421/588, 7-14=-421/588
WEBS 3-10=-250/347, 4-10=-272/384, 5-8=-156/348, 5-7=-915/664

NOTES (9-11)

- 1) Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- 5) All bearings are assumed to be SYP No.2.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=286, 2=322.
- 8) "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- 9) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- 10) Truss Design Engineer: Julius Lee, PE; Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33436
- 11) Use Simpson HTU26 to attach Truss to Carrying member

LOAD CASE(S) Standard

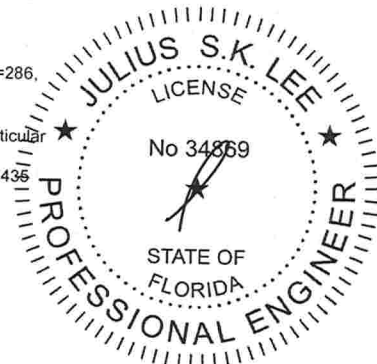

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T07G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES. Job Reference (optional)	I4476652
---------------	---------------	---------------------	----------	----------	--	----------

Builders FrstSource, Lake City, FL 32055 7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:54 2010 Page 2

13) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

14) Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-5=-99(F=-45), 5-9=-99(F=-45), 2-32=-10, 32-33=-50, 8-33=-10



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T07	Truss Type FINK	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	I4476651
---------------	--------------	--------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:53 2010 Page 1

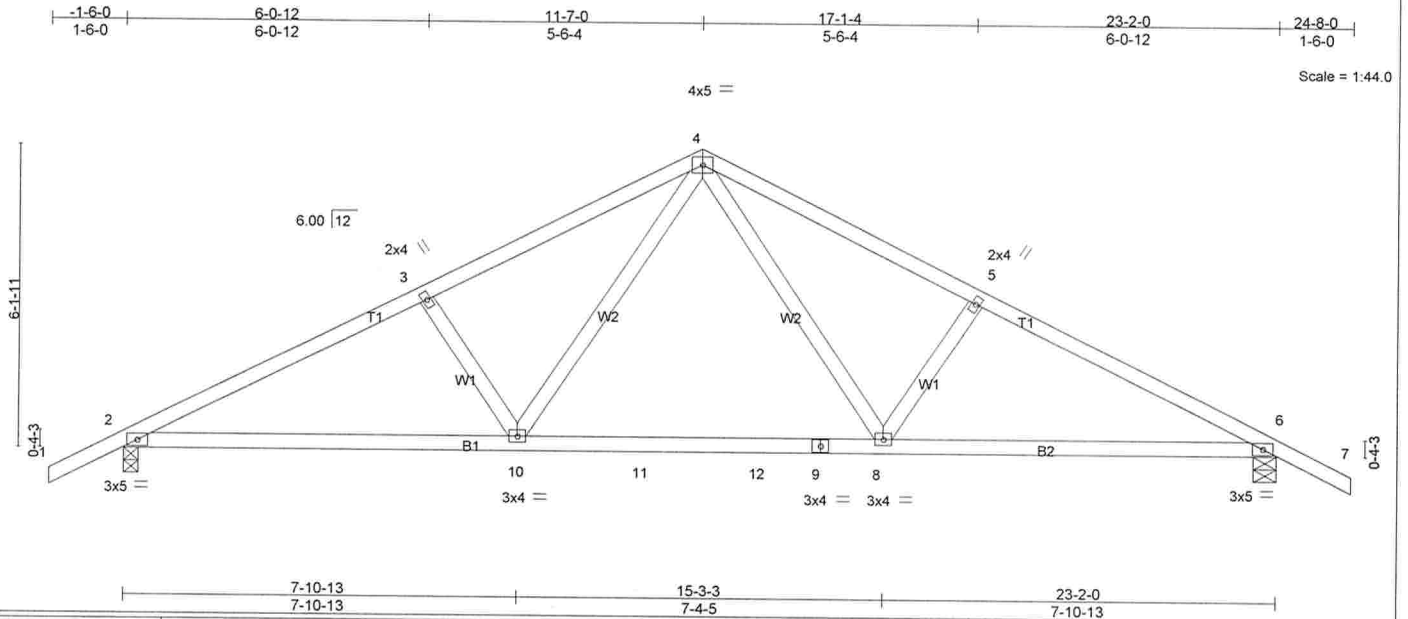

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.34	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.39	Vert(LL) -0.14 8-10 >999 360		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.27	Vert(TL) -0.19 8-10 >999 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.04 6 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.08 8-10 >999 240		
				Weight: 108 lb	

LUMBER
TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING
TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-1-15 oc purlins.
Rigid ceiling directly applied or 7-9-9 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


REACTIONS (lb/size) 6=870/0-5-8, 2=865/0-3-8
Max Horz 2=120(LC 6)
Max Uplift 6=342(LC 7), 2=337(LC 6)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1385/945, 3-4=-1214/931, 4-5=-1205/924, 5-6=-1375/936
BOT CHORD 2-10=-662/1171, 10-11=-285/780, 11-12=-285/780, 9-12=-285/780, 8-9=-285/780, 6-8=-650/1158
WEBS 3-10=-295/380, 4-10=-325/458, 4-8=-314/446, 5-8=-285/370

NOTES (8-9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=342, 2=337.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

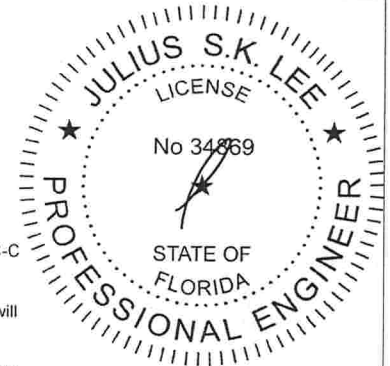

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T05	Truss Type COMMON	Qty 2	Ply 1	ADAMS CONST. - CONNER RES.	14476649
---------------	--------------	----------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:52 2010 Page 1

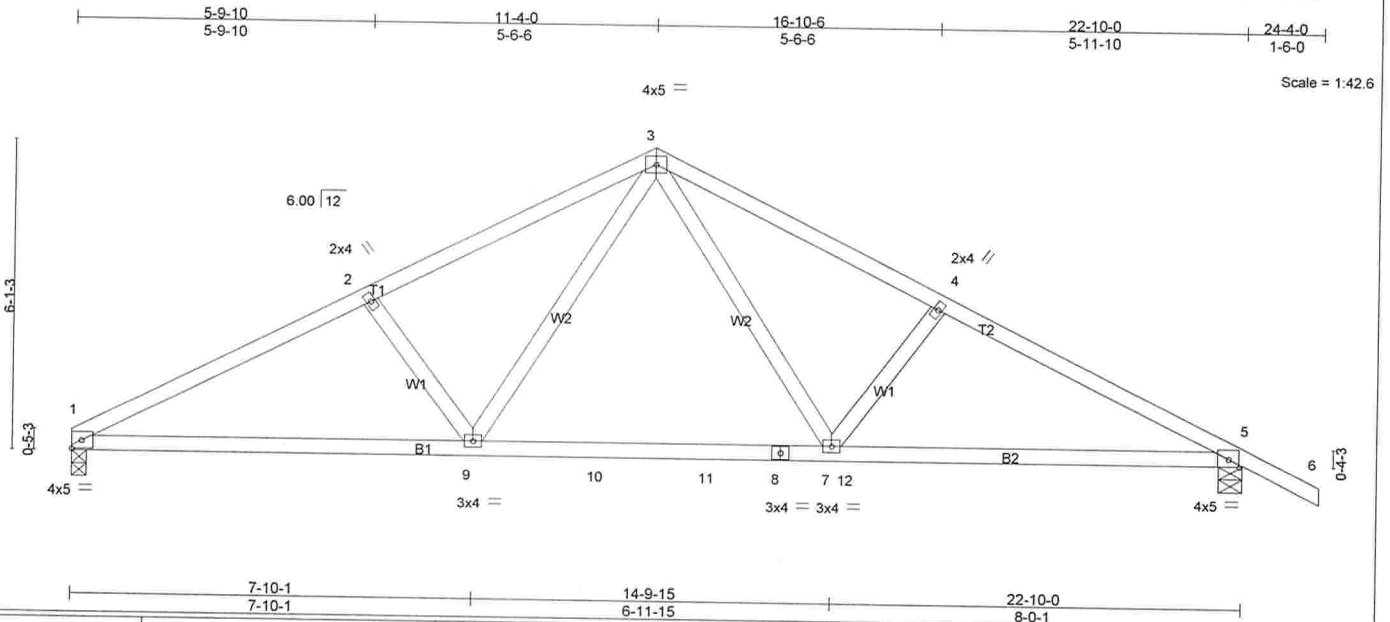

LOADING (psf)	SPACING	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.44	Vert(LL)	-0.30	7-9	>901	360	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.79	Vert(TL)	-0.42	7-9	>637	240		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.36	Horz(TL)	0.05	5	n/a	n/a		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Wind(LL)	0.22	7-9	>999	240		
	Code FBC2007/TPI2002							Weight: 104 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-5-3 oc purlins.
Rigid ceiling directly applied or 6-7-3 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 1=976/0-3-8, 5=1081/0-5-8
Max Horz 1=-131(LC 7)
Max Uplift 1=-292(LC 6), 5=-395(LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1851/1197, 2-3=-1673/1165, 3-4=-1681/1150, 4-5=-1860/1181
BOT CHORD 1-9=-890/1578, 9-10=-439/1085, 10-11=-439/1085, 8-11=-439/1085, 7-8=-439/1085,
7-12=-867/1585, 5-12=-867/1585
WEBS 3-7=-425/697, 4-7=-264/359, 3-9=-446/681, 2-9=-269/380


NOTES (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 5.0psf.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 292 lb uplift at joint 1 and 395 lb uplift at joint 5.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

1) Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)

Vert: 1-3=-54, 3-6=-54, 1-9=-10, 9-10=-70(F=-60), 10-11=-110(F=-60), 11-12=-70(F=-60), 5-12=-10

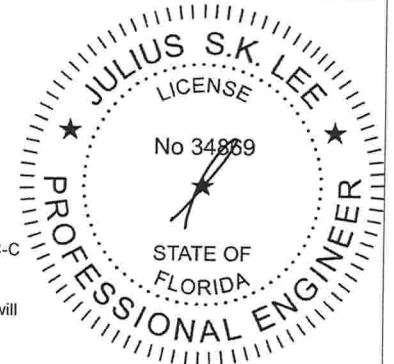

September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MH-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, DSB-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T04	Truss Type ATTIC	Qty 5	Ply 1	ADAMS CONST. - CONNER RES.	14476648
---------------	--------------	---------------------	----------	----------	----------------------------	----------

Builders FrstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:52 2010 Page 1

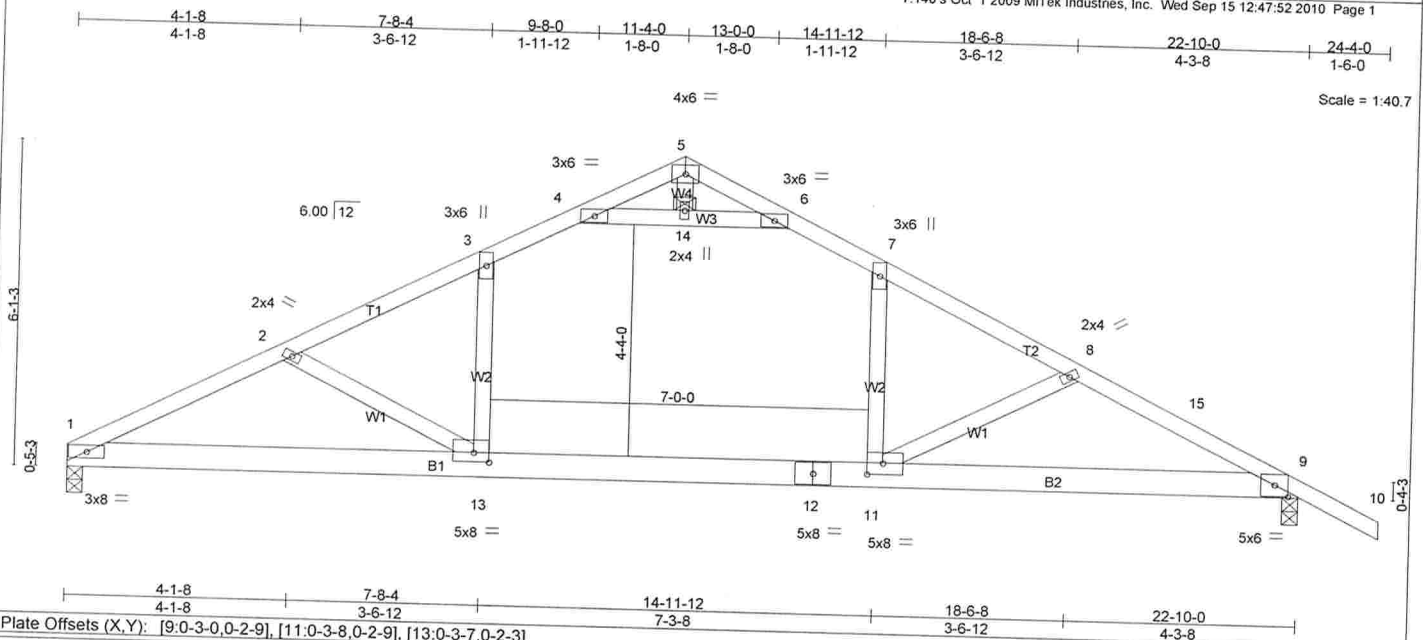

LOADING (psf)		SPACING		CSI		DEFL		PLATES		GRIP	
TCLL	20.0	Plates Increase	2-0-0	TC	0.93	in (loc)	l/defl	L/d	MT20	244/190	
TCDL	7.0	Lumber Increase	1.25	BC	0.69	Vert(LL)	-0.36 11-13	>755			
BCLL	0.0	Rep Stress Incr	NO	WB	0.47	Vert(TL)	-0.62 11-13	>436			
BCDL	5.0	Code FBC2007/TPI2002		(Matrix)		Horz(TL)	0.05 9	n/a			
						Wind(LL)	0.32 11	>855			
									Weight: 123 lb		

LUMBER

TOP CHORD 2 X 4 SYP M 31
BOT CHORD 2 X 6 SYP No.1D
WEBS 2 X 4 SYP No.3 *Except*
W2: 2 X 4 SYP No.2

BRACING

TOP CHORD
BOT CHORD
WEBS

Structural wood sheathing directly applied or 3-5-13 oc purlins.
Rigid ceiling directly applied or 7-10-1 oc bracing.
1 Row at midpt 4-6

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 1=1272/0-3-8, 9=1577/0-3-8
Max Horz 1=-135(LC 7)
Max Uplift 1=-179(LC 6), 9=-366(LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2666/1045, 2-3=-2355/857, 3-4=-1903/815, 4-5=-133/579, 5-6=-154/609,
6-7=-1918/818, 7-8=-2439/905, 8-15=-2905/1262, 9-15=-3034/1282
BOT CHORD 1-13=-780/2328, 12-13=-467/1995, 11-12=-467/1995, 9-11=-1006/2680
WEBS 4-14=-2682/1069, 6-14=-2682/1069, 3-13=-160/769, 7-11=-91/702, 2-13=-400/356,
8-11=-797/613

NOTES (12-13)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 3-4, 6-7, 4-14, 6-14; Wall dead load (5.0psf) on member(s). 3-13, 7-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
- All bearings are assumed to be SYP No.2
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 1 and 366 lb uplift at joint 9.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Attic room checked for L/360 deflection.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25

Continued on page 2



September 15, 2010

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component.
Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Oro Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T02	Truss Type SPECIAL	Qty 4	Ply 1	ADAMS CONST. - CONNER RES.	14476646
---------------	--------------	-----------------------	----------	----------	----------------------------	----------


Builders FrstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:51 2010 Page 1



Scale = 1:43.3

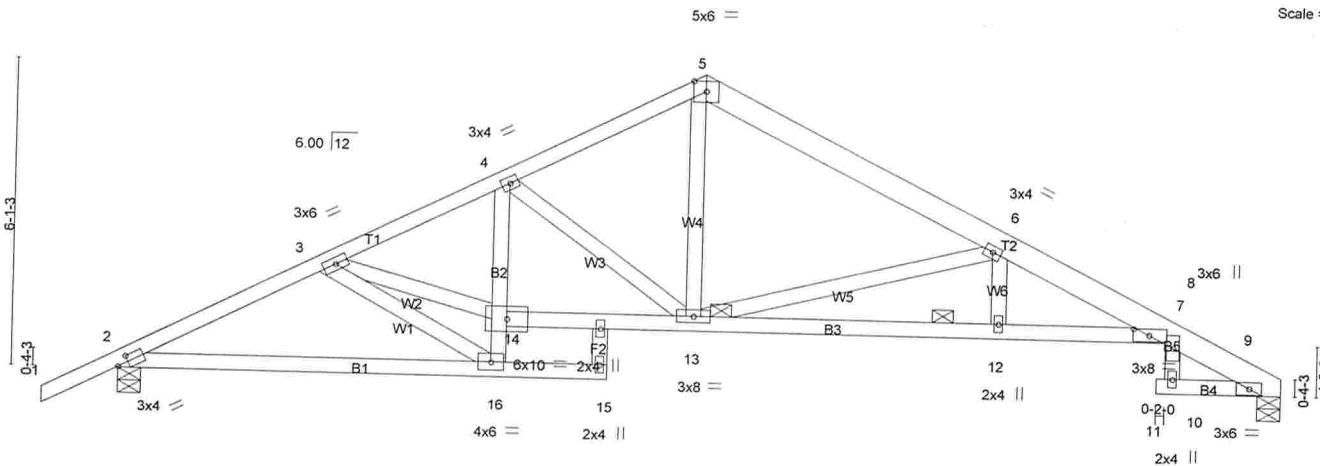

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.74	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.75	Vert(LL) -0.15 15 >999 360		
BCLL 0.0 *	Lumber Increase 1.25	WB 0.62	Vert(TL) -0.29 15 >909 240		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.21 9 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.23 15 >999 240		
				Weight: 131 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2 *Except*
T2: 2 X 6 SYP No.1D
BOT CHORD 2 X 4 SYP No.2 *Except*
B2,B5: 2 X 4 SYP No.3
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-6-4 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
7-4-7 oc bracing: 2-16,
5-8-0 oc bracing: 7-14
9-8-0 oc bracing: 14-16

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

(lb/size) 9=716/0-5-8, 2=821/0-5-8
Max Horz 2=131(LC 6)
Max Uplift 9=229(LC 7), 2=330(LC 6)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1292/934, 3-4=-1431/1034, 4-5=-1020/813, 5-6=-1041/780, 6-7=-1815/1337,
8-9=-599/458
BOT CHORD 2-16=-736/1090, 14-16=-336/581, 4-14=-131/334, 13-14=-757/1276, 12-13=-1178/1720,
7-12=-1178/1720
WEBS 3-16=-1054/764, 3-14=-694/1114, 4-13=-499/423, 5-13=-454/621, 6-13=-902/808

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 229 lb uplift at joint 9 and 330 lb uplift at joint 2.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

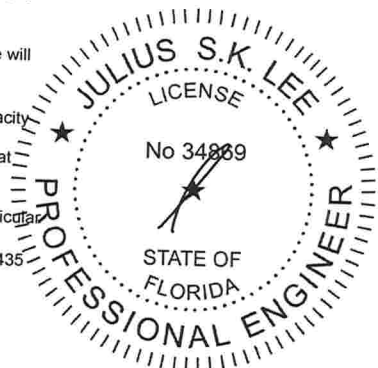

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 BEFORE USE.
Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component.
Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, DSB-89 and 8CSI1 Building Component Safety Information available from Truss Plate Institute, 583 D'Oonofrio Drive, Madison, WI 53719.

Your Company Name

Job 344737	Truss T01G	Truss Type GABLE	Qty 1	Ply 1	ADAMS CONST. - CONNER RES.	14476645
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:50 2010 Page 1

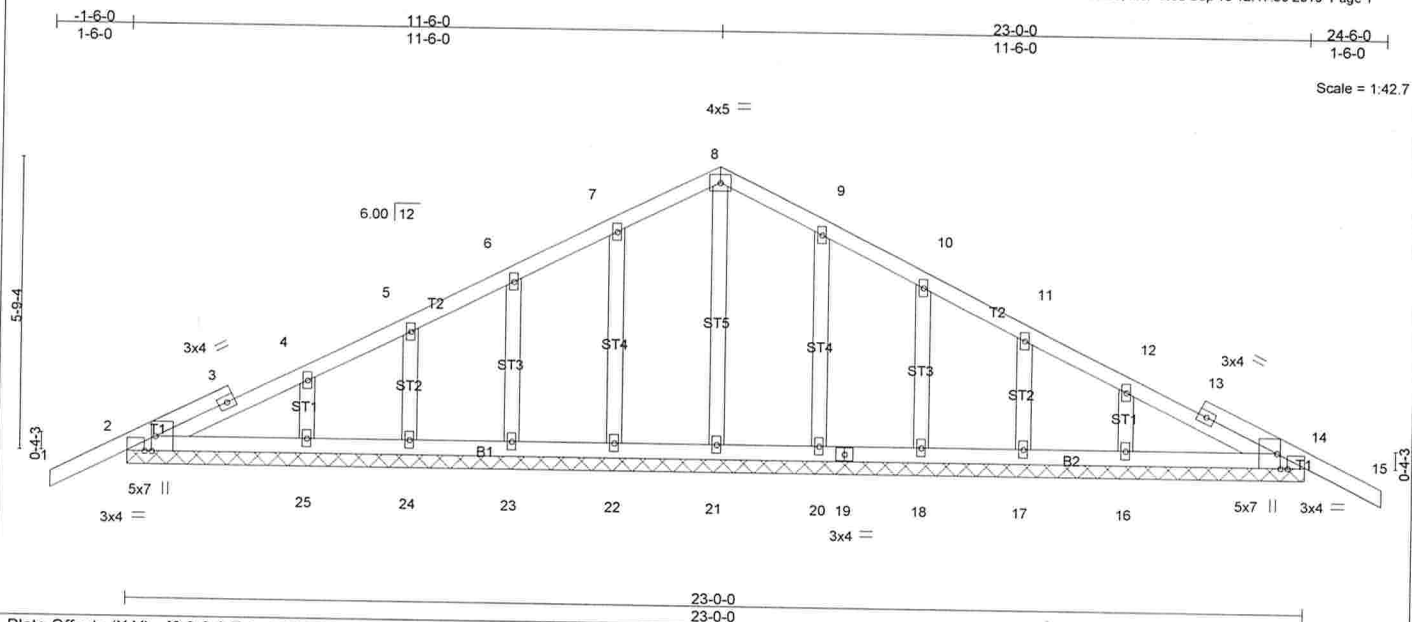


Plate Offsets (X,Y): [2:0-3-8,Edge], [2:0-2-8,Edge], [14:0-3-8,Edge], [14:0-2-8,Edge]

LOADING (psf)	SPACING	CSI	DEFL	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 2-0-0	TC 0.28	Vert(LL) -0.01	15	n/r	120	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.06	Vert(TL) -0.01	15	n/r	90		
BCLL 0.0	Rep Stress Incr NO	WB 0.10	Horz(TL) 0.01	14	n/a	n/a		
BCDL 5.0	Code FBC2007/TPI2002	(Matrix)						

Weight: 123 lb

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
OTHERS 2 X 4 SYP No.3

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS

All bearings 23-0-0.
(lb) - Max Horz 2=131(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) except 2=267(LC 6), 14=287(LC 7), 22=184(LC 6), 23=180(LC 6), 24=170(LC 6), 25=210(LC 6), 20=182(LC 7), 18=181(LC 7), 17=168(LC 7), 16=216(LC 7)
Max Grav All reactions 250 lb or less at joint(s) 21, 22, 23, 24, 20, 18, 17 except 2=349(LC 10), 14=349(LC 11), 25=311(LC 10), 16=311(LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 7-8=-47/266, 8-9=-47/266


WEBS 4-25=-275/262, 12-16=-275/262

NOTES (13-14)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1-2002.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 267 lb uplift at joint 2, 287 lb uplift at joint 14, 184 lb uplift at joint 22, 180 lb uplift at joint 23, 170 lb uplift at joint 24, 210 lb uplift at joint 25, 182 lb uplift at joint 20, 181 lb uplift at joint 18, 168 lb uplift at joint 17 and 216 lb uplift at joint 16.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

Continued on page 2

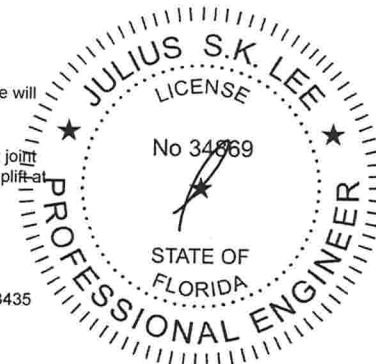

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and 8CSI1 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Your Company Name

Job 344737	Truss T01B	Truss Type ATTIC	Qty 2	Ply 1	ADAMS CONST. - CONNER RES.	14476644
---------------	---------------	---------------------	----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 Mitek Industries, Inc. Wed Sep 15 12:47:50 2010 Page 1

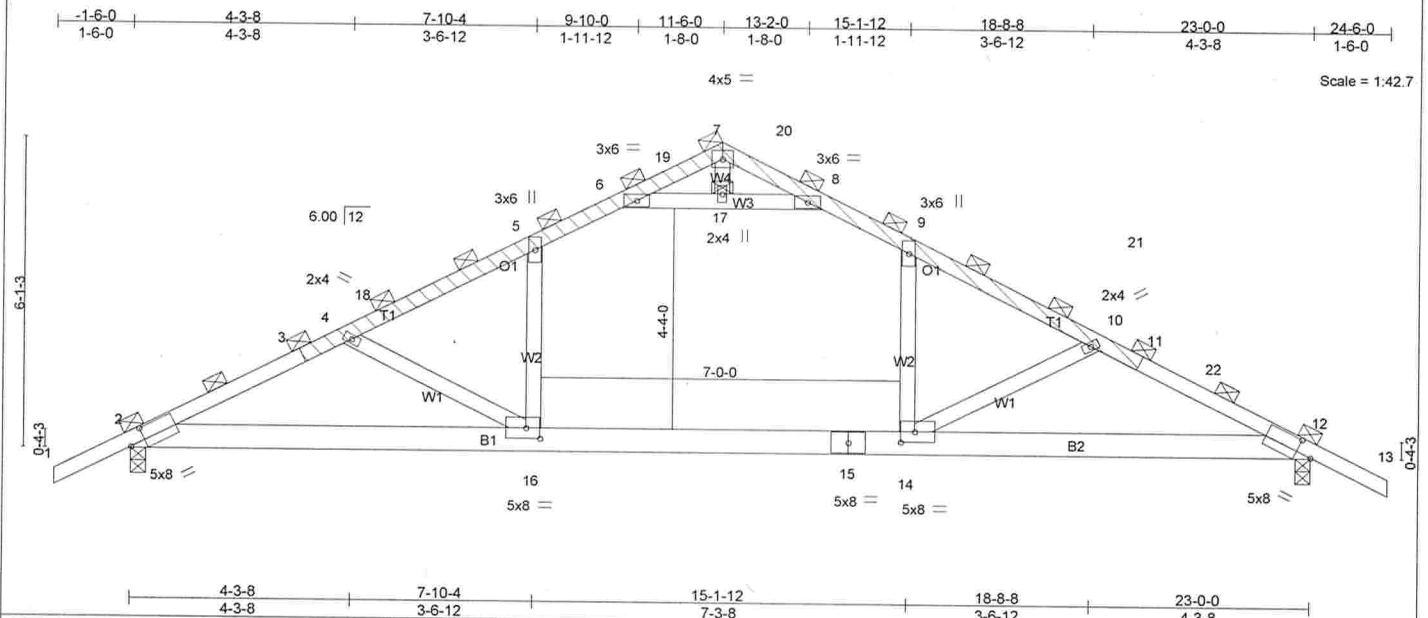

LOADING (psf)		SPACING		CSI		DEFL		PLATES		GRIP	
TCLL	20.0	Plates Increase	2-6-0	TC	0.58	in (loc)	l/defl	L/d	MT20	244/190	
TCDL	7.0	Lumber Increase	1.25	BC	0.75	Vert(LL)	-0.33 14-16	>820			
BCLL	0.0	Rep Stress Incr	NO	WB	0.57	Vert(TL)	-0.57 14-16	>482			
BCDL	5.0	Code FBC2007/TPI2002		(Matrix)		Horz(TL)	0.06 12	n/a			
						Wind(LL)	0.20 12-14	>999			
									Weight: 154 lb		


LUMBER		BRACING	
TOP CHORD	2 X 4 SYP M 31	TOP CHORD	2-0-0 oc purlins (4-0-1 max.)
BOT CHORD	2 X 6 SYP No.1D		(Switched from sheeted: Spacing > 2-0-0).
WEBS	2 X 4 SYP No.3 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
	W2: 2 X 4 SYP No.2	WEBS	1 Row at midpt 6-8
OTHERS	2 X 4 SYP M 31	JOINTS	1 Brace at Jt(s): 7
LBR SCAB	3-7 2 X 4 SYP M 31 one side		
	7-11 2 X 4 SYP M 31 one side		

REACTIONS (lb/size)	
2=1684/0-3-8, 12=1903/0-3-8	
Max Horz 2=153(LC 5)	
Max Uplift 2=337(LC 5), 12=426(LC 6)	

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-3296/321, 3-4=-3187/338, 4-18=-2891/250, 5-18=-2886/268, 5-6=-2348/300, 6-19=-25/463, 7-19=-20/511, 7-20=-38/555, 8-20=-42/507, 8-9=-2348/287, 9-21=-2981/288, 10-21=-2989/289, 10-11=-3506/467, 11-22=-3528/469, 12-22=-3656/468
BOT CHORD	2-16=-325/2891, 15-16=-126/2455, 14-15=-126/2455, 12-14=-351/3213
WEBS	6-17=-3082/333, 8-17=-3082/333, 5-16=-5/910, 9-14=-1/902, 4-16=-525/227, 10-14=-891/376

- NOTES** (15-16)
- Attached 9-2-7 scab 3 to 7, front face(s) 2 X 4 SYP M 31 with 1 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-0 from end at joint 3, nail 1 row(s) at 7" o.c. for 2-0-0; starting at 4-0-11 from end at joint 3, nail 1 row(s) at 4" o.c. for 5-0-15.
 - Attached 9-2-7 scab 7 to 11, front face(s) 2 X 4 SYP M 31 with 1 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-0 from end at joint 7, nail 1 row(s) at 4" o.c. for 5-0-15; starting at 7-1-9 from end at joint 7, nail 1 row(s) at 7" o.c. for 2-0-0.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise); Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 5-6, 8-9, 6-17, 8-17; Wall dead load (5.0psf) on member(s). 5-16, 9-14
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 14-16
 - All bearings are assumed to be SYP No.2.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 337 lb uplift at joint 2 and 426 lb uplift at joint 12.
 - "Pin all pitchbreaks" Member end fixity model was used in the analysis and design of this truss.
 - Design assumes 4x2 (flat orientation) purlins at oc spacing indicated, fastened to truss TC w/ 2-10d nails.
 - Attic room checked for L/360 deflection.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Continued on page 2

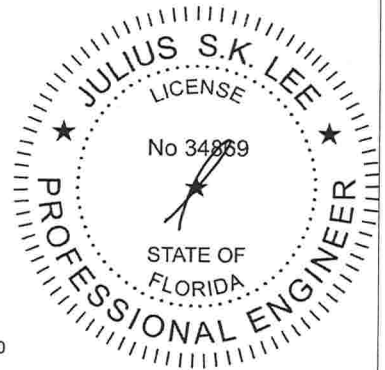


September 15, 2010

Job 344737	Truss T01A	Truss Type ATTIC	Qty 13	Ply 1	ADAMS CONST. - CONNER RES.	14475643
---------------	---------------	---------------------	-----------	----------	----------------------------	----------

Builders FirstSource, Lake City, FL 32055

Job Reference (optional)

7.140 s Oct 1 2009 MiTek Industries, Inc. Wed Sep 15 12:47:49 2010 Page 1

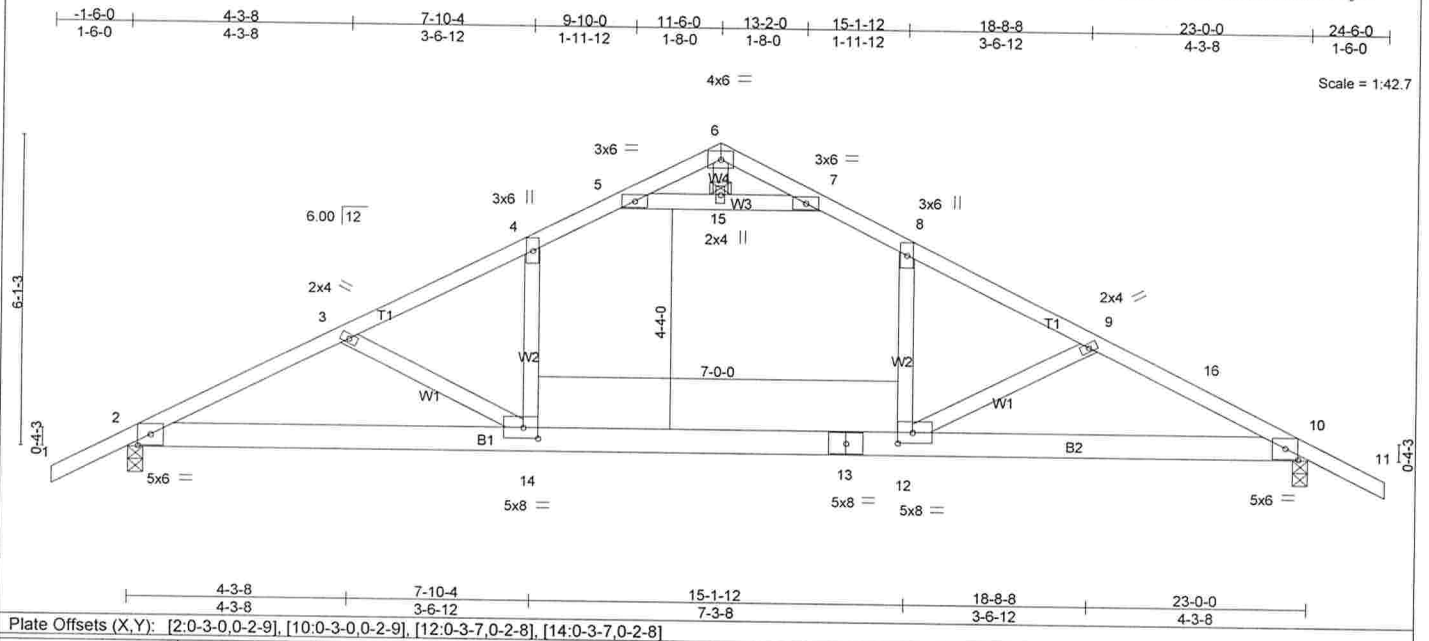

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.94	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.68	Vert(LL) -0.36 12-14 >761 360		
BCLL 0.0	Lumber Increase 1.25	WB 0.48	Vert(TL) -0.62 12-14 >439 240		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.05 10 n/a n/a		
	Code FBC2007/TPI2002		Wind(LL) 0.32 12 >847 240		
				Weight: 127 lb	

LUMBER	BRACING
TOP CHORD 2 X 4 SYP M 31	TOP CHORD Structural wood sheathing directly applied or 3-5-8 oc purlins.
BOT CHORD 2 X 6 SYP No.1D	BOT CHORD Rigid ceiling directly applied or 7-10-3 oc bracing.
WEBS 2 X 4 SYP No.3 *Except*	WEBS 1 Row at midpt 5-7
W2: 2 X 4 SYP No.2	

REACTIONS (lb/size) 2=1366/0-3-8, 10=1584/0-3-8
Max Horz 2=122(LC 6)
Max Uplift 2=277(LC 6), 10=366(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2708/1021, 3-4=-2372/842, 4-5=-1917/808, 5-6=-130/587, 6-7=-153/616,
7-8=-1932/809, 8-9=-2457/895, 9-16=-2922/1254, 10-16=-3051/1274
BOT CHORD 2-14=-753/2378, 13-14=-458/2010, 12-13=-458/2010, 10-12=-999/2695
WEBS 5-15=-2706/1057, 7-15=-2706/1057, 4-14=-142/777, 8-12=-90/709, 3-14=-437/336,
9-12=-796/615

NOTES (12-13)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 5-15, 7-15; Wall dead load (5.0psf) on member(s). 4-14, 8-12
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- All bearings are assumed to be SYP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 277 lb uplift at joint 2 and 366 lb uplift at joint 10.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- Attic room checked for L/360 deflection.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869; Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25

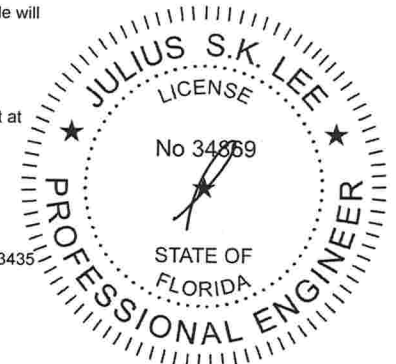

Continued on page 2

September 15, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.







Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Your Company Name



MULTIPLE-MEMBER CONNECTIONS FOR SIDE-LOADED BEAMS

Maximum Uniform Load Applied to Either Outside Member (PLF)

Connector Type	Number of Rows	Connector On-Center Spacing	Connector Pattern					
			Assembly A	Assembly B	Assembly C	Assembly D	Assembly E	Assembly F
								
			3 1/2" 2-ply	5 1/4" 3-ply	5 1/4" 2-ply	7" 3-ply	7" 2-ply	7" 4-ply
10d (0.128" x 3") Nail ⁽¹⁾	2	12"	370	280	280	245		
	3	12"	555	415	415	370		
1/2" A307 Through Bolts ⁽²⁾⁽⁴⁾	2	24"	505	380	520	465	860	340
		19.2"	635	475	655	580	1,075	425
		16"	760	570	785	695	1,290	505
SDS 1/4" x 3 1/2" ⁽⁴⁾	2	24"	680	510	510	455		
		19.2"	850	640	640	565		
		16"	1,020	765	765	680		
SDS 1/4" x 6" ⁽³⁾⁽⁴⁾	2	24"				455	465	455
		19.2"				565	580	565
		16"				680	695	680
USP WS35 ⁽⁴⁾	2	24"	480	360	360	320		
		19.2"	600	450	450	400		
		16"	715	540	540	480		
USP WS6 ⁽³⁾⁽⁴⁾	2	24"				350	525	350
		19.2"				440	660	440
		16"				525	790	525
3 3/8" TrussLok ⁽⁴⁾	2	24"	635	475	475	425		
		19.2"	795	595	595	530		
		16"	955	715	715	635		
5" TrussLok ⁽⁴⁾	2	24"		500	500	445	480	445
		19.2"		625	625	555	600	555
		16"		750	750	665	725	665
6 3/4" TrussLok ⁽⁴⁾	2	24"				445	620	445
		19.2"				555	770	555
		16"				665	925	665

(1) Nailed connection values may be doubled for 6" on-center or tripled for 4" on-center nail spacing.

(2) Washers required. Bolt holes to be 1/16" maximum.


(3) 6" SDS or WS screws can be used with Parallam® PSL and Microllam® LVL, but are not recommended for TimberStrand® LSL.

(4) 24" on-center bolted and screwed connection values may be doubled for 12" on-center spacing.

General Notes

- Connections are based on NDS® 2005 or manufacturer's code report.
- Use specific gravity of 0.5 when designing lateral connections.
- Values listed are for 100% stress level. Increase 15% for snow-loaded roof conditions or 25% for non-snow roof conditions, where code allows.
- Bold Italic** cells indicate **Connector Pattern** must be installed on both sides. Stagger fasteners on opposite side of beam by 1/2 the required **Connector Spacing**.
- Verify adequacy of beam in allowable load tables on pages 16–33.
- 7" wide beams should be side-loaded only when loads are applied to both sides of the members (to minimize rotation).
- Minimum end distance for bolts and screws is 6".
- Beams wider than 7" require special consideration by the design professional.

Uniform Load Design Example

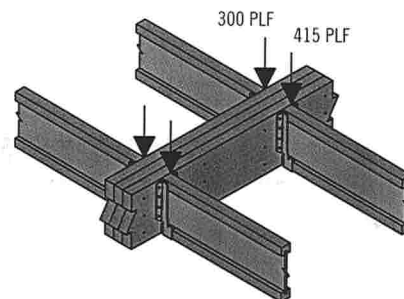

First, check the allowable load tables on pages 16–33 to verify that three pieces can carry the total load of 715 plf with proper live load deflection criteria. Maximum load applied to either outside member is 415 plf. For a 3-ply 1 3/4" assembly, two rows of 10d (0.128" x 3") nails at 12" on-center is good for only 280 plf. Therefore, use three rows of 10d (0.128" x 3") nails at 12" on-center (good for 415 plf).

Alternates:

Two rows of 1/2" bolts or SDS 1/4" x 3 1/2" screws at 19.2" on-center.




TRULOX CONNECTION DETAIL

11 GAUGE (0.120" X 1.375") NAILS REQUIRED FOR TRULOX PLATE ATTACHMENT. FILL ROWS COMPLETELY WHERE SHOWN (Φ).

* NAILS MAY BE OMITTED FROM THESE ROWS.

THIS DETAIL MAY BE USED WITH SO. PINE, DOUGLAS-FIR OR HEM-FIR CHORDS WITH A MINIMUM 1.00 DURATION OF LOAD OR SPRUCE-PINE-FIR CHORDS WITH A MINIMUM 1.15 DURATION OF LOAD. CHORD SIZE OF BOTH TRUSSES MUST EXCEED THE TRULOX PLATE WIDTH.

TRULOX PLATE IS CENTERED ON THE CHORDS AND BENT BETWEEN NAIL ROWS.
REFER TO ENGINEER'S SEALED DESIGN REFERENCING THIS DETAIL FOR LUMBER, PLATES, AND OTHER INFORMATION NOT SHOWN.

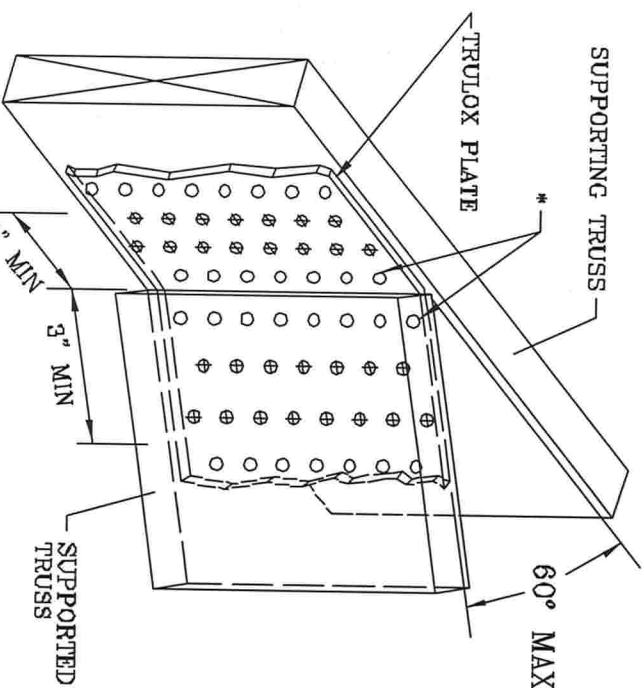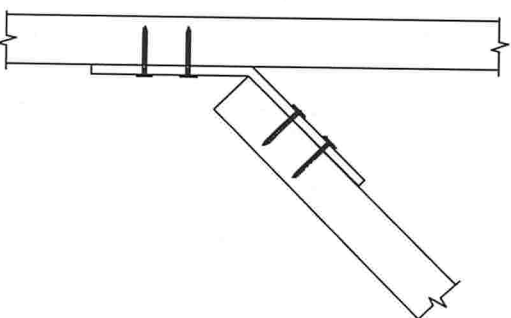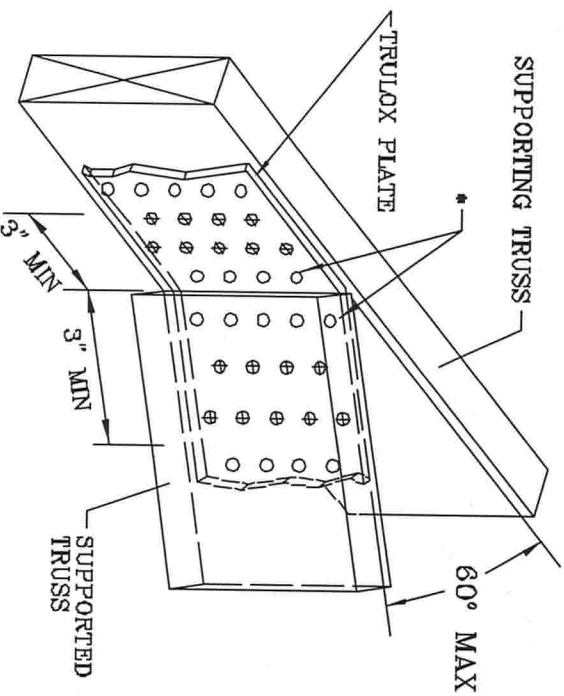


MINIMUM 3X6 TRULOX PLATE

MINIMUM 5X6 TRULOX PLATE

TRULOX PLATE SIZE	REQUIRED NAILS PER TRUSS	MAXIMUM LOAD UP OR DOWN
3X6	9	350#
5X6	15	990#

REVIEWED
By Julius Lee at 11:58 am, Jun 11, 2008

THIS DRAWING REPLACES DRAWINGS 1,156,989 1,159,989/B
1,154,844 1,152,217 1,152,017 1,159,154 & 1,151,524

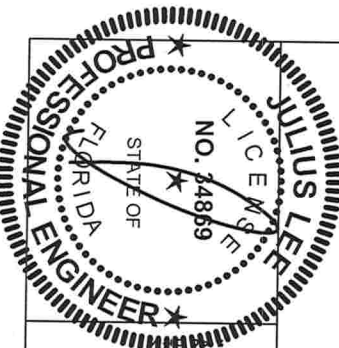

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO AC308-1-03 (BUILDING COMPONENT SAFETY INFORMATION) FOR TRUSS CHORDS, JOINTS, AND BRACING. REFER TO AC308-1-03 (BUILDING COMPONENT SAFETY INFORMATION) FOR TRUSS CHORDS, JOINTS, AND BRACING. UNLESS OTHERWISE INDICATED, THE CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL FIELDS AND JOINTS CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 SW 4th AVENUE
DELAKE BEACH, FL 32444-2101

No. 34869
STATE OF FLORIDA

REF	TRULOX
DATE	11/26/03
DRWG	CNTRULOX1103
-ENG	JL