A CUSTOM HOME FOR:

PETER & ANNA LEV

PROJECT ADDRESS:

LOT 19, RUSSWOOD LAKE CITY, FLORIDA 32024 (COLUMBIA COUNTY)



SHEET INDEX


- A.I FRONT & REAR ELEVATIONS
- A.2 LEFT & RIGHT ELEVATIONS
- A.3 DIMENSIONED FLOOR PLAN
- A.4 ELECTRICAL PLAN
- 51 FOUNDATION PLAN & DETAILS
- 5.2 ROOF PLAN, DETAILS & NOTES
- 53 WINDLOAD INFO, NOTES & DETAILS
- 5.4 FRAMING DETAILS & NOTES

AREA SUMMARY

LIVING AREA	2,530	
GARAGE AREA		S.F.
ENTRY PORCH AREA		S.F.
REAR PORCH AREA	193	S.F.
TOTAL AREA	3,456	S.F.

October 19, 2022
January 15, 2024


SOFTPXN ARCHITECTURAL DESIGN SOFTWARE

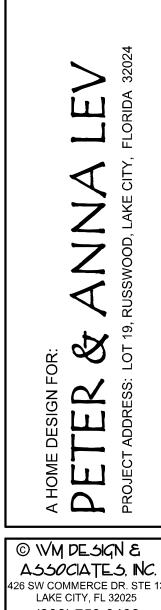

JOB NUMBER 20231214

SHEET NUMBER

COVER

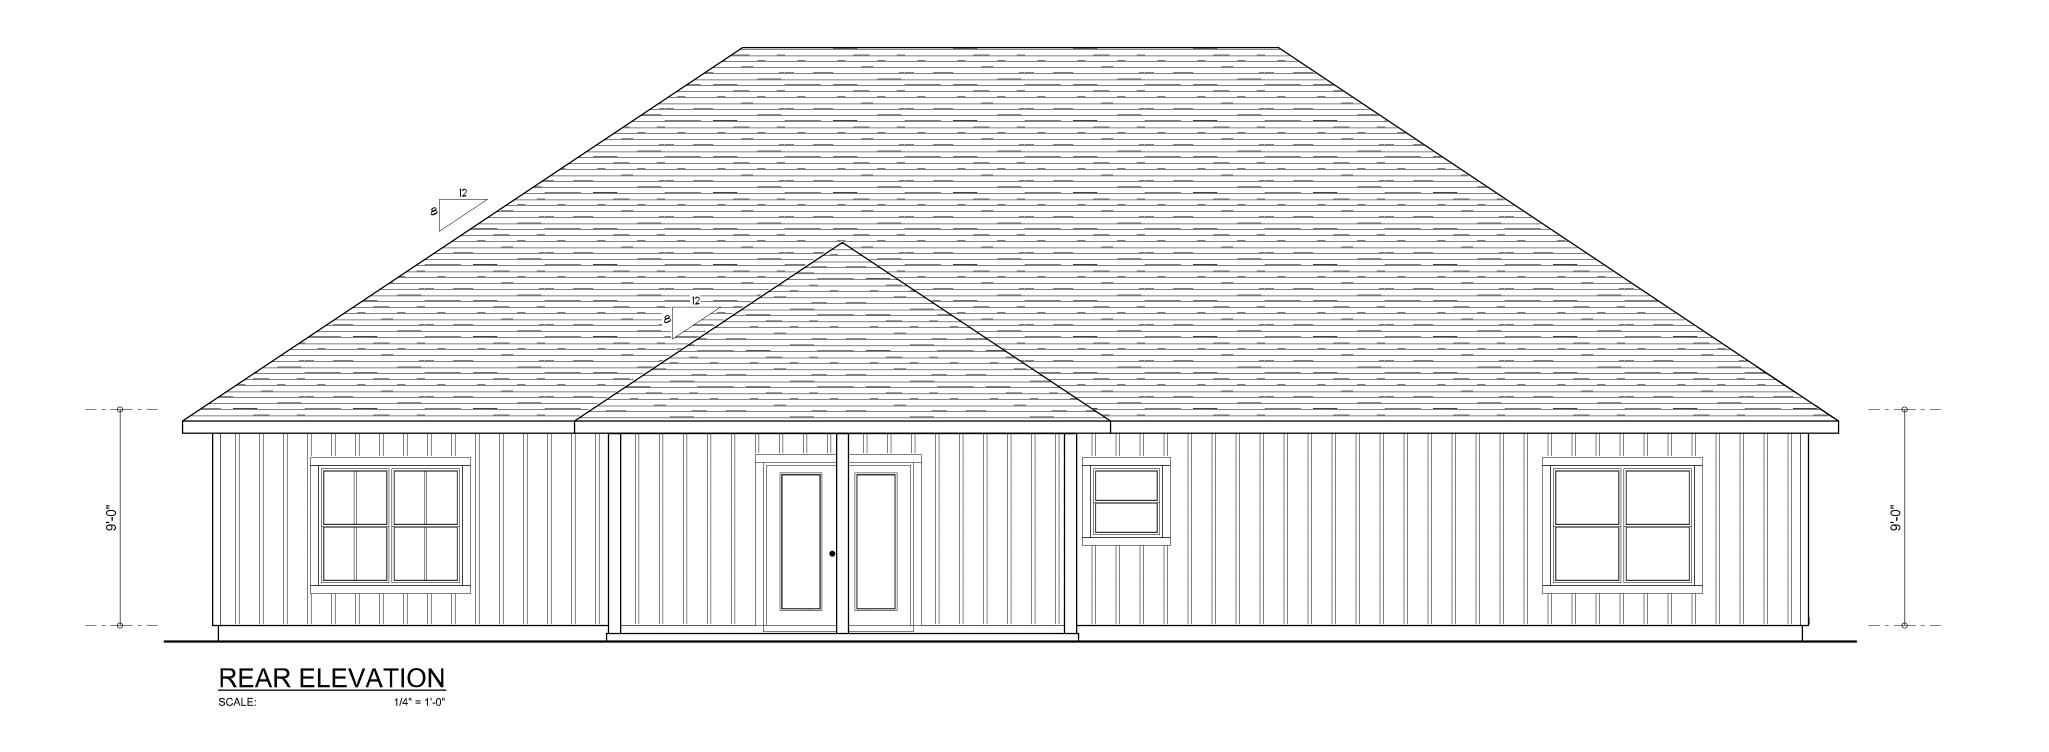

NNA LEV SWOOD, LAKE CITY, FLORIDA 32024

SOFTPIAN ARCHITECTURAL DESIGN SOFTWARE

& REAR ELEVATIONS

FRONT SCALE:

© WM DE. SIGN &
A.550CIATE.5, INC.
426 SW COMMERCE DR. STE 130
LAKE CITY, FL 32025
(386) 758-8406
will@willmyers.net




JOB NUMBER 20231214

SHEET NUMBER

A.1

Jul C-Ary [





JOB NUMBER 20231214

© WM PESIGN & ASSOCIATES, INC.
426 SW COMMERCE DR. STE 130
LAKE CITY, FL 32025
(386) 758-8406
will@willmyers.net

SOFTPIAN

ELEVATIONS


1/4" = 1'-0"


RIGHT

∞ಶ

TYPICAL

SHEET NUMBER

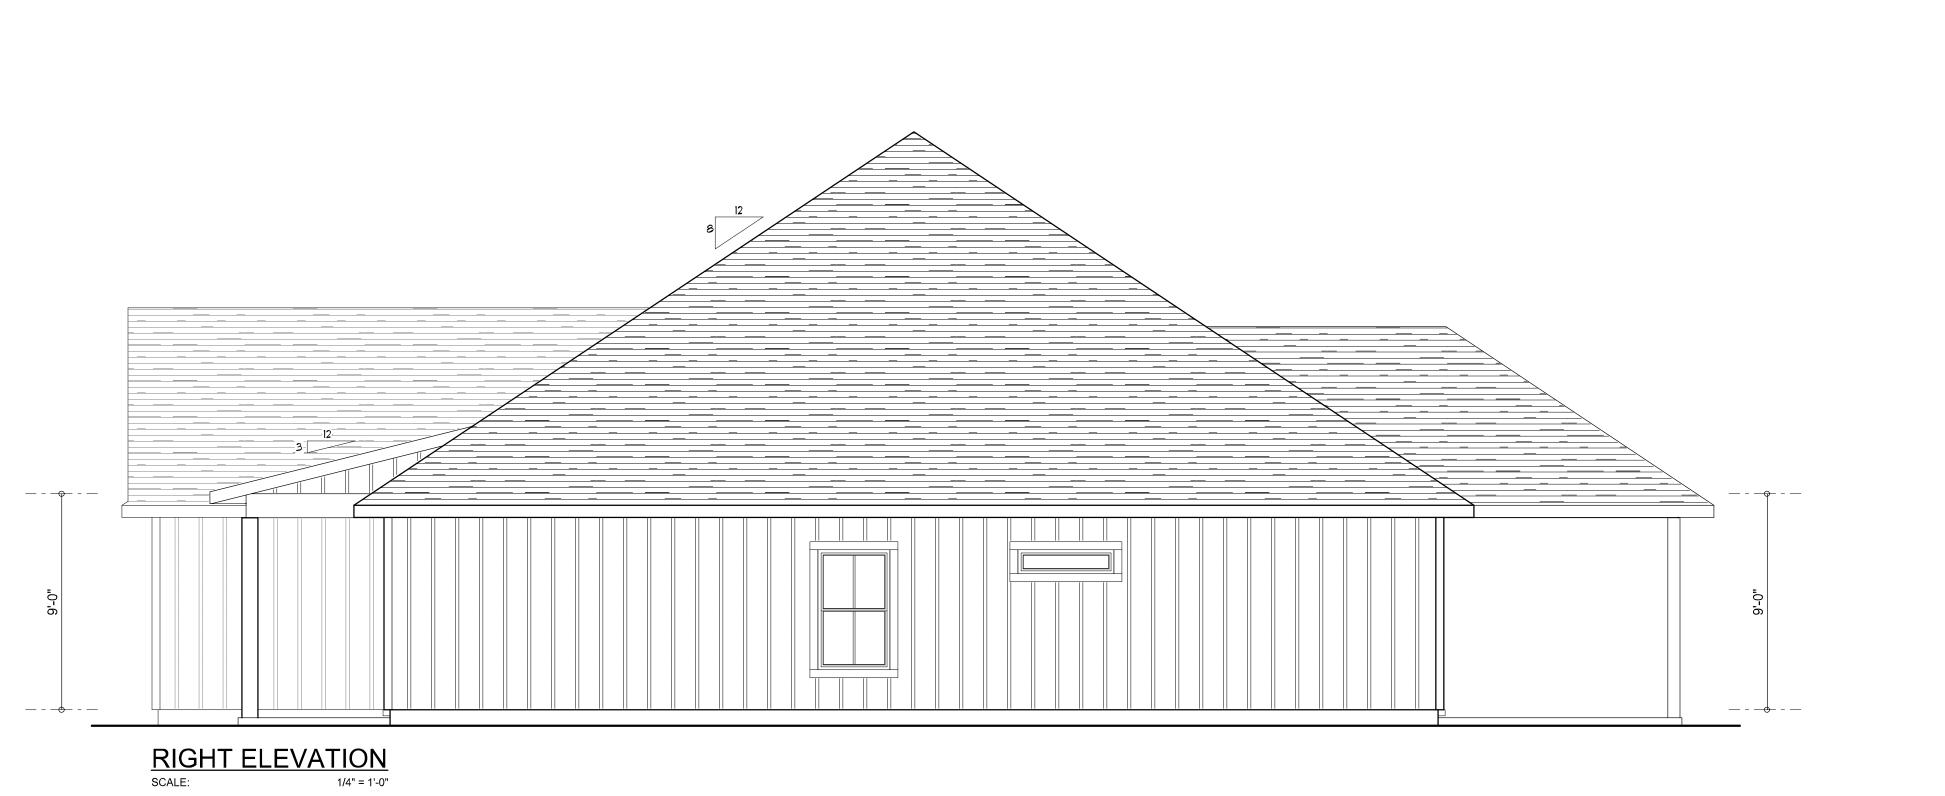

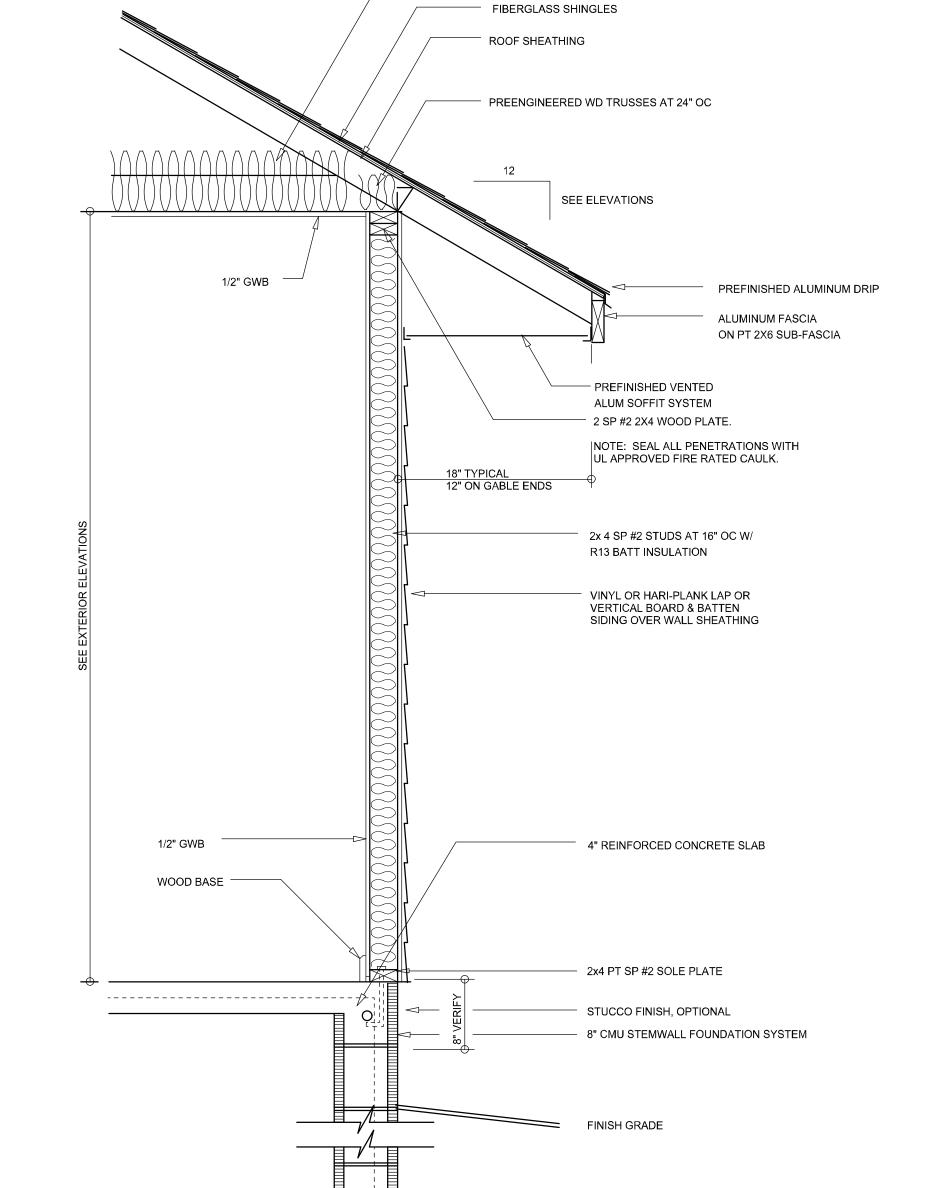


Ö O

TYPICAL WALL SECTION
SCALE: 1" = 1'- 0"

CONTINUOUS REINFORCED CONCRETE STRIP FOOTING

R38 INSULATION

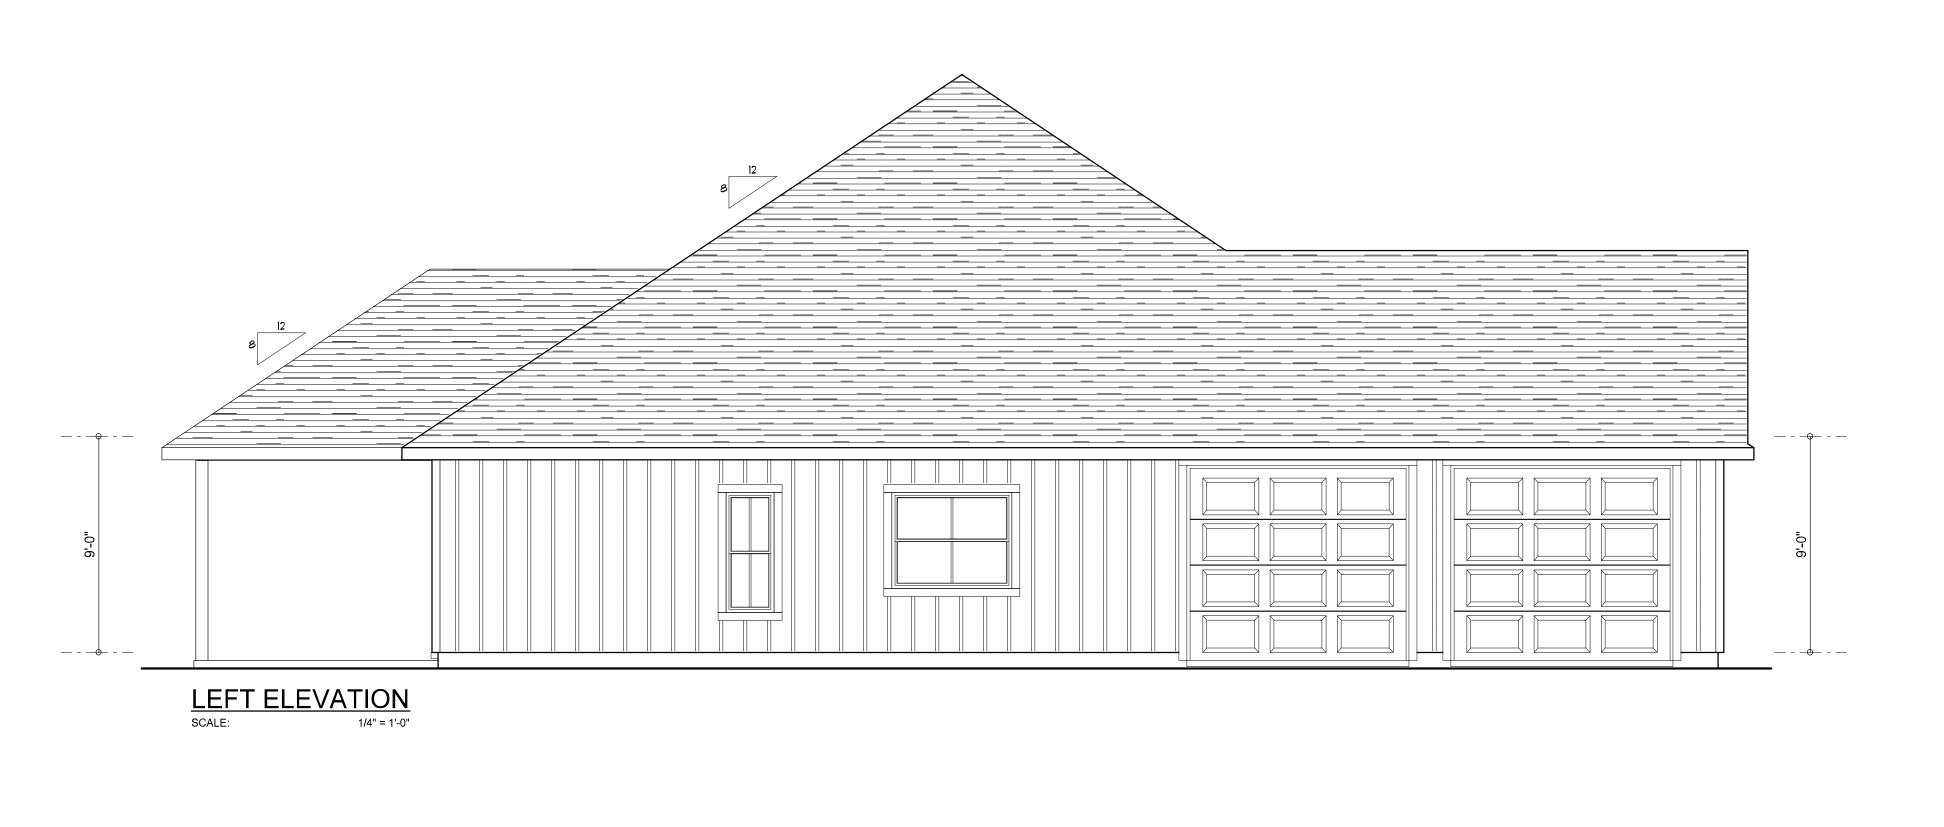

36X80 CCA220_2-sidelites RH

ENTRY PORCH

28'-0"

6'-8"

WD POST, WRAPPED TO 8" SQUARE. ANCHORED

66'-0"

W/ "SIMPSON" ABU66 POST BASE, 2 LOC.

- 6x 6 PT SP #2

DIMENSIONED FLOOR PLAN

3050 SH

6'-0"

NOTE: ALL CEILING HEIGHTS SHALL BE 9'-0" UNLESS OTHERWISE NOTED.

Garage fire separations shall comply with the following:

10'-0"

21'-8"

1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum ½-inch (12.7 mm) gypsum board applied to the garage side. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors in compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted.

3050 SH

5'-8"

3'-0"

7'-4"

7'-8"

2. Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.

7'-4"

— 2-PLY 1 3/4" X 11 1/4" 2.0E MICRO=LAM L.V.L BEAM, EXTEND TOP PLY OF WALL PLATE FULL LENGTH, LAP MIN. 32" TO ADJOINING WALL, ASSEMBLE W/ 16d NAILS @ 12" O.C., STAGGERED TOP & BOTTOM OF BEAM,

3. A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.

2-3050 SH EGRESS

16'-4"

7'-2"

12'-11"

4. When installing an attic access and/or pull-down stair unit in the garage, devise shall have a minimum 20 min. fire rating.

AREA SUMMARY

2,530 S.F. LIVING AREA 565 S.F. **GARAGE AREA** 168 S.F. **ENTRY PORCH AREA** 193 S.F. REAR PORCH AREA

TOTAL AREA

3,456 S.F.

NOTE: ALL DRAWINGS NOT TO BE SCALED, WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS

SOFTPIXN

 \leq 4


© WM DEJGN & ASSOCIATES, INC. 26 SW COMMERCE DR. STE 130 LAKE CITY, FL 32025 (386) 758-8406 will@willmyers.net

JOB NUMBER

20231214

SHEET NUMBER

A.3

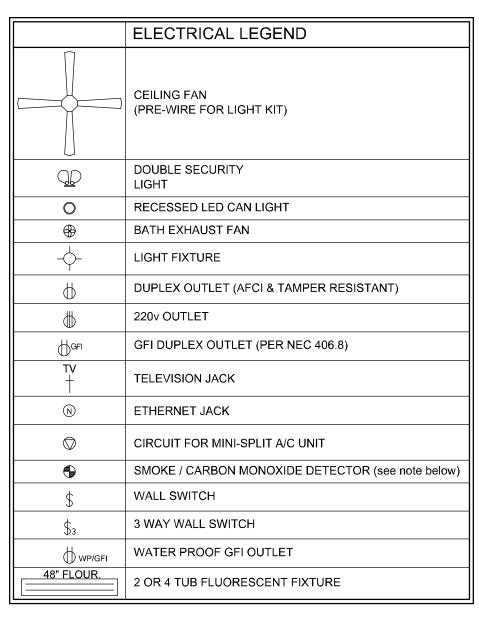

NOTE:


ALL INTERIOR RECEPTACLES SHALL BE AFCI
(ARC FAULT CIRCUIT INTERRUPT) PER NEC 210.12 & TAMPER RESISTANT PER

ALL INTERIOR & EXTERIOR LIGHTING SHALL MEET OR EXCEED THE MIN. 75% HIGH-EFFICIENCY LIGHTING PER FBC-ENERGY CONSERVATION R404.

ALL SMOKE DETECTORS BE A COMBO SMOKE & CARBON MONOXIDE DETECTOR AND SHALL HAVE BATTERY BACKUP POWER AND ALL WIRED TOGETHER SO IF ANY ONE UNIT IS ACTUATED THEY

THE ELECTRICAL SERVICE OVERCURRENT PROTECTION DEVICE SHALL BE INSTALLED ON THE EXTERIOR OF STRUCTURES TO SERVE AS A DISCONNECT MEANS. CONDUCTORS USED FROM THE EXTERIOR DISCONNECTING MEANS TO A PANEL OR SUB PANEL SHALL HAVE FOUR-WIRE CONDUCTORS, OF WHICH ONE CONDUCTOR SHALL BE USED AS AN EQUIPMENT GROUND.

IT IS THE LICENSED ELECTRICAL CONTRACTORS RESPONSIBILITY TO INSURE THAT ALL WORK PERFORMED AND EQUIPMENT INSTALLED MEETS OR EXCEEDS THE 2020 (NFPA-70) NATIONAL ELECTRIC CODE AND ALL OTHER LOCAL CODES AND ORDINANCES.

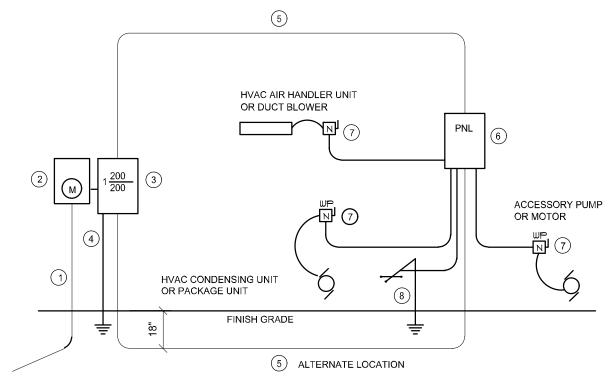


- Service/Feeder Entrance Conductors: 2" rigid conduit, min.
 18" deep, w/ continuous Ground Bonding Conductor, Service/
 Entrance Conductors shall not be spliced except that bolted
 connections at the Meter, Disconnecting Devices and Panel
- Meter Enclosure, weatherproof, U.L. Listed.
- Main Disconnect Switch: fused or Main BRKR, weatherproof,
- Service entrance Ground: }" ~ iron/steel rod x 8'-0" long and/or concrete encased foundation steel rebar x 20'-0" long. Grounding Conductor shall be bonded to each piece of Service/Entrance Equipment, and shall be sized per Item #5, below.
- 5 200 AMPERE SERVICE: 3-#2/0-USE-Cu, 1-#4-Cu-GND, 2" Conduit.
 6 House Panel (PNL), U.L. Lised, sized per schedule.
- 7) Equipment Disconnect Switch: non-fused, in weatherproof
- enclosure, size according to Panel Schedule loads.
- 8 Provide Ground Bond Wire to metal piping, size in accordance with the Service Ground Conductor.

THE MINIMUM AIC RATING FOR PANEL BOARDS, BRKRS AND DISCONNECT SWITCHES SHALL BE 22,000 AIC.

ELECTRICAL RISER DIAGRAM: 200A

SCALE: NONE

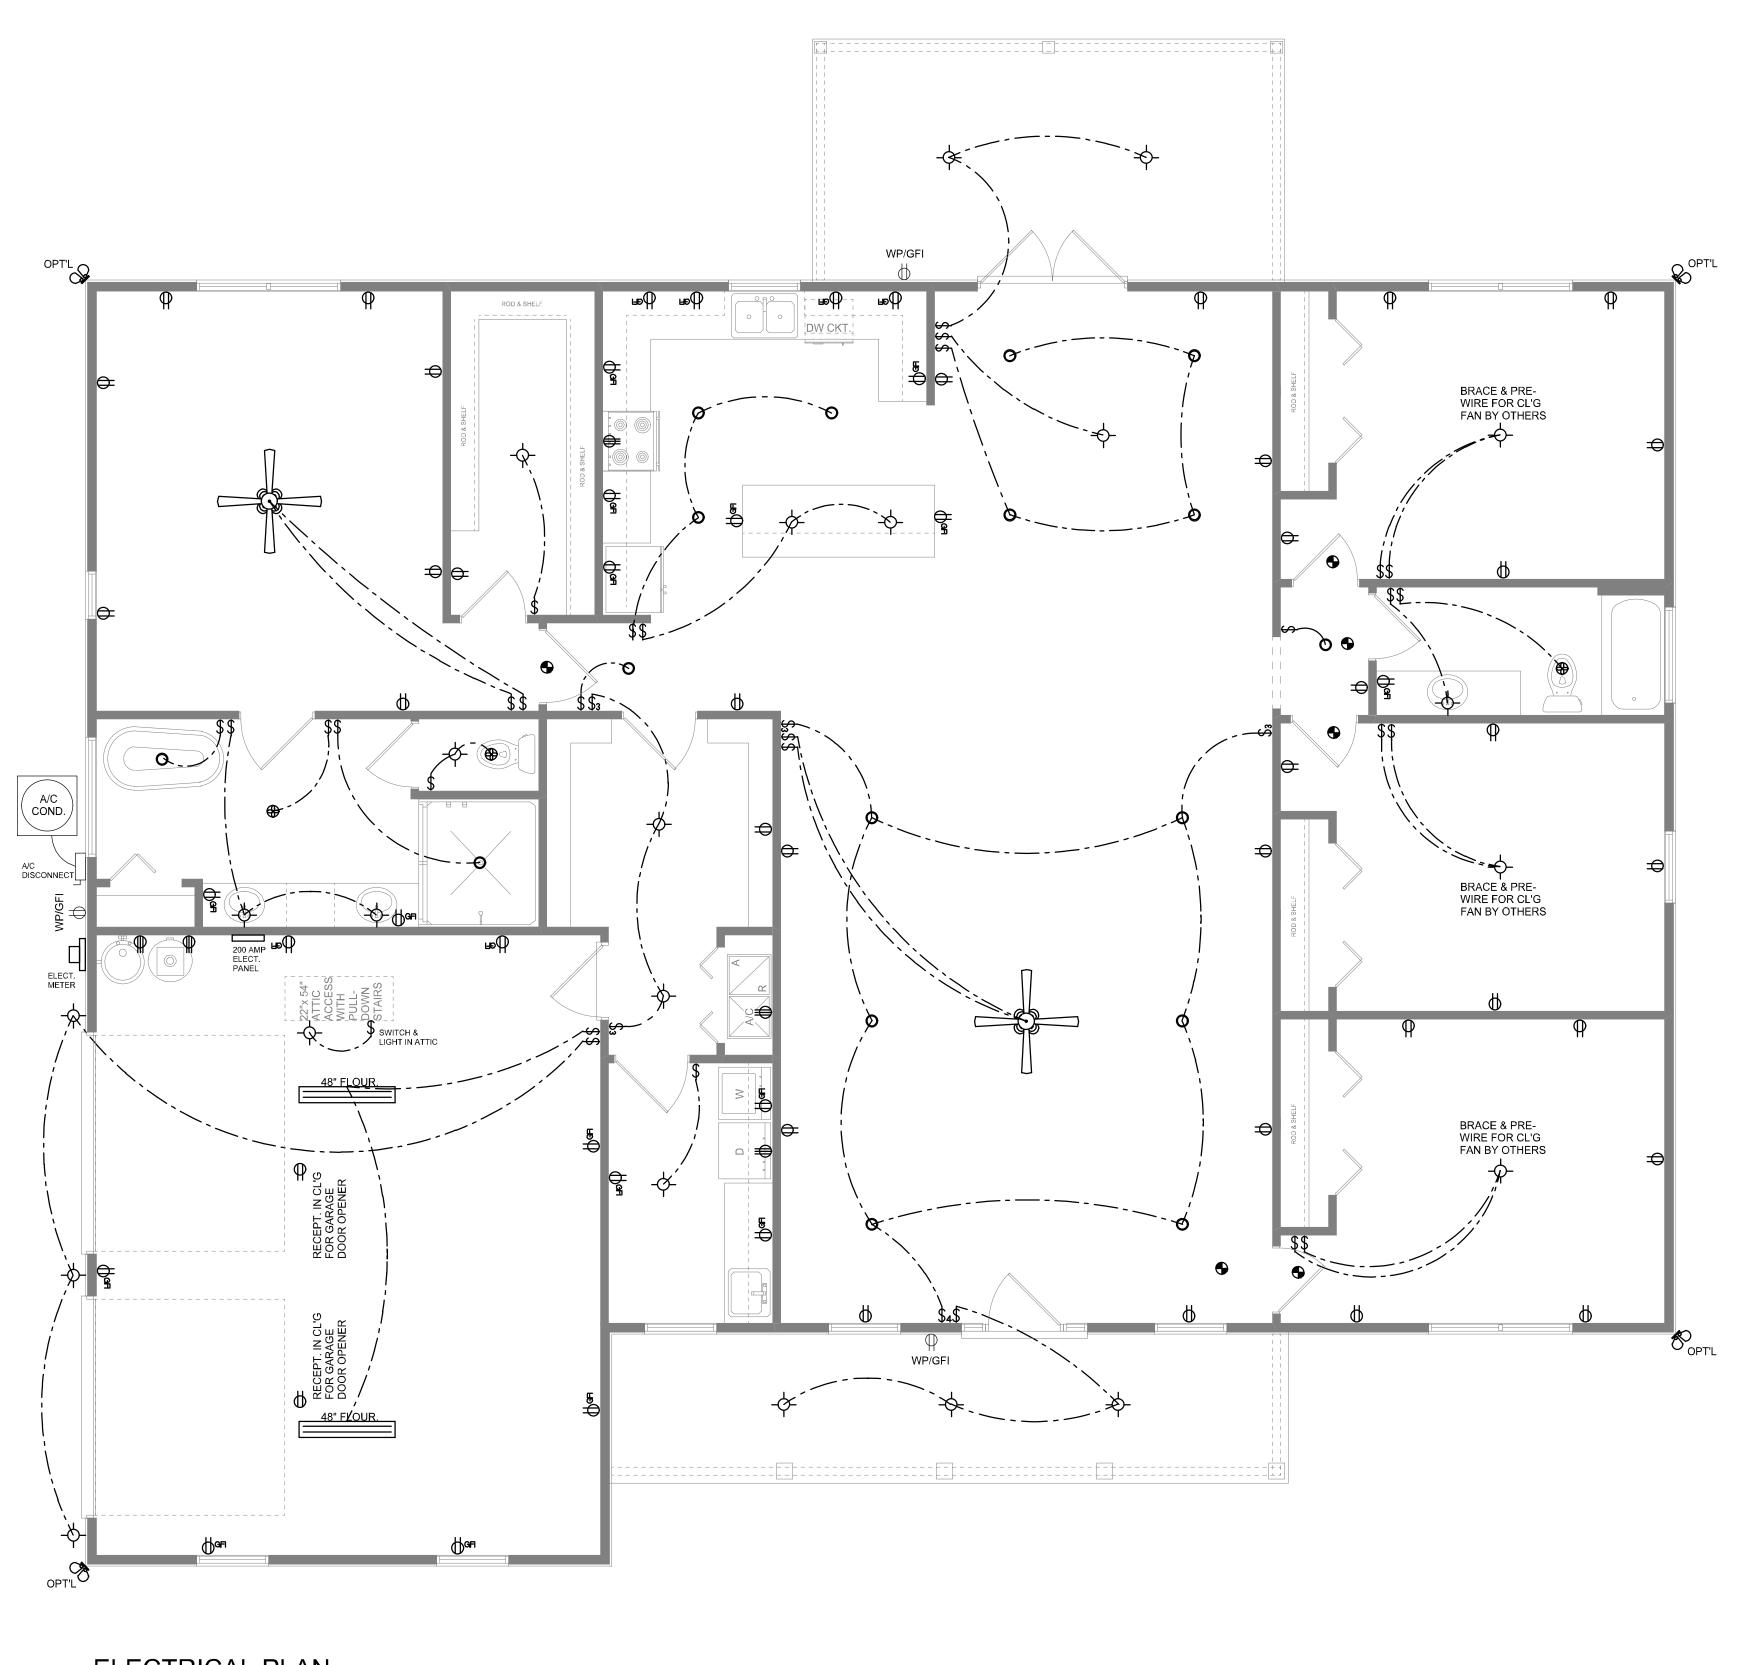

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

JOB NUMBER
20231214

SHEET NUMBER

A.4

 \leq

4

LAKE CITY, FL 32025

(386) 758-8406 will@willmyers.net

© VM DEJGN & AJJOCIATEJ, INC. 426 SW COMMERCE DR. STE 13

Dul C-Any